

# FieldMate Versatile Device Management Wizard

## Notice of Alterations


This notice of alterations amending that must be made to the 20th edition of FieldMate Versatile Device Management Wizard R3.04 (IM 01R01A01-01E).

## H Segment Viewer

### H-2 Segment Viewer Window

For devices that can communicate with FieldMate, the actual device is automatically recognized and displayed, and the device information is automatically registered in the database as device maintenance information.

For devices that are not covered by FieldMate, those that are manually registered are displayed.

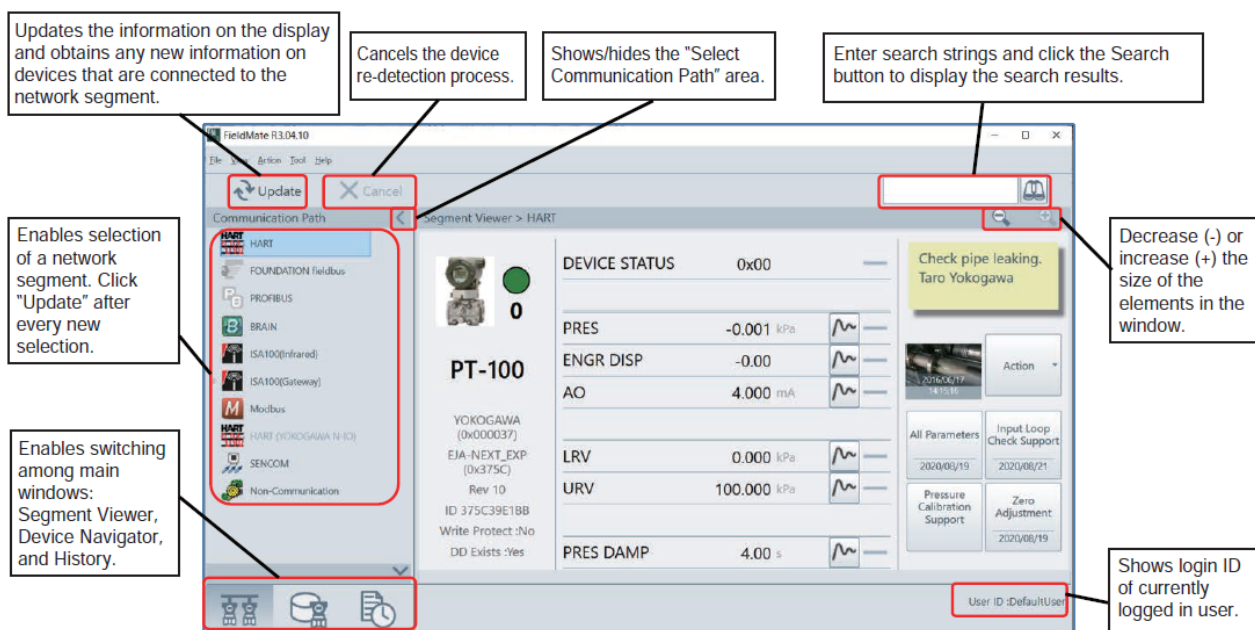

H020001 E.ai

Figure H-2-1 Segment Viewer (1)

**SEE ALSO** "J-3 Registration of Non-Communication device" about the procedure to register Non-communicate device.

The functions that used for Non-communicate device are as follows.

- Sticky note
- Image
- Calibration support function

**NOTE**

The Favorite selection button is displayed on the Segment Viewer if the “Enhanced Favorite function” is enabled. See “Appendix J Enhanced Favorite function” for details about “Enhanced Favorite function”.

---

**NOTE**

“HART (Yokogawa N-IO)” communication path in network segment is enabled when using FieldMate Validator and Field Commissioning Support Package.

FieldMate Validator and Field Commissioning Support Package require this communication path.

“HART (Yokogawa N-IO)” communication path remains enabled on the segment viewer after Field Commissioning Support Package is uninstalled.

---