

Please use this manual change for the following user's manual.

Document number	Edition	Title	Part to be changed
IM 01C25A01-10EN	2	EJX and EJA-E Series Differential Pressure and Pressure Transmitters Explosion-Protected Instruments (FM, CSA, ATEX and IECEx)	2.. Handling Cautions

The following WARNING applies when installing the blind plug, regardless of its condition at delivery (pre-installed in the connection port or provided in the packing box).


Add the following WARNING at the end of the section describing safe use of the product (Section 2.1).



## WARNING

When electrical connection code “7” or “C” is specified in combination with the following explosion protection options, apply appropriate seal to the threaded portion of the blanking element in the packing box, and tighten it into the electrical connection port of the instrument in accordance with IEC 60079-14.

	Option code
FM	FF1, FU1, FU14
ATEX	KF22, KU22, KU24
CSA	CF1, CU1
IECEx	SF22, SU22, SU34
Combination	V1U1

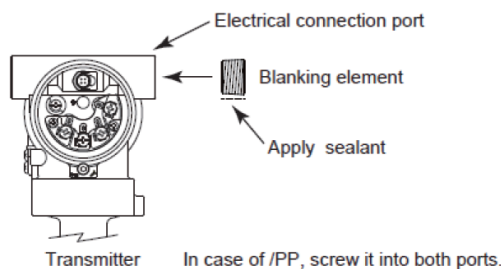

F0201.ai