

# pH in Diazo Coupler

**Industry:** Petrochemical, Chemical  
**Product:** pH

## Introduction

### Diazonium Coupling (Diazo Coupling, Azo Coupling):

Due to their positive charge, diazonium cations, which are generated by treatment of aromatic amines with nitrous acid and a stronger mineral acid, may participate in an electrophilic aromatic substitution as an electrophile. The electrophilic reaction center is the terminal nitrogen of the -N=N group. As a result, two aromatic compounds are coupled by a -N=N group. This is known as the azo group (diazo group). The corresponding reaction is called diazonium coupling (diazo coupling, azo coupling). However, the electrophilicity of diazonium ions is only relatively weak, as their positive charge is delocalized. The unsubstituted benzenediazonium cation may react only with strongly activated aromatic compounds, such as phenolates and amines.

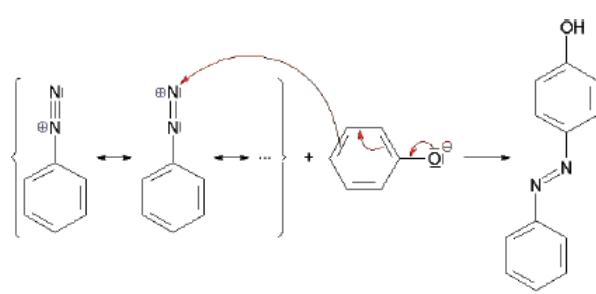


Fig. 1 Diazo coupling with a phenolate.

Azo coupling is the most widely used industrial reaction in the production of dyes, lakes and pigments. Aromatic diazonium ions acts as electrophiles in coupling reactions with activated aromatics such as anilines or phenols. The

substitution normally occurs at the para position, except when this position is already occupied, in which case *ortho* position is favoured. The pH of solution is quite important; it must be mildly acidic or neutral, since no reaction takes place if the pH is too low.

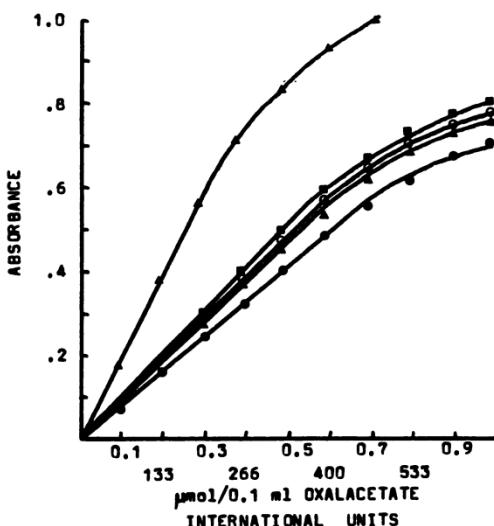


Fig. 2 The effect of pH on standard curves of diazonium coupling with oxalacetate. Except for dye and pH, all parameters are as described in procedure  
—○— Fast Red PDC, pH 4.2; —△— Fast Red PDC, pH 7.5; —●— Fast Red RC, pH 4.2; —▲— Fast Red RC, pH 7.5; —■— Fast Red RC, pH 8.5

## Application Information

### Typical process details:

Chemical Composition - Coupler + Diazo Coupler – 48 % caustic + Nephthol + Water  
 Diazo – 36% HCL + Diecloro Anelene + Water  
 Operating Temperature – 55°C  
 Operating Pressure – 4 kg/cm<sup>2</sup>

### Typical problems:

Limited life of sensor

## Summary

The process is indeed quite aggressive so Glass is best material.

### Sensor Selection:

*Sensor Option #1:* SC21C-AGC55 would be best, if it is possible to pressurize the electrolyte to 5 bar (72PSI).

#### Features for type SC21C-AGC55

- Heavy duty pH sensitive glass.
- Flowing reference system for pollution resistance, and highly stable reference potential.
- Use in combination with the pressurizable electrolyte reservoir to obtain a positive flow towards the process (K1500YA)

*Sensor Option #2: (-FTS or -FTS) → (-FTS or -MTS)*

is possible if the cation (salt) content is stable during the pH control step.

#### Features:

The FU20-\*FTS and FU20-\*MTS are a differential pH sensors. This means that the reference is not a (liquid) junction but a glass sensor which does not respond to pH changes (within the applicable range of the sensor). Therefore the sensor is truly maintenance free and the output voltage of the sensor depends only on the salt concentration of the process.

The sensor responds to pH changes rather than analyses the accurate pH value. In that sense it is best to describe the sensor as pH control sensor rather than pH measuring sensor.

A pH sensor measures the voltage that the pH membrane measures as function of the pH value of the process sample. This voltage is then compared with the mV output of a reference cell that is independent on the pH value of the sensor.

In most pH control applications the salt concentration is rather constant, so the output of the FU20 differential sensor is only dependent on the pH of the process.

A rule of thumb is that a change in salt concentration of +/- 25% has an effect of less than 0.1 pH on the pH reading.

### Analyzer/ Transmitter Selection:

*Option #1:* 4 wire pH Analyzer



Type: 4 wire type

#### Features

- Easy touchscreen operation
- Multi sensor input available

*Option #2:* 2 wire pH transmitter



Type: 2 wire type

#### Features

- Redundant system on dual sensor measurement
- Easy touch screen operation on 2-wire type analyzer

#### Tangible benefit:

More reliable and accurate analysis of pH which helps to improve end product quality.

#### Trademarks

Co-innovating tomorrow, OpreX and all product names of Yokogawa Electric Corporation in this bulletin are either trademarks or registered trademarks of Yokogawa Electric Corporation. All other company brand or product names in this bulletin are trademarks or registered trademarks of their respective holders.

#### YOKOGAWA ELECTRIC CORPORATION

##### World Headquarters

9-32, Nakacho 2-chome, Musashino-shi, Tokyo 180-8750, JAPAN

<http://www.yokogawa.com/an/>



#### YOKOGAWA CORPORATION OF AMERICA

YOKOGAWA EUROPE B.V.

YOKOGAWA ENGINEERING ASIA PTE. LTD.

YOKOGAWA CHINA CO., LTD.

YOKOGAWA MIDDLE EAST & AFRICA B.S.C.(c)

<http://www.yokogawa.com/us/>

<http://www.yokogawa.com/eu/>

<http://www.yokogawa.com/sg/>

<http://www.yokogawa.com/cn/>

<http://www.yokogawa.com/bh/>

Subject to change without notice.

All Rights Reserved, Copyright © 2015, Yokogawa Electric Corporation