

General Specifications

ROTAMASS Total Insight Coriolis Mass Flow and Density Meter Nano



GS 01U10B01-00EN-R



Rotamass Nano - For low flow applications

Features and benefits

- Accurate measuring results with flat accuracy specification from 2.5 kg/h
- Uninterrupted and repeatable mass flow measurement even under high aeration conditions
- Batching function with batch leakage detection and batch control by display or automatic for precise dosing
- Thick measuring tubes and wetted parts made of 316L/1.4404 and Nickel Alloy C-22/2.4602 against corrosion and abrasion for increased safety
- Large portfolio of process connections starting with ¼ in. (DN06) combined with customer specific installation length options for reduced installation efforts
- Reliable and safe measurements with advanced self-diagnostics and Tube Health Check function

Process Guard



Operation and
Observation

- Meter Performance under wide process conditions
- Meter Verification in line by Tube Health Check function

Table of contents

1	Introduction	4
1.1	About this General Specification	4
1.2	Applicable documents	4
1.3	Measuring system	5
1.4	Transmitter	6
2	Application and measuring ranges	7
2.1	Measured quantities	7
2.2	Mass flow	8
2.3	Pressure loss	9
2.4	Density	9
2.5	Process fluid temperature range	9
3	Accuracy	10
3.1	Overview	10
3.2	Zero point stability of the mass flow	11
3.3	Mass flow accuracy	12
3.4	Accuracy of density	13
3.4.1	For liquids	13
3.4.2	For gases	13
3.5	Accuracy of mass flow and density according to the model code	14
3.5.1	For liquids	14
3.5.2	For gases	15
3.6	Volume flow accuracy	15
3.6.1	For liquids	15
3.6.2	For gases	15
3.7	Accuracy of temperature	16
3.8	Repeatability	16
3.9	Calibration conditions	17
3.9.1	Mass flow calibration and density adjustment	17
3.9.2	Density calibration	17
3.9.3	Calibration for gases	17
3.10	Process conditions	18
3.10.1	Process pressure effect	18
3.10.2	Process fluid temperature effect	18
3.11	Analog output specification	20
4	Operating conditions	21
4.1	Location and position of installation	21
4.1.1	Sensor installation position	22
4.2	Process conditions	24
4.2.1	Pressure	24
4.2.2	Secondary containment	29
4.2.3	Insulation and heat tracing	30
4.3	Ambient conditions	31
4.3.1	Allowed ambient temperature for sensor	33
4.3.2	Temperature specification in hazardous areas	35

5	Mechanical specification	39
5.1	Design	39
5.2	Material	40
5.2.1	Sensor.....	40
5.2.2	Transmitter	41
5.2.3	Nameplates.....	41
5.2.4	Heat tracing.....	42
5.3	Process connections, dimensions and weights of sensor	43
5.4	Transmitter dimensions and weights.....	54
6	Electrical specification	56
6.1	Power supply.....	56
6.2	Electrical interfaces	56
6.2.1	Analog inputs and outputs	57
6.2.2	Digital inputs and outputs	60
6.2.3	HART	64
6.2.4	Modbus	66
6.2.5	PROFIBUS PA.....	67
6.2.6	FOUNDATION Fieldbus.....	69
6.2.7	PROFINET over APL.....	71
6.3	Display and microSD card.....	73
6.4	Cable specifications	74
7	Approvals and declarations of conformity	75
7.1	Legal equipment standards and norms.....	75
7.2	Application and industry related standards	76
7.3	Communication interface standards.....	77
7.4	Other standards and guidelines	77
7.5	Hazardous area.....	78
8	Ordering information	82
8.1	Model code description	82
8.2	Available model codes per basic model.....	90
8.3	Ordering Instructions.....	94
8.3.1	Mandatory ordering instructions	94
8.3.2	Optional ordering instructions	94

1 Introduction

This specification provides overview about Rotamass Total Insight portfolio. Complete specification is available per product line.

1.1 About this General Specification

All available properties of the Rotamass Coriolis flow meter are specified by means of a model code.

One model code position may include several characters depicted by means of dashed lines.

The positions of the model code relevant for the respective properties are depicted and highlighted in blue. Any values that might occupy these model code positions are subsequently explained.




Fig. 1: Highlighted model code positions

A complete description of the model code is included in the chapter 8 *Ordering information* [82].

1.2 Applicable documents

The following documents supplement this specification:

Document title	Document number
General Specifications:	
▪ General Specifications Rotamass Specification Overview	GS 01U10B00-00__-R ¹⁾
▪ General Specifications Rotamass Spare Transmitter	GS 01U10B21-00__-R ¹⁾
Instruction Manuals:	
▪ General Instruction Manual	IM 01U10B00-00__-R ¹⁾
▪ Quick Reference Instruction Manual	IM 01U10A00-00__-R ¹⁾
▪ Quick Reference Instruction Manual for Spare	IM 01U10A01-00__-R ¹⁾
Explosion proof type Manuals:	
▪ Explosion Proof Type Manual ATEX	IM 01U10X01-00__-R ¹⁾
▪ Explosion Proof Type Manual IECEx	IM 01U10X02-00__-R ¹⁾
▪ Explosion Proof Type Manual FM	IM 01U10X03-00__-R ¹⁾
▪ Explosion Proof Type Manual INMETRO	IM 01U10X04-00__-R ¹⁾
▪ Explosion Proof Type Manual PESO	IM 01U10X05-00__-R ¹⁾
▪ Explosion Proof Type Manual NEPSI	IM 01U10X06-00__-R ¹⁾
▪ Explosion Proof Type Manual Korea-Ex	IM 01U10X07-00__-R ¹⁾
▪ Explosion Proof Type Manual EAC-Ex	IM 01U10X08-00__-R ¹⁾
▪ Explosion Proof Type Manual Japan Ex	IM 01U10X09-00__-R ¹⁾
Software Instruction Manuals:	
▪ Software Instruction Manual HART	IM 01U10S01-00__-R ¹⁾
▪ Software Instruction Manual FOUNDATION Fieldbus	IM 01U10S02-00__-R ¹⁾
▪ Software Instruction Manual Modbus	IM 01U10S03-00__-R ¹⁾
▪ Software Instruction Manual PROFIBUS PA	IM 01U10S04-00__-R ¹⁾
▪ Software Instruction Manual PROFINET over APL	IM 01U10S05-00__-R ¹⁾

¹⁾ The "_" symbols are placeholder for the corresponding language version of the document (EN, DE, etc.).



The complete product documentation is stored on the microSD card delivered with the device and is available at:

- Yokogawa Customer Portal (<http://myportal.yokogawa.com/s/documents>)
- Yokogawa Device Lifecycle Management app

Please enter the serial number of the device or scan the QR code on the device.

1.3 Measuring system

The Rotamass Coriolis flow meter consists of:

- Sensor
- Transmitter

When the remote type is used, sensor and transmitter are linked via connecting cable. As a result, sensor and transmitter can be installed in different locations.

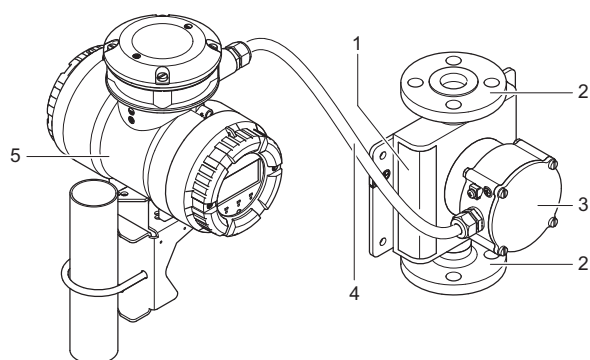


Fig. 2: Configuration of the Rotamass remote type

1	Sensor	4	Connecting cable
2	Process connections	5	Transmitter
3	Sensor terminal box		


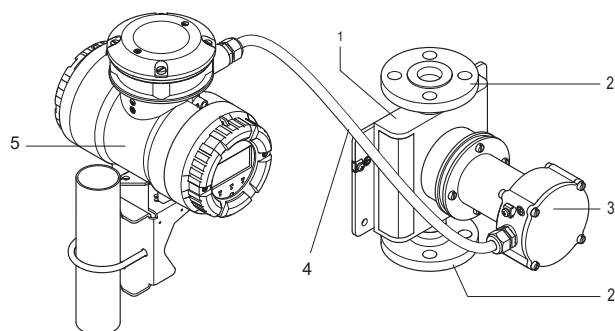


Fig. 3: Configuration of the Rotamass remote type - long neck


1	Sensor	4	Connecting cable
2	Process connections	5	Transmitter
3	Sensor terminal box		

1.4 Transmitter


The sensor can be combined with different transmitters. The transmitter type is visible in the indicator.



Essential Transmitter



Ultimate Transmitter



Model code position 1	Transmitter type	Description	Communication Interfaces
E	Essential	Basic functions	HART, Modbus
U	Ultimate	Advanced functions	HART, Modbus, PROFIBUS PA, FOUNDATION Fieldbus, PROFINET over APL

Transmitter functions are described in detail in the Specification overview GS01U10B00-00__-R.
For details about available functions per transmitter type refer to chapter *Ordering information* [▶ 82].

2 Application and measuring ranges

This flowmeter is intended to measure mass flow of fluids while simultaneously also capturing their density and temperature. Based on those values additional measured quantities are calculated.

Use of the flow meter is limited by the necessary fluid homogeneity and wetted parts chemical resistance. Operational safety cannot be ensured in the event of any improper or not intended use. Yokogawa is not liable for damage arising from such case.

Flow meter as specified is a class A device according to EN 61326-1 and may only be used in an industrial environment.



In this chapter, all values related to pressure are gauge pressure values.



For process specific results, please refer to the FlowConfigurator online sizing and configuration tool: <http://www.FlowConfigurator.com>

2.1 Measured quantities

The Rotamass Coriolis flow meter can be used to measure the following fluids:

- Liquids
- Gases
- Mixtures, such as emulsions, suspensions, slurries

Possible limitations applying to measurement of mixtures must be checked with the responsible Yokogawa sales organization.

The following variables can be measured using Rotamass:

- Mass flow
- Density
- Temperature

Based on these measured quantities, the transmitter also calculates:

- Volume flow
- Partial component concentration of a two-component mixture
- Partial component flow rate of a mixture consisting of two components (net flow)

The net flow is calculated based on the known partial component concentration and the overallflow.

The mass flow, volume flow, net flow measurements can be bi-directional.


Measured quantities for NTEP custody transfer approval

Measurement variables for NTEP approval options /Q20 are:

- Mass flow unidirectional
- Volume flow unidirectional

2.2 Mass flow

For Rotamass Nano the following meter sizes to be determined using the *Model code description* [► 82] are available.



Mass flow of liquids

Meter size	Typical connection size	Q_{nom} in t/h (lb/min)	Q_{max} in t/h (lb/min)	Model code position 3
Nano 06	DN15, ½"	0.021 (0.77)	0.040 (1.5)	06
Nano 08	DN15, ½"	0.045 (1.7)	0.094 (3.5)	08
Nano 10	DN15, ½"	0.170 (6.2)	0.300 (11)	10
Nano 15	DN15, ½"	0.370 (14)	0.600 (22)	15
Nano 20	DN15, ½"	0.950 (35)	1.500 (55)	20

Q_{nom} - Nominal mass flow

Q_{max} - Maximum mass flow

Q_{min} - Minimum mass flow

The nominal mass flow Q_{nom} is defined as the mass flow of water (temperature: 20 °C) at 1 bar (14.5 psi) pressure loss across the flow meter. The flowmeter has factory defined low cut suppressing flow measurement values below 0.05 % of Q_{nom} .

Mass flow measuring range for NTEP custody transfer approval

Tab. 1: Mass flow measuring ranges (/Q20)

Meter size	Typical connection size	Q_{min} in t/h (lb/min)	Q_{max} in t/h (lb/min)
Nano 20	DN15, ½"	0.12 (4.410)	0.96 (35.273)

Mass flow of gases

When using Rotamass for measuring the flow of gases, the mass flow is usually limited by the pressure loss generated and the maximum flow velocity.

Type of gas	Meter size	Maximum flow velocity	
		in [m/s]	in [ft/s]
Oxygen	All	60	197
Methane	All	40	131
Natural gas			
Other gases	All	33 % of sound velocity	

2.3 Pressure loss

The pressure loss along the flow meter is heavily dependent on the application. The pressure loss of 1 bar at nominal mass flow Q_{nom} also applies to water and is considered the reference value.

2.4 Density

Meter size	Measuring range of density in kg/l (lb/ft ³)
Nano 06	0 – 5 (0 – 312)
Nano 08	
Nano 10	
Nano 15	
Nano 20	

Density measuring range for NTEP custody transfer approval

Tab. 2: Density measuring ranges (/Q20)

Option	Measuring range of density in kg/l (lb/ft ³)
/Q20	0.74 – 1.40 (46 – 87)

Density of gases


Rather than being measured directly, density of gas is usually calculated using its reference density, process fluid temperature and process pressure.

2.5 Process fluid temperature range



Allowed process fluid and ambient temperature ranges in hazardous areas depend on classifications defined by applications, refer to *Temperature specification in hazardous areas* [▶ 35].

For Rotamass Nano the following process fluid temperature ranges are available:



Temperature range	Model code position 6	Model code position 8	Process fluid temperature in °C (°F)	Design type	Model code position 10
Standard	HS3	0	-50 – 140 (-58 – 284)	Remote type	A, B, E, F, J, K
	HS4, HS8		-10 – 140 (14 – 284)		
	Others		-50 – 150 (-58 – 302)		
Medium	Others	2	-50 – 260 (-58 – 500)		B, F, K

3 Accuracy

In this chapter, maximum deviations are indicated as absolute values.



All accuracy data are given in $\pm$ values.

3.1 Overview

Achievable accuracies for liquids

The value D_{flat} specified for accuracy of mass flow applies for flow rates exceeding the mass flow limit Q_{flat} . If the flow rate is less than Q_{flat} , other effects have to be considered.

If the flow rate is higher than Q_{nom} , other effects might influence the accuracy (e.g. cavitation).

The following values are achieved at calibration conditions when the device is delivered, see *Calibration conditions* [► 17]. For small meter sizes, specifications may not be as accurate, see *Mass flow accuracy* [► 12].

Measured quantity		Accuracy for transmitters	
		Essential	Ultimate
Mass flow ¹⁾	Accuracy ²⁾ D_{flat}	0.2 % of measured value	0.1 % of measured value
	Repeatability ³⁾	0.1 % of measured value	0.05 % of measured value
Volume flow (water) ¹⁾	Accuracy ²⁾ D_v	0.45 % of measured value	0.12 % of measured value
	Repeatability ³⁾	0.23 % of measured value	0.06 % of measured value
Density	Accuracy ²⁾	4 g/l (0.25 lb/ft ³)	0.5 g/l (0.03 lb/ft ³)
	Repeatability ³⁾	2 g/l (0.13 lb/ft ³)	0.3 g/l (0.02 lb/ft ³)
Temperature	Accuracy ²⁾	0.5 °C (0.9 °F)	0.5 °C (0.9 °F)

Achievable accuracies for gases

Measured quantity		Accuracy for transmitters	
		Essential	Ultimate
Mass flow / standard volume flow ¹⁾	Accuracy ²⁾ D_{flat}	0.75 % of measured value	0.5 % of measured value
	Repeatability ³⁾	0.6 % of measured value	0.4 % of measured value
Temperature	Accuracy ²⁾	0.5 °C (0.9 °F)	0.5 °C (0.9 °F)

¹⁾ Based on the measured values of the pulse output. This means that the flow accuracy and repeatability considers the combined measurement uncertainties including sensor, electronic and pulse output interface.

²⁾ Best mass flow accuracy per transmitter type for Nano 15 and Nano 20.

³⁾ The stated repeatability is included in the accuracy.

3.2 Zero point stability of the mass flow

In case of no flow, the maximum measured flow rate is called Zero point stability. Zero point values are shown in the table below.

Meter size	Zero point stability Z in kg/h (lb/h)
Nano 06	0.003 (0.007)
Nano 08	0.005 (0.011)
Nano 10	0.009 (0.019)
Nano 15	0.019 (0.042)
Nano 20	0.048 (0.11)

3.3 Mass flow accuracy

Above mass flow Q_{flat} , maximum deviation is constant and referred to as D_{flat} . It depends on the product version and can be found in the tables in chapter *Accuracy of mass flow and density according to the model code* [► 14].

Use the following formulas to calculate the maximum deviation D :

$$Q_{nom} \geq Q_m \geq Q_{flat} \rightarrow D = D_{flat}$$

$$Q_m < Q_{flat} \rightarrow D = \frac{a \times 100 \%}{Q_m} + b$$

D Maximum deviation in %

D_{flat} Maximum deviation for high flow rates in %

Q_m Mass flow in kg/h

Q_{flat} Mass flow value above which D_{flat} applies, in kg/h

a, b Constants

Meter size (Q_{nom} in kg/h)	Model code position 9	D_{flat} in %	Q_{flat} in kg/h	a in kg/h	b in %
Nano 06 (21)	E9	0.2	2.52	0.004	0.041
	D9	0.15	2.8	0.0035	0.024
	70	0.75	2.52	0.004	0.591
	50	0.5	2.8	0.0035	0.374
Nano 08 (45)	E8	0.2	4.5	0.0071	0.041
	D8	0.15	5	0.0061	0.028
	C8	0.1	5.6	0.0054	0.003
	70	0.75	4.5	0.0071	0.591
	50	0.5	5	0.0061	0.378
Nano 10 (170)	E7	0.2	8.5	0.021	-0.05
	D3, D7	0.15	11	0.012	0.038
	C3, C7	0.1	14	0.0097	0.031
	70	0.75	8.5	0.021	0.5
	50	0.5	11	0.012	0.388
Nano 15 (370)	E7	0.2	18.5	0.048	-0.057
	D2, D3, D7	0.15	25	0.027	0.042
	C2, C3, C7	0.1	30	0.022	0.028
	70	0.75	18.5	0.048	0.493
	50	0.5	25	0.027	0.392
Nano 20 (950)	E7	0.2	47.5	0.12	-0.053
	D2, D3, D7	0.15	64	0.068	0.043
	C2, C3, C7	0.1	79	0.055	0.031
	70	0.75	47.5	0.12	0.497
	50	0.5	64	0.068	0.393

¹⁾ Water calibration transferability to gas according to AGA11. AGA11 confirmed by declaration of conformity available with Rotamass Total Insight HART firmware rev.4 or later. For details please contact your local Yokogawa sales organization.

Accuracy using water at 20 °C as an example

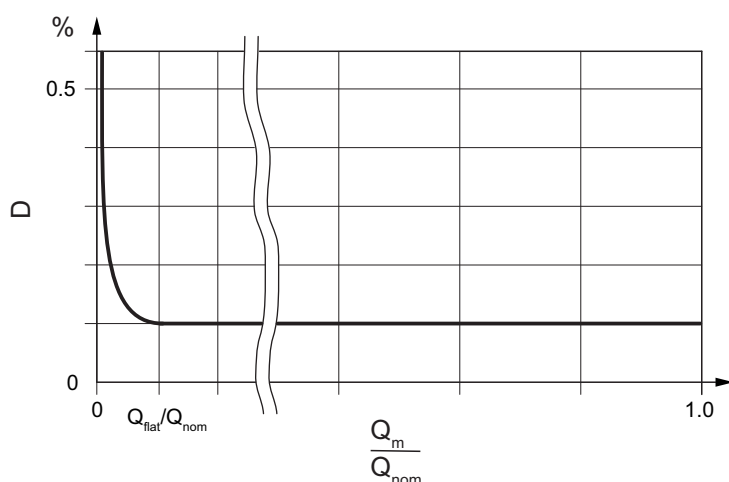


Fig. 4: Schematic dependency of the maximum deviation on the mass flow

D Maximum deviation in %
 Q_{nom} Nominal mass flow in kg/h

Q_m Mass flow in kg/h
 Q_{flat} Mass flow above which D_{flat} applies, in kg/h

3.4 Accuracy of density

3.4.1 For liquids

Meter size	Transmitter	Maximum deviation of density ¹⁾ in g/l (lb/ft ³)
Nano 06	Essential	Down to 4 (0.25)
Nano 08		
Nano 10		
Nano 15		
Nano 20		
Nano 06	Ultimate	Down to 0.5 (0.03)
Nano 08		
Nano 10		
Nano 15		
Nano 20		

¹⁾ Deviations possible depending on product version (meter size, type of calibration)

The maximum deviation depends on the product version selected, see also *Accuracy of mass flow and density according to the model code* [► 14].

3.4.2 For gases

In most applications, density at standard conditions is programmed into the transmitter and used to calculate the standard volume flow based on mass flow.

If gas pressure is a known value, after entering a reference density, the transmitter is able to calculate gas density from temperature and pressure as well (while assuming an ideal gas).


Alternatively, gas density can be measured. In order to do so, it is necessary to adapt the lower density limit value in the transmitter.

For most applications the direct measurement of the gas density will have less accuracy as stated for liquids.

3.5 Accuracy of mass flow and density according to the model code

Accuracy for flow rate as well as density is selected via model code position 9. Here a distinction is made between devices for measuring liquids and devices for measuring gases. No accuracy for density measurement is specified for gas measurement devices.

3.5.1 For liquids



Essential

Model code position 9	Maximum deviation of density ¹⁾ in g/l	Maximum deviation D_{flat} for mass flow in %				
		Nano 06	Nano 08	Nano 10	Nano 15	Nano 20
E9	20	0.2	—	—	—	—
E8	8	—	0.2	—	—	—
E7	4	—	—	0.2	0.2	0.2

¹⁾ Specified maximum deviation is achieved within the applicable measuring range for density.

Ultimate

Model code position 9	Maximum deviation of density ¹⁾ in g/l	Maximum deviation D_{flat} for mass flow in %				
		Nano 06	Nano 08	Nano 10	Nano 15	Nano 20
E9	20	0.2	—	—	—	—
E8	8	—	0.2	—	—	—
E7	4	—	—	0.2	0.2	0.2
D9 ²⁾	20	0.15	—	—	—	—
D8	8	—	0.15	—	—	—
D7	4	—	—	0.15	0.15	0.15
D3 ^{2),3)}	1	—	—	0.15	0.15	0.15
D2 ^{2),3)}	0.5	—	—	—	0.15	0.15
C8 ²⁾	8	—	0.1	—	—	—
C7 ²⁾	4	—	—	0.1	0.1	0.1
C3 ²⁾	1	—	—	0.1	0.1	0.1
C2 ^{2),3)}	0.5	—	—	—	0.1	0.1


¹⁾ Specified maximum deviation is achieved within the applicable measuring range for density.

²⁾ Notice: In case of a spare sensor combined with a transmitter in use, the original accuracy specification may be affected. For calibration services, please contact Yokogawa Service department.

³⁾ Specified deviation of density is achieved within the following limits, see table below:

	Limits for density specific D_{flat} for mass flow
	Nano 20
Q_{min} of C2 in kg/h	95
Ambient temperature range in °C (°F)	-10 – 50 (14 – 122)

3.5.2 For gases



Essential

Model code position 9	Maximum deviation D_{flat} for mass flow in %
70	0.75

Ultimate

Model code position 9	Maximum deviation D_{flat} for mass flow in %
50 ¹⁾	0.5

¹⁾ Notice: In case of a spare sensor combined with a transmitter in use, the original accuracy specification may be affected. For calibration services, please contact Yokogawa Service department.

3.6 Volume flow accuracy

3.6.1 For liquids

The following formula can be used to calculate the accuracy of liquid volume flow:

$$D_v = \sqrt{D^2 + \left(\frac{\Delta\rho}{\rho} \times 100\%\right)^2}$$

D_v Maximum deviation of volume flow in %

$\Delta\rho$ Maximum deviation of density in kg/l

D Maximum deviation of mass flow in %

ρ Density in kg/l

3.6.2 For gases

Accuracy of standard volume flow for gas with a fixed reference density equals the maximum deviation D of the mass flow.

$$D_v = D$$

D_v Maximum deviation of volume flow in %

D Maximum deviation of mass flow in %



The specified accuracy is then only valid for reference gas density. Gas composition changes can have different reference density leading to accuracy deviation.

3.7 Accuracy of temperature

Accuracy of temperature depends on the sensor temperature range selected (see *Process fluid temperature range* [9]) and can be calculated as follows:

Formula for specified temperature range *Standard and Medium*

$$\Delta T = 0.5\text{ }^{\circ}\text{C} + 0.005 \times |T_{\text{pro}} - 20\text{ }^{\circ}\text{C}|$$

ΔT Maximum deviation of temperature

T_{pro} Process fluid temperature in $^{\circ}\text{C}$ measured by Rotamass Total Insight

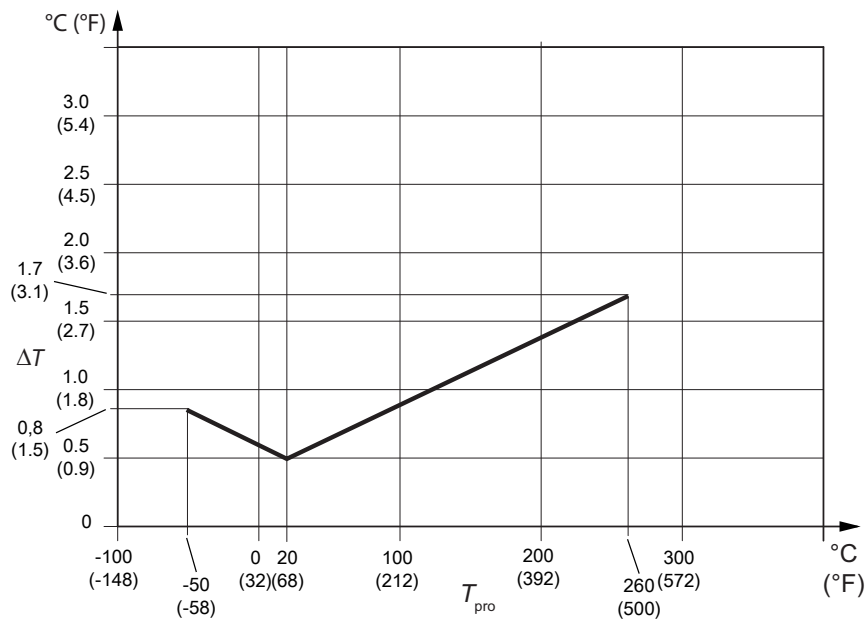


Fig. 5: Temperature accuracy

3.8 Repeatability

For liquids

When using default damping times, the specified repeatability of mass flow, density and temperature measurements equals half of the respective maximum deviation.

$$R = \frac{D}{2}$$

R Repeatability

D Maximum deviation

For gases

In deviation hereto, the following applies to mass and standard volume flow of gases:

$$R = \frac{D}{1.25}$$

3.9 Calibration conditions

3.9.1 Mass flow calibration and density adjustment

The calibration laboratory at Rota Yokogawa is accredited according to DIN EN ISO/IEC 17025:2018. All Rotamass are calibrated in accordance with standard calibration procedure and each device comes with a standard calibration certificate. Optionally, a 5 point-calibration (option K2) or a 10 point-calibration with DAkkS calibration certificate (option K5) can be performed.

Each Rotamass device comes with a standard calibration certificate.

Calibration takes place at reference conditions. Specific values are listed in the standard calibration certificate.

	Reference conditions
Fluid	Water
Density	0.9 – 1.1 kg/l (56 – 69 lb/ft ³)
Fluid temperature	10 – 35 °C (50 – 95 °F) Average temperature: 22.5 °C (72.5 °F)
Ambient temperature	10 – 35 °C (50 – 95 °F)
Process pressure (absolute)	1 – 5 bar (15 – 73 psi)

The accuracy specified is achieved at as-delivered calibration conditions stated.

3.9.2 Density calibration

Density calibration is performed for maximum deviation of 0.5 g/l (0.03 lb/ft³), (model code pos. 9: C2 or D2).

Density calibration includes:

- Determination of calibration constants for fluid densities at 0.7 kg/l (44 lb/ft³), 1 kg/l (62 lb/ft³) and 1.65 kg/l (103 lb/ft³) at 20 °C (68 °F) fluid temperature
- Check of results for fluid densities at 0.7 kg/l (44 lb/ft³), 1 kg/l (62 lb/ft³) and 1.65 kg/l (103 lb/ft³) at 20 °C (68 °F) fluid temperature
- Special design (probe type) of the temperature sensor
- Creation of density calibration certificate

3.9.3 Calibration for gases

Same calibration conditions described in *Mass flow calibration and density adjustment* [▶ 17] apply for gas measurement according to AGA11 water calibration transferability¹⁾. Specifications are determined based on evaluation at accredited ISO/IEC17025 calibration at following conditions:

Terms	Reference conditions
Fluid	Natural Gas
Fluid temperature	20 °C (68 °F)
Process pressure	approx. 17 barg (246 psig) and approx. 50 barg (725 psig)

Different gases can be considered by entering characteristic gas sound velocity and related temperature coefficient¹⁾.

¹⁾ Depends on firmware revision. Please check GS Specification Overview GS 01U10B00-00_--R for details.

3.10 Process conditions



For process specific results, please refer to the FlowConfigurator online sizing and configuration tool: <http://www.FlowConfigurator.com>

3.10.1 Process pressure effect

Process pressure effect is defined as the change in sensor flow and density deviation due to process pressure change away from 1 barg reference condition. This effect can be corrected by dynamic pressure input or a fixed process pressure.

Tab. 3: Process pressure effect

Meter size	Deviation of Flow		Deviation of Density	
	in % of rate per bar	in % of rate per psi	in g/l per bar	in g/l per psi
Nano 06	none	none	-0.016	-0.0011
Nano 08	none	none	-0.016	-0.0011
Nano 10	none	none	-0.017	-0.0011
Nano 15	-0.0011	-0.00008	-0.033	-0.0023
Nano 20	-0.0010	-0.00007	-0.260	-0.0179

3.10.2 Process fluid temperature effect

For mass flow and density measurement, process fluid temperature effect is defined as the change in sensor flow and density accuracy due to process fluid temperature change away from 20 °C reference condition. For temperature ranges, see *Process fluid temperature range* [► 9].

Temperature effect on Zero

Temperature effect on Zero of mass flow can be corrected by zeroing at the process fluid temperature.

Temperature effect on mass flow


The process fluid temperature is measured and the temperature effect compensated. However due to uncertainties in the compensation coefficients and in the temperature measurement an uncertainty of this compensation is left. The typical rest error of Rotamass Total Insight temperature effect on mass flow is:

Tab. 4: All models

Temperature range	Uncertainty of flow
Standard, Medium	± 0.001 % of rate / °C (± 0.00056 % of rate / °F)

The temperature used for calculation of the uncertainty is the difference between process fluid temperature and the temperature 20 °C reference condition.

Temperature effect on density measurement (liquids)



Process fluid temperature influence:

Formula for metric values

$$D'_{\rho} = \pm k \times \text{abs}(T_{\text{pro}} - 20 \text{ }^{\circ}\text{C})$$

Formula for imperial values

$$D'_{\rho} = \pm k \times \text{abs}(T_{\text{pro}} - 68 \text{ }^{\circ}\text{F})$$

D'_{ρ} Additional density deviation due to the effect of fluid temperature in g/l (lb/ft³)

T_{pro} Process fluid temperature in °C measured by Rotamass Total Insight

k Constant for temperature effect on density measurement in g/l × 1/°C (lb/ft³ × 1/°F)

Tab. 5: Constants for particular meter size and model code position (see also *Process fluid temperature range* [► 9] and *For liquids* [► 14])

Meter size	Model code position 4	Model code position 8	Model code position 9	<i>k</i> in g/l × 1/°C (lb/ft³ × 1/°F)
Nano 06	K	0, 2	D9, E9	0.71 (0.0246)
Nano 08			C8, D8, E8	0.67 (0.0232)
Nano 10			C3, C7, D3, D7, E7	0.56 (0.0194)
Nano 15				0.38 (0.0132)
Nano 20			C2, D2	0.046 (0.0016)
			C3, C7, D3, D7, E7	0.08 (0.0028)
	C2, D2	0.041 (0.0014)		

3.11 Analog output specification

Analog output specification *I_{out}*

If mass- or volume flow, density, temperature, pressure or concentration is measured via current output *I_{out}* two additional deviation effects have to be taken into account.

- The *I_{out}* –base specification ΔI_{base} contains all combined effects of output adjustment, linearity, power supply variation, load resistance variation, short and long term drift for one year.
- The *I_{out}* –ambient temperature specification $\Delta I(T_{\text{amb}})$ gives an additional deviation effect if the ambient temperature of the transmitter differs from 20 °C.

Both additional output deviation effects have to be added to the basic mass- or volume flow, density, temperature, pressure or concentration deviation. They are based on a 95 % (2σ) confidence level.

Deviation of mass- or volume flow, density, temperature, pressure or concentration by *I_{out}*

The following formula can be used to calculate the deviation of mass- or volume flow:

$$D_I = \sqrt{D^2 + \left(\frac{\Delta I_{\text{base}}}{I(Q)} \times 100 \% \right)^2 + \left(\frac{\Delta I(T_{\text{amb}})}{I(Q)} \times 100 \% \right)^2}$$

D_I	Maximum deviation of mass- or volume flow, density, temperature, pressure or concentration by <i>I_{out}</i> in %
D	Maximum deviation of mass- or volume flow, density, temperature, pressure or concentration ¹⁾ by pulse/frequency output in %
$I(Q)$	<i>I_{out}</i> depending on mass- or volume flow, density, temperature, pressure or concentration in μA
ΔI_{base}	Maximum deviation of <i>I_{out}</i> by combined effects $\Delta I_{\text{base}} = a \times I(Q) + b$
$\Delta I(T_{\text{amb}})$	Maximum deviation of <i>I_{out}</i> by deviation of the transmitter ambient temperature from 20 °C $\Delta I(T_{\text{amb}}) = (c \times I(Q) + d) \times (T - 20 \text{ °C})$
a, b, c, d	Constants

Description	Model code pos. 13	a in ppm	b in μA	c in ppm/°C	d in $\mu\text{A}/^\circ\text{C}$
Non-intrinsically safe <i>I_{out}</i> (active or passive)	JA, JB, JC, JD, JE, JF, JG, JH, JJ, JK, JL, JM, JN, M6	170	2.3	7	0
Intrinsically safe <i>I_{out}</i> (passive)	JP, JQ, JR, JS				0.06

¹⁾ Formula or value for accuracy of specific output parameter, please see chapters:

- 3.4 Accuracy of density [► 13]
- 3.6 Volume flow accuracy [► 15]
- 3.7 Accuracy of temperature [► 16]

4 Operating conditions

4.1 Location and position of installation

Rotamass Coriolis flow meters can be mounted horizontally, vertically and at an incline. The measuring tubes should be completely filled with the fluid during flow measurement as accumulations of air or formation of gas bubbles in the measuring tube may result in errors in measurement. Straight pipe runs at inlet or outlet are usually not required.

Avoid the following installation locations and positions:

- Measuring tubes as highest point in piping when measuring liquids
- Measuring tubes as lowest point in piping when measuring gases
- Immediately in front of a free pipe outlet in a downpipe
- Lateral positions

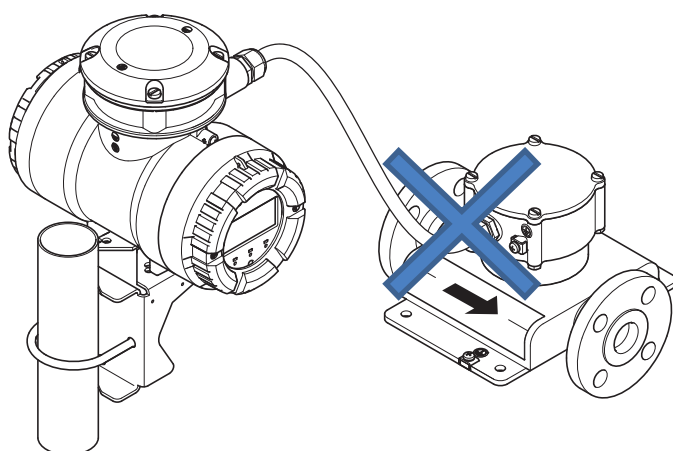
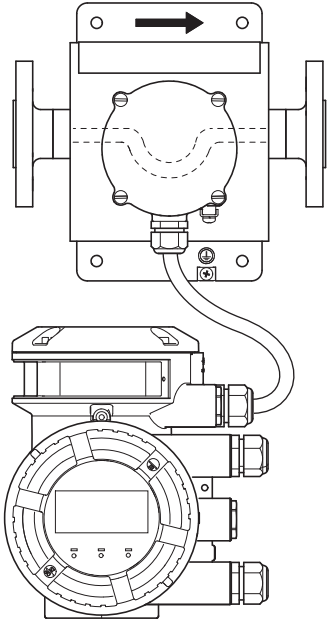
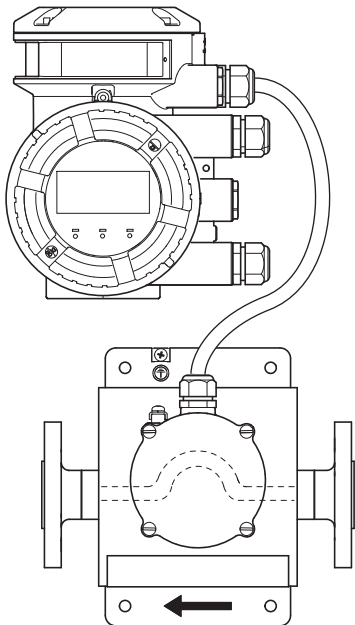
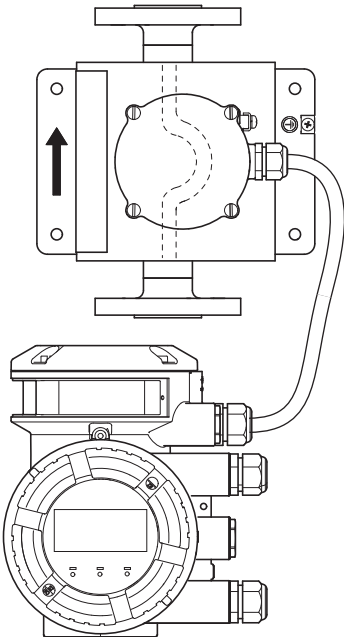


Fig. 6: Installation position to be avoided: Flow meter in sideways position

4.1.1 Sensor installation position

Sensor installation position as a function of the fluid

Installation position	Fluid	Description
Horizontal, measuring tubes at bottom 	Liquid	The measuring tubes are oriented toward the bottom. Accumulation of gas bubbles is avoided.
Horizontal, measuring tubes at top 	Gas	The measuring tubes are oriented toward the top. Accumulation of liquid, such as condensate is avoided.

Installation position	Fluid	Description
Vertical, direction of flow towards the top (recommended) 	Liquid/gas	The sensor is installed on a pipe with the direction of flow towards the top. Accumulation of gas bubbles or solids is avoided. This position allows for complete self-draining of the measuring tubes.

4.2 Process conditions



The pressure and temperature ratings presented in this section represent the design values for the devices. For individual applications (e.g. marine applications with option MC_) further limitations may apply according to the respective applicable regulations. For details see chapter *Application and industry related standards* [► 76] under the heading Marine approvals.



In this chapter, all values related to pressure are gauge pressure values.

4.2.1 Pressure

The maximum allowed process pressure depends on the selected process connection and process temperature.

The given process temperature and process pressure ranges are calculated and approved without corrosion or erosion effects.

The following diagrams shows the process pressure as a function of process temperature as well as the process connection used (type and size of process connection).

Calculations for ASME flanges are based on ASME B16.5 Material group 2.2 (316/316L dual certified).

ASME class 150, JPI class 150

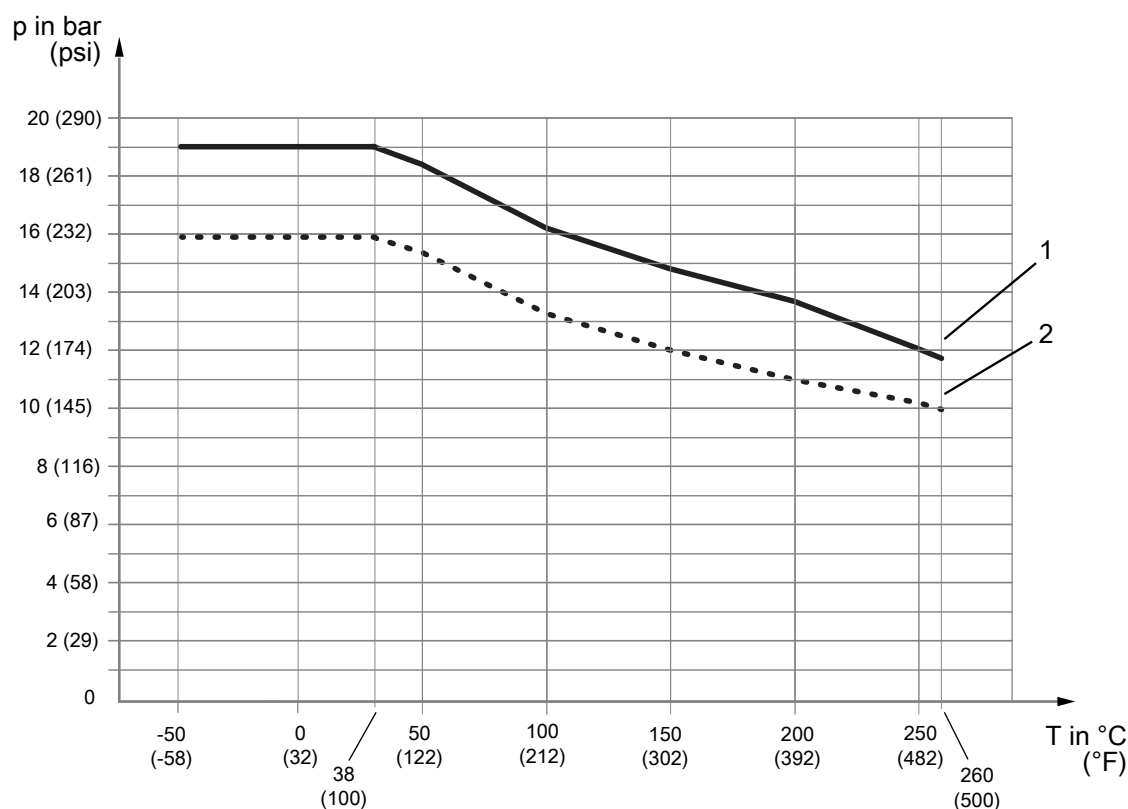


Fig. 7: Allowed process pressure as a function of process connection temperature

- 1 Process connection compatible to ASME B16.5 class 150
- 2 Process connection compatible to JPI class 150 and heat tracing connection suitable for ASME B16.5 class 150

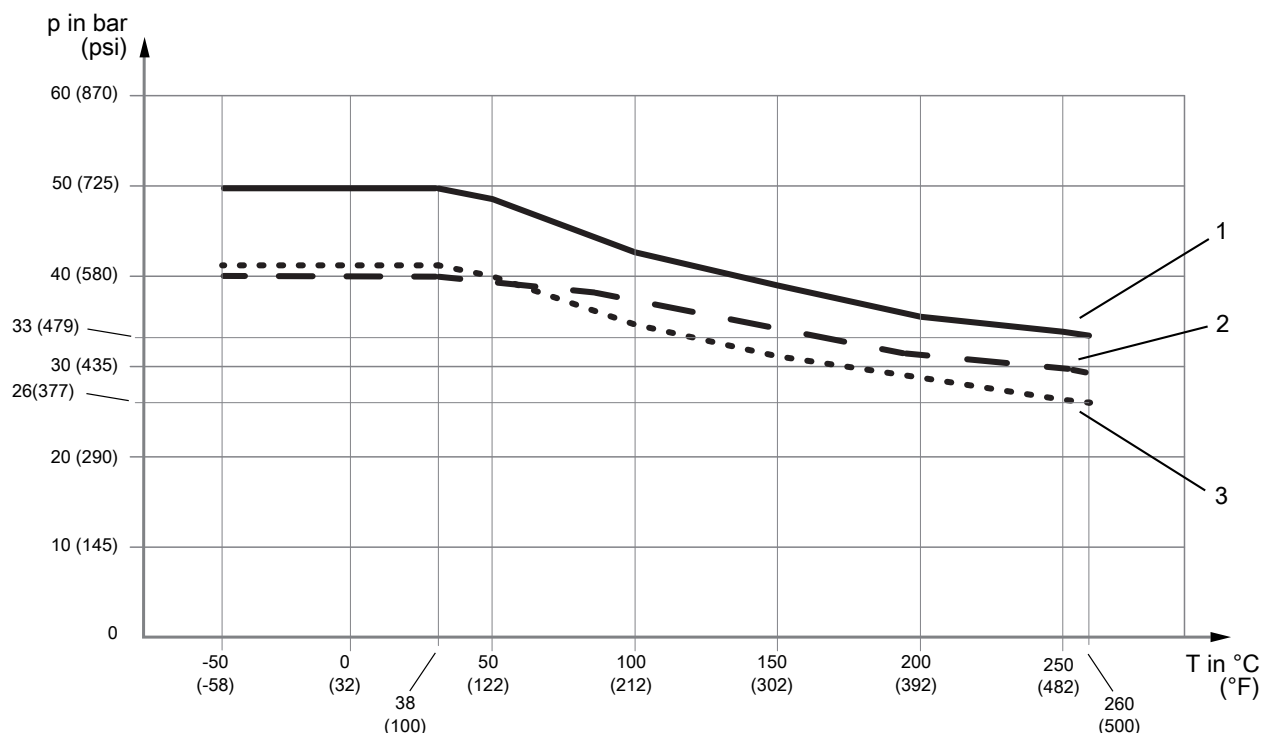
ASME class 300, EN PN40, JPI class 300

Fig. 8: Allowed process pressure as a function of process fluid temperature

- 1 Process connection compatible to ASME B16.5 class 300
- 2 Process and heat tracing connection compatible to EN 1092-1 PN40
- 3 Process connection compatible to JPI class 300 and process and heat tracing connection for ASME B16.5 class 300

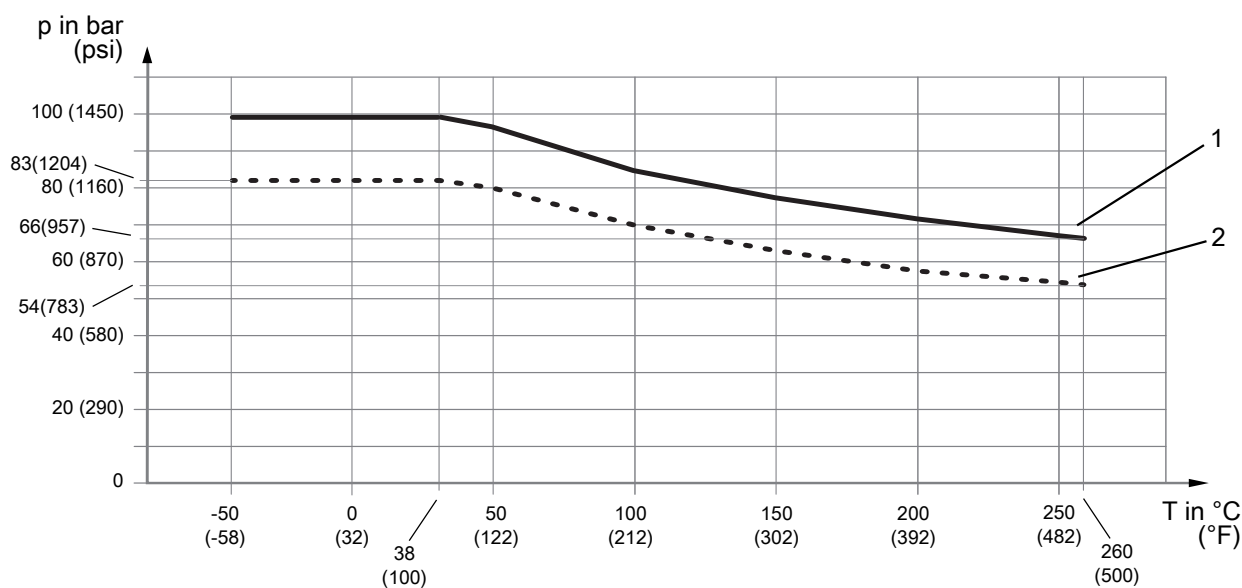
ASME class 600, JPI class 600

Fig. 9: Allowed process pressure as a function of process connection temperature

- 1 Process connection compatible to ASME B16.5 class 600
- 2 Process connection compatible to JPI class 600

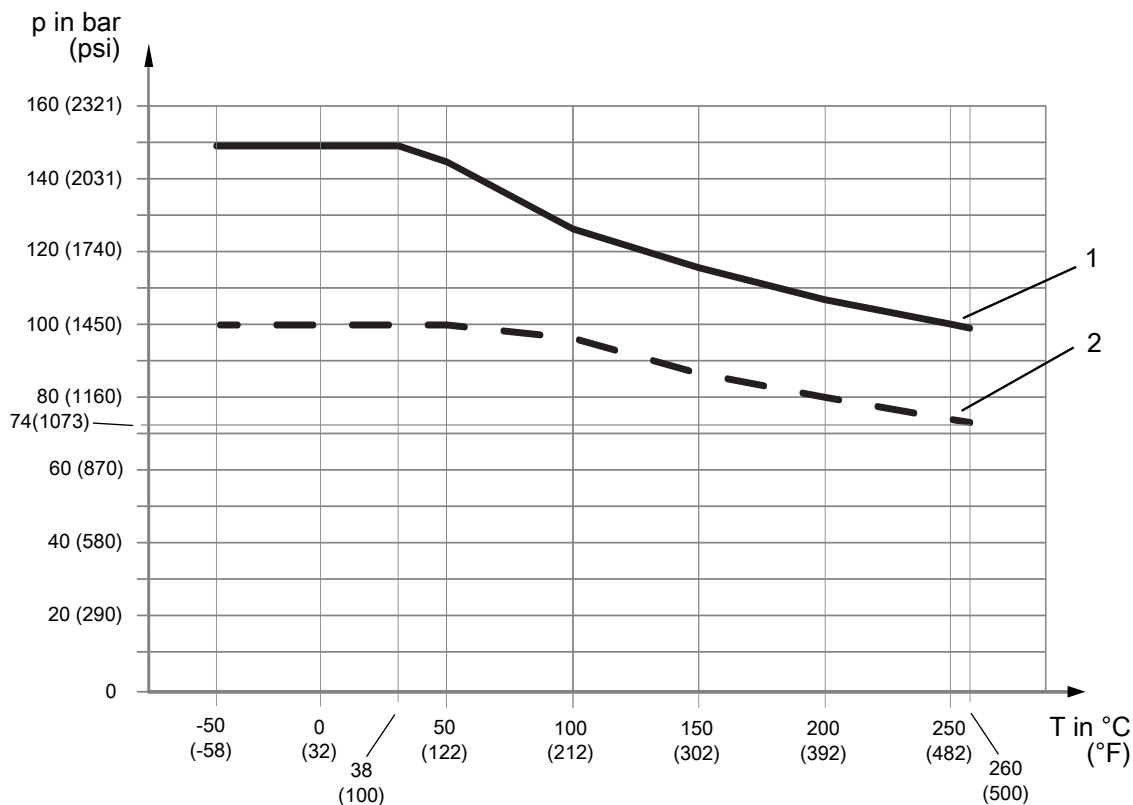
ASME class 900, EN PN100

Fig. 10: Allowed process pressure as a function of process connection temperature

- 1 Process connection compatible to ASME B16.5 class 900
- 2 Process connection compatible to EN 1092-1 PN100

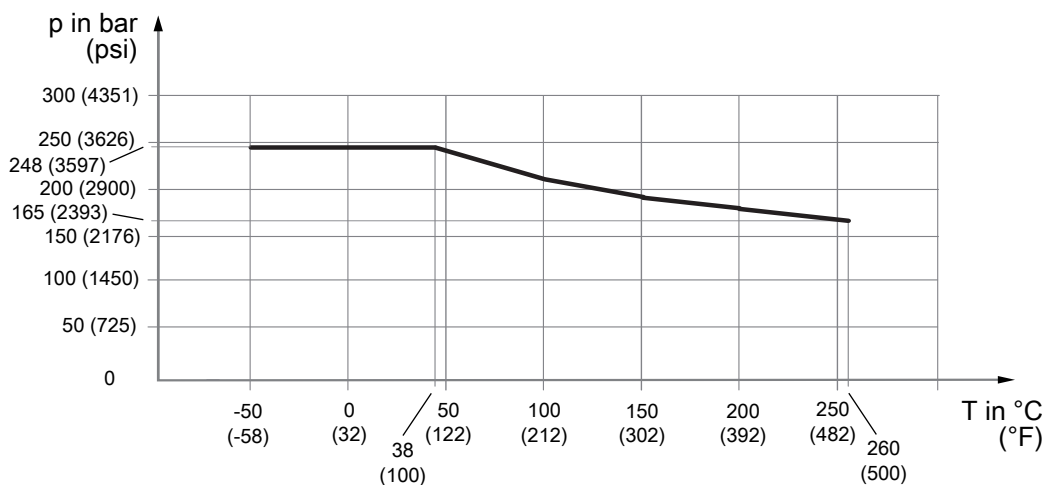
ASME class 1500 compatible to flange ASME B16.5

Fig. 11: Allowed process pressure as a function of process connection temperature

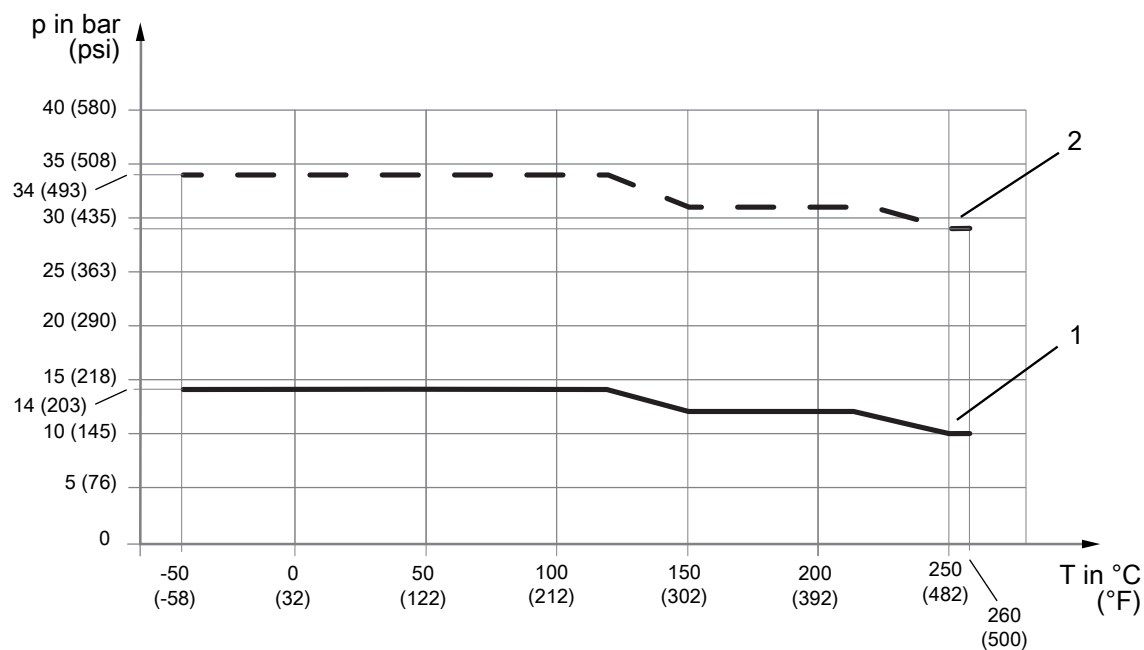
JIS 10K, JIS 20K

Fig. 12: Allowed process pressure as a function of process connection temperature

- 1 Process connection compatible to JIS B 2220 10K
- 2 Process connection compatible to JIS B 2220 20K

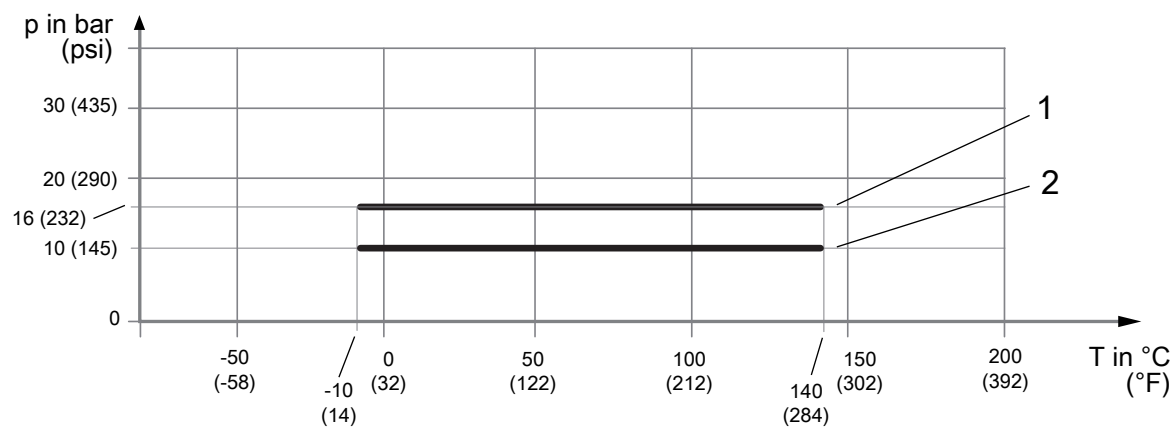
Clamp process connection according to DIN 32676 series A

Fig. 13: Allowed process pressure as a function of process fluid temperature

- 1 Clamp connection compatible to DIN 32676 series A up to DN50
- 2 Clamp connection compatible to DIN 32676 series A above DN50

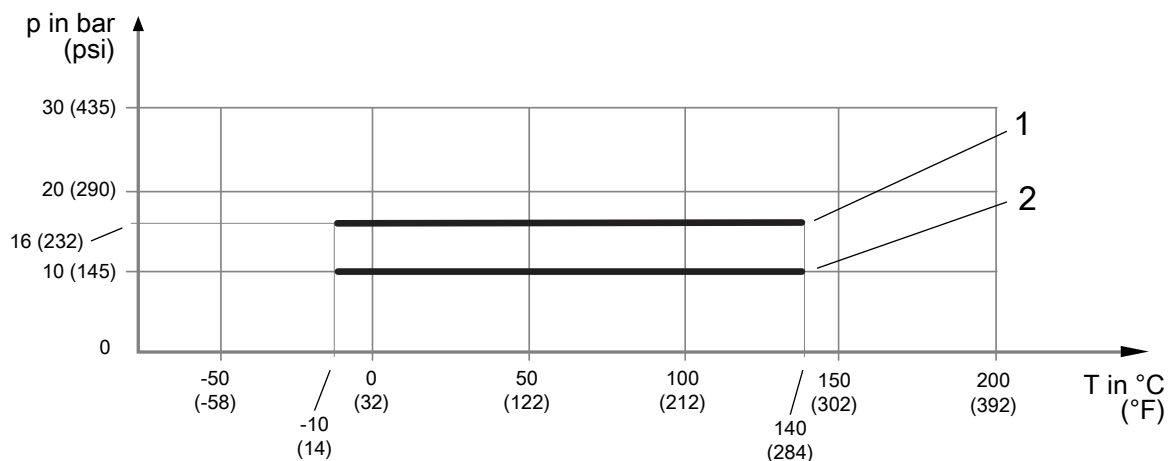
Clamp process connection according to DIN 32676 series C (Tri-Clamp)

Fig. 14: Allowed process pressure as a function of process fluid temperature

- 1 Clamp connection compatible to DIN 32676 series C up to DN40
- 2 Clamp connection compatible to DIN 32676 series C from DN50 to DN100

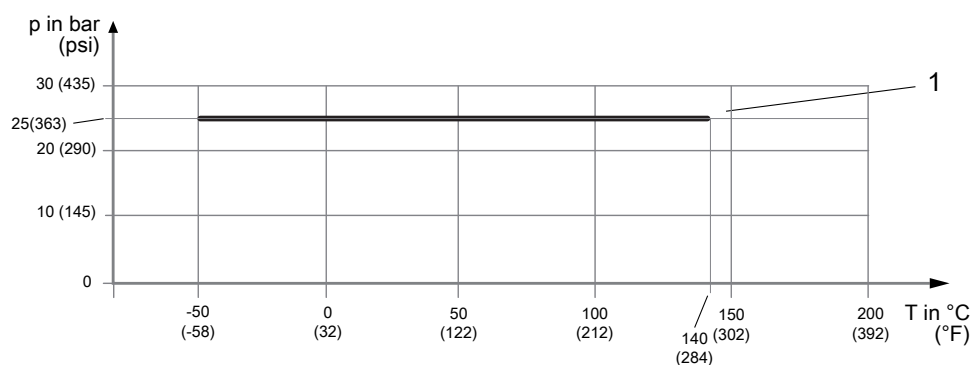
Clamp process connection according to DIN 11864-2-BF Form A

Fig. 15: Allowed process pressure as a function of process fluid temperature

- 1 Clamp connection compatible to DIN 11864-2-BF Form A up to DN15

Process connection with internal thread G and NPT

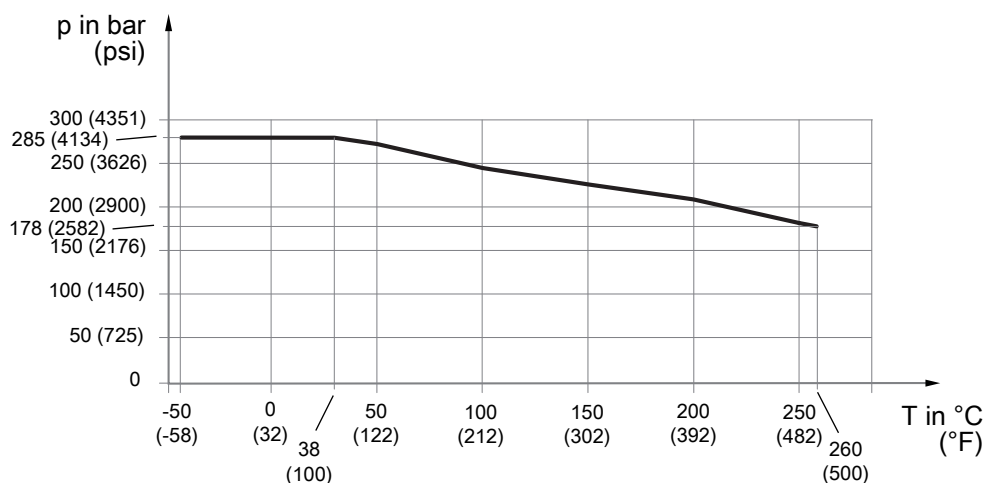


Fig. 16: Allowed process pressure as a function of process fluid temperature

4.2.2 Secondary containment

Some applications or environment conditions require secondary containment retaining the process pressure for increased safety. All Rotamass Total Insight have a secondary containment filled with inert gas. The typical burst pressure values of the secondary housing are defined in the table below.

Typical burst pressure at room temperature

Burst pressure in bar (psi)				
Nano 06	Nano 08	Nano 10	Nano 15	Nano 20
65 (942)				

4.2.3 Insulation and heat tracing



In case it is necessary fluid temperature deviates more than 80 °C (176 °F) from ambient temperature, sensor insulation is recommended to avoid negative effects from temperature fluctuations.

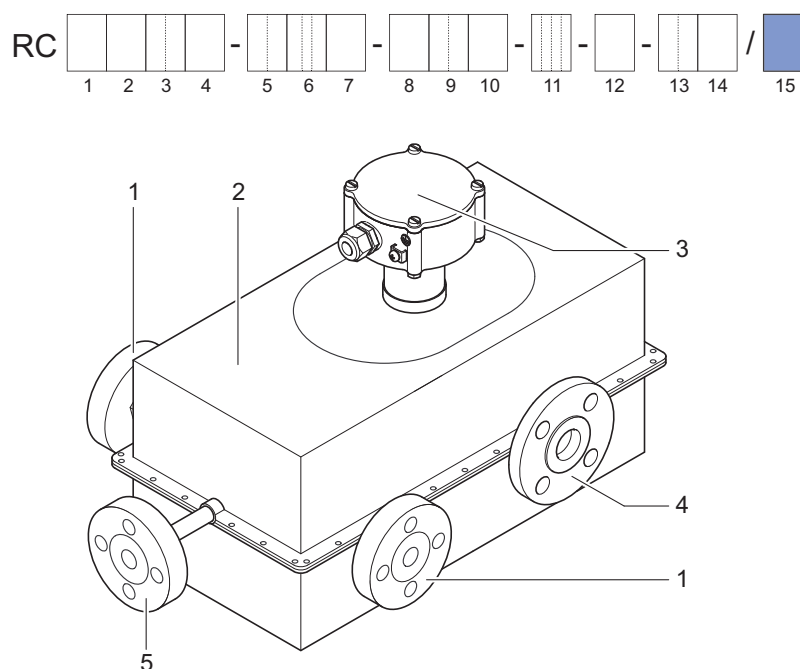


Fig. 17: Configuration of Rotamass with insulation and heat tracing

- | | | | |
|---|----------------------------|---|--------------------|
| 1 | Heating tracing connection | 4 | Process connection |
| 2 | Insulation | 5 | Purging |
| 3 | Sensor terminal box | | |

Overview of device options for insulation and heat tracing for remote type

Options	Description
T10	Insulation
T21, T22, T26	- Insulation - Heat tracing without purging
T31, T32, T36	- Insulation - Heat tracing with purging

For details about the ordering information see model code position 15 in the table of chapter *Model code description* [82] under the same heading Insulation and heat tracing.

In case of subsequent sensor insulation installed by the customer, the following must be noted:

- Do not insulate sensor terminal box.
- Do not expose transmitters to ambient temperatures exceeding 60 °C (140 °F).
- The preferred insulation is 60 mm (2.36 inch) thick with a heat transfer coefficient of 0.4 W/m² K (0.07 Btu/ ft² °F).

Maximum temperature of heat carrier

Temperature range	Model code position 8	Maximum temperature range of heat carrier in °C (°F)
Standard	0	0 – 150 (32 – 302)
Medium	2	0 – 200 (32 – 392)

Pressure ratings of heat tracing are defined based on heat tracing connection, refer to *Pressure* [▶ 24].

Subsequent installation of an electrical heat tracing to the sensor is possible. Electromagnetic insulation is required in case the heating device is controlled by phase-fired control or pulse train.



In hazardous areas, subsequent application of insulation, heating jacket or heating strips is not permitted.

4.3 Ambient conditions

Allowed ambient and storage temperature of Rotamass Total Insight depends on the below components and their own temperature limits:

- Sensor
- Transmitter
- Connecting cable between sensor and transmitter

Ambient temperature

Device surrounding air temperature is considered as ambient temperature. If the device is operating outdoors make sure that the solar irradiation does not increase the surface temperature of the device higher than the allowed maximum ambient temperature. Transmitter display has limited legibility below -20 °C (-4 °F).

Maximum ambient temperature range		
with standard cable (option L___):	Sensor ¹⁾ :	-50 – 80 °C (-58 – 176 °F)
	Transmitter:	-40 – 60 °C (-40 – 140 °F)
with fire retardant cable ²⁾ (option Y___):	Sensor ¹⁾ :	-35 – 80 °C (-31 – 176 °F)
	Transmitter:	-35 – 60 °C (-31 – 140 °F)

Ambient temperature range for NTEP custody transfer approval

Maximum ambient temperature range (/Q20)		
integral type:		-40 – 50 °C (-40 – 122 °F)
remote type		
with standard cable (option L___):	Sensor ¹⁾ :	-50 – 80 °C (-58 – 176 °F)
	Transmitter:	-40 – 50 °C (-40 – 122 °F)
with fire retardant cable ²⁾ (option Y___):	Sensor ^{1), 2)} :	-35 – 80 °C (-31 – 176 °F)
	Transmitter:	-35 – 50 °C (-31 – 122 °F)

¹⁾ Check derating for high fluid temperature, see *Process fluid temperature range* [▶ 9], *Process conditions* [▶ 24] and *Allowed ambient temperature for sensor* [▶ 33]

²⁾ Lower temperature specification valid for fixed installation only

Storage temperature

Maximum storage temperature range		
with standard cable (option L___):	Sensor:	-50 – 80 °C (-58 – 176 °F)
	Transmitter:	-40 – 60 °C (-40 – 140 °F)
with fire retardant cable (option Y___):	Sensor:	-35 – 80 °C (-31 – 176 °F)
	Transmitter:	-35 – 60 °C (-31 – 140 °F)


Further ambient conditions

Ranges and specifications	
Relative humidity	0 – 95 %
IP code	IP66/67 for transmitters and sensors when using the appropriate cable glands
Allowable pollution degree in surrounding area acc. EN 61010-1	4 (in operation)
Vibration resistance acc. IEC 60068-2-6	Transmitter: 10 – 500 Hz, 1g
Electromagnetic compatibility (EMC) ▪ IEC/EN 61326-1, Table 2 ▪ IEC/EN 61326-2-3 ▪ IEC/EN 61326-2-5 ▪ NAMUR NE 21 recommendation ▪ DNV-CG-0339 Section 3, Chapter 14 This includes ▪ Surge immunity acc.: – EN 61000-4-5 for lightning protection ▪ Emission acc.: – IEC/EN 61000-3-2, Class A – IEC/EN 61000-3-3, Class A – NAMUR NE 21 recommendation – DNV-CG-0339 Section 3, Chapter 14	Immunity assessment criterion: The output signal fluctuation is within ± 1 % of the output span.
Maximum altitude	2000 m (6600 ft) above mean sea level (MSL)
Overvoltage category according to IEC/EN 61010-1	II

4.3.1 Allowed ambient temperature for sensor

The allowed ambient temperature of the sensor depends on the following product properties:

- Process fluid temperature, see *Process fluid temperature range* [► 9]
- Connecting cable type (options L____ and Y____)



The allowed combinations of process fluid and ambient temperature for the sensor are illustrated as gray areas in the diagrams below.



Allowed process fluid and ambient temperature ranges in hazardous areas depend on classifications defined by applications, refer to *Temperature specification in hazardous areas* [► 35].

Temperature range specification Standard, remote type

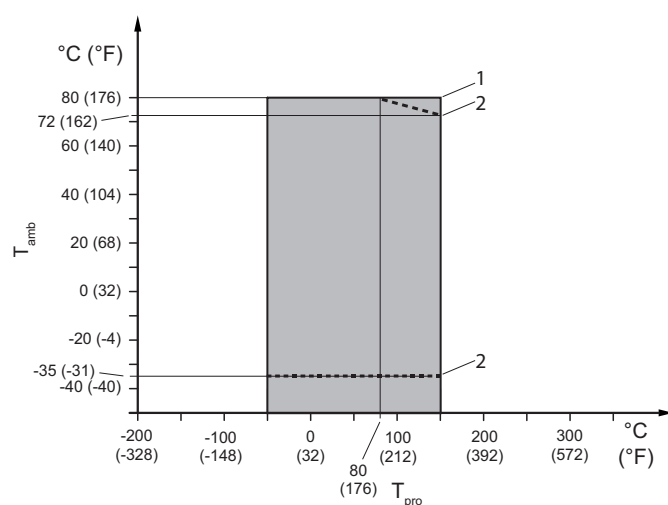


Fig. 18: Allowed process fluid and ambient temperatures, remote type (except process connection type HS4 and HS8)

T_{amb}	Ambient temperature
T_{pro}	Process fluid temperature
1	Standard cable option L____
2	Limitation for fire retardant cable option Y____

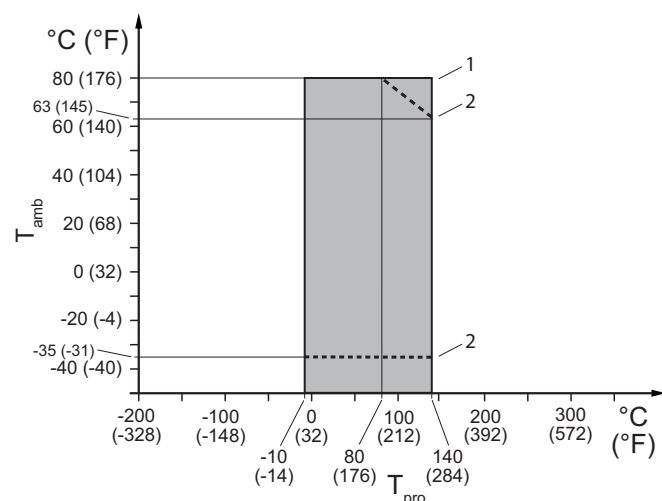


Fig. 19: Allowed process fluid and ambient temperatures, remote type for process connection type HS4 and HS8

- 1 Standard cable option L_ _ _
- 2 Limitation for fire retardant cable option Y_ _ _

Temperature range specification Medium, remote type

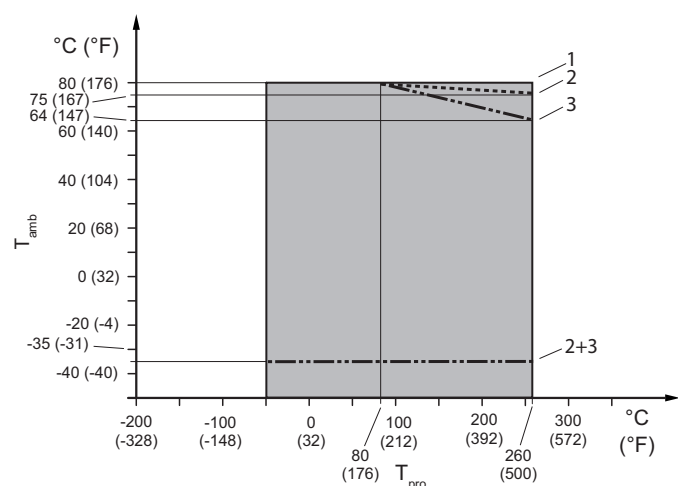


Fig. 20: Allowed process fluid and ambient temperatures

- 1 Standard cable option L_ _ _
- 2 Limitation for fire retardant cable option Y_ _ _ without option T_ _
- 3 Limitation for fire retardant cable option Y_ _ _ with option T_ _

4.3.2 Temperature specification in hazardous areas

Please select appropriate equipment in accordance with the laws and regulations of the relevant country/region, when it is used in a location where explosive atmospheres may be present.

The maximum ambient and process fluid temperatures of Integral type and Remote Sensor depending on explosion groups and temperature classes can be determined via the model code or via the model code together with the Ex code (see the corresponding Explosion Proof Type Manual).



Note: The maximum process fluid temperature could be further restricted due to process connection type see *Allowed ambient temperature for sensor* [▶ 33].

Model code:

Pos. 2: N


Pos. 8: 0

Pos. 10: A, B, E, F, J, K

Pos. 11: _F21, _F22

Ex code: -

The following figure shows the relevant positions of the model code:




Tab. 6: Temperature classification

Temperature class	Maximum ambient temperature in °C (°F)		Maximum process fluid temperature in °C (°F)
	Option L_	Option Y_	
T6	65 (149)	65 (149)	65 (149)
T5	75 (167)	75 (167)	90 (194)
T4	80 (176)	74 (165)	130 (266)
T3	80 (176)	72 (161)	150 (302)
T2	80 (176)	72 (161)	150 (302)
T1	80 (176)	72 (161)	150 (302)

Model code:
Pos. 2: N
Pos. 8: 0
Pos. 10: A, E, J, B, F, K
Pos. 11: FF11, FF12
Ex code: –

The following figure shows the relevant positions of the model code:




Tab. 7: Temperature classification

Temperature class	Maximum ambient temperature in °C (°F)		Maximum process fluid temperature in °C (°F)
	Option L_	Option Y_	
T6	65 (149)	65 (149)	65 (149)
T5	75 (167)	70 (158)	90 (194)
T4	80 (176)	70 (158)	130 (266)
T3	80 (176)	70 (158)	150 (302)
T2	80 (176)	70 (158)	150 (302)
T1	80 (176)	70 (158)	150 (302)

Model code:
Pos. 2: N
Pos. 8: 0
Pos. 10: A, B, E, F
Pos. 11: JF54, JF53
Ex code: –

The following figure shows the relevant positions of the model code:




Tab. 8: Temperature classification

Temperature class	Maximum ambient temperature in °C		Maximum fluid temperature in °C
	Option L_	Option Y_	
T4	80	–	130
T3	80	–	150

Model code:**Pos. 2: N****Pos. 8: 2****Pos. 10: B, F, K****Pos. 11: _F21, _F22****Ex code: -**

The following figure shows the relevant positions of the model code:




Tab. 9: Temperature classification

Temperature class	Maximum ambient temperature in °C (°F)			Maximum process fluid temperature in °C (°F)
	Option L ₋₋₋	Option Y ₋₋₋ with- out option T ₋₋₋	Option Y ₋₋₋ with option T ₋₋₋	
T6	65 (149)	65 (149)	65 (149)	65 (149)
T5	75 (167)	75 (167)	75 (167)	90 (194)
T4	80 (176)	76 (168)	75 (167)	130 (266)
T3	80 (176)	75 (167)	71 (159)	180 (356)
T2	80 (176)	73 (163)	64 (147)	260 (500)
T1	80 (176)	73 (163)	64 (147)	260 (500)

Model code:**Pos. 2: N****Pos. 8: 2****Pos. 10: B, F, K****Pos. 11: FF11, FF12****Ex code: -**

The following figure shows the relevant positions of the model code:



Tab. 10: Temperature classification

Temperature class	Maximum ambient temperature in °C (°F)			Maximum process fluid temperature in °C (°F)
	Option L ₋₋₋	Option Y ₋₋₋ with- out option T ₋₋₋	Option Y ₋₋₋ with option T ₋₋₋	
T6	65 (149)	65 (149)	65 (149)	65 (149)
T5	75 (167)	70 (158)	70 (158)	90 (194)
T4	80 (176)	70 (158)	70 (158)	130 (266)
T3	80 (176)	70 (158)	70 (158)	180 (356)
T2	80 (176)	70 (158)	64 (147)	260 (500)
T1	80 (176)	70 (158)	64 (147)	260 (500)

Model code:

Pos. 2: N,


Pos. 8: 2

Pos. 10: B, F,

Pos. 11: JF52

Ex code: –

The following figure shows the relevant positions of the model code:



Tab. 11: Temperature classification

Temperature class	Maximum ambient temperature in °C		Maximum fluid temperature in °C
	Option L ₋₋₋	Option Y ₋₋₋	
T2	80	–	260

5 Mechanical specification

5.1 Design

The Rotamass Nano flow meter is available with two neck design versions:

- Standard neck
- Long neck


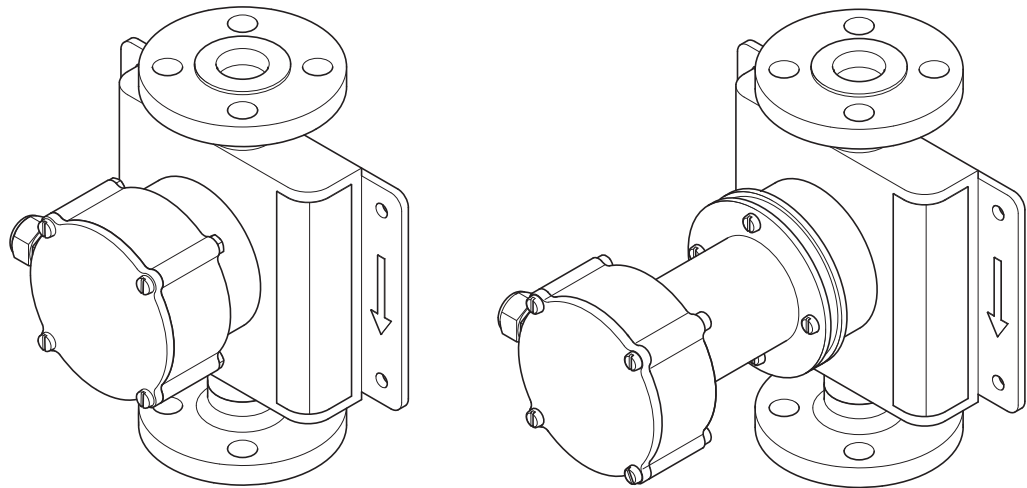


Fig. 21: Sensor with standard and long neck



Design version	Process fluid temperature range	Model code position 10
Standard neck	Standard	A, E, J
Long neck	Standard	B, F, K
	Medium	



If insulation (e.g. device option / T_{...}) is planned, it is mandatory to use the remote type with long neck.




The design influences the temperature specification for Ex-approved Rotamass, see Explosion Proof Type Manual (IM 01U10X_{...}-00_{...}-R).

5.2 Material

5.2.1 Sensor

Material wetted parts

Sensor parts which are wetted by process fluid are available with the following materials:



Material	Model code position 4
Measuring tubes made of nickel alloy C-22/2.4602, process connections of stainless steel alloy 1.4404/316L	K


The customer is responsible to ensure chemical compatibility of the material of the wetted parts with the measured process fluid.

If corrosion, erosion or abrasion is expected it is recommended to monitor tube constitution. Tube health check feature is optionally available. For details about Tube Health Check function refer to Specification Overview GS 01U10B00-00_--R.

Option	Model code position 15
Tube Health Check	/TC

Sensor housing material

Sensor housing is available in the following materials:




Housing part	Material	Model code position 7
Junction box	Stainless steel 1.4404/316L	0
		1
Neck	Stainless steel 1.4308	—
Body	Stainless steel 1.4301/304	0
	Stainless steel 1.4404/316L	1

5.2.2 Transmitter

Transmitter housing

The transmitter housing is available with different materials and coatings:




Housing material	Coating	Design type	Model code position 10
Aluminum Al-Si10Mg(Fe)	Standard coating	Remote type	A, B
	Corrosion protection coating		E, F
Stainless steel F8M	—		J, K

- Standard coating: Polyester resin powder coating
- Corrosion protection coating: Three-layer coating with high chemical resistance (polyurethane coating on two layers of epoxy coating)
- Color Mint green (Munsell 5.6BG3.3/2.9)

Display window

This is relevant for all transmitters having a display:



Display material	Model code position 14
Glass	1

Bracket material

The bracket is available for remote type devices only:

Bracket material	Design type	Model code position 10
Stainless steel 1.4404/316L	Remote type	A, B, E, F, J, K

5.2.3 Nameplates

Sensor


Sensor housing material	Process fluid temperature range	Sensor nameplate material
1.4301/304	Standard	Polyester film
	Medium	1.4404/316L
1.4404/316L	all	1.4404/316L

Transmitter

Transmitter housing material	Transmitter nameplate material
Aluminum AL-Si10MG(Fe)	Foil
Stainless steel CF8M	1.4404/316L

5.2.4 Heat tracing

These device options are available only for remote type with long neck.



Material of components

Component	Material
Insulation housing	Stainless steel 1.4301/304
Insulation material	Mineral wool, RAL-quality label, approved acc. EU directive 97/69 note Q, European class A1 non-combustible (EN 13 501), thermal conductivity 0,031 W/(m*K) at 0 °C (acc. P-MPA-E-99-521)
Heat tracing andpurging lines	Stainless steel 1.4571/316Ti and 1.4404/316L
Heat tracing andpurging connections	Stainless steel 1.4404/316L; flanges acc. ASME or EN

For dimensions of insulation and heat tracing components see *Process connections, dimensions and weights of sensor* [43].

5.3 Process connections, dimensions and weights of sensor

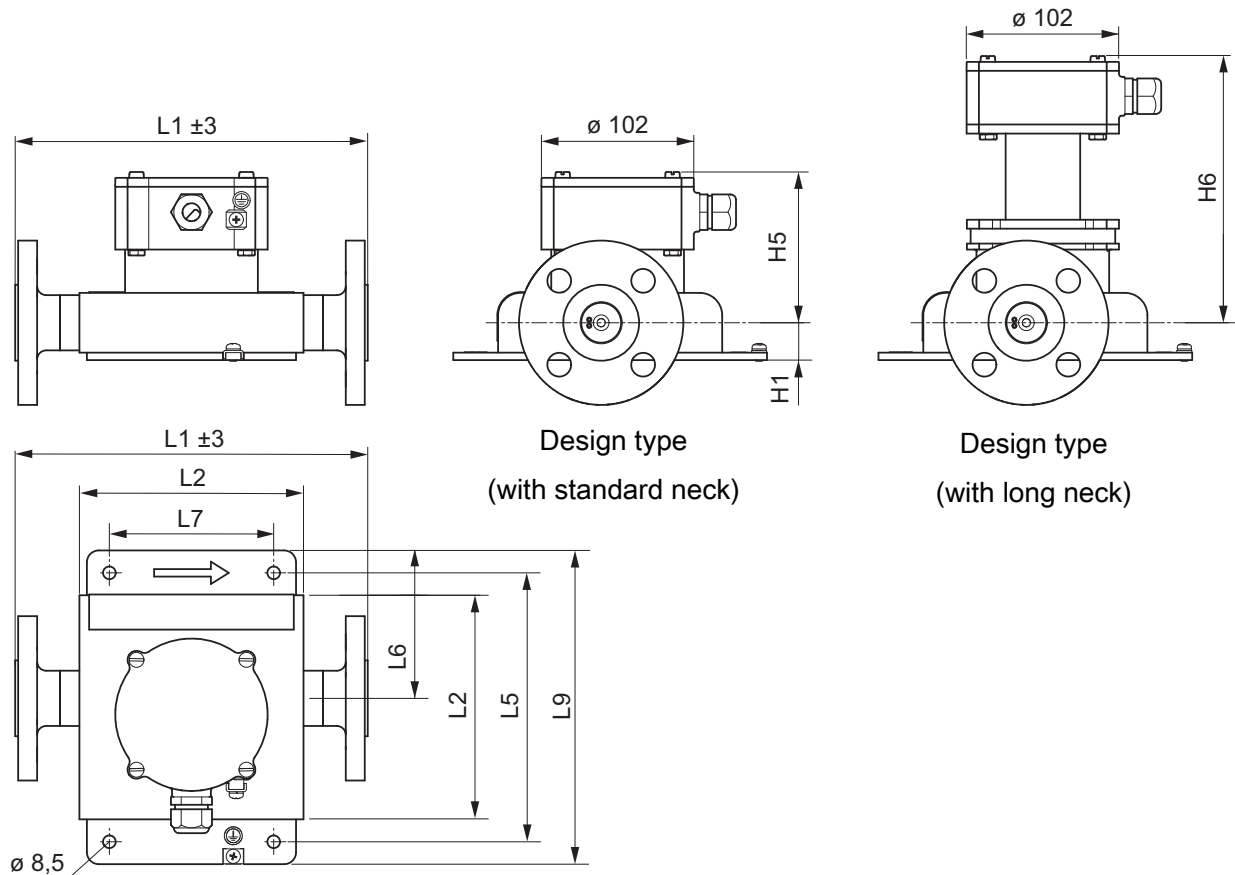


Fig. 22: Dimensions in mm

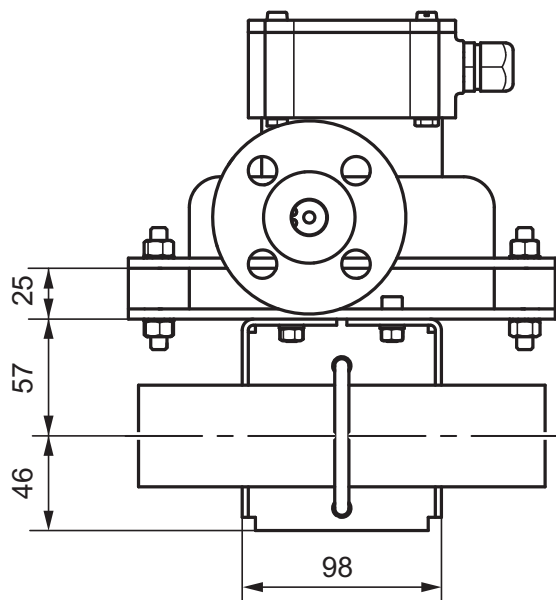


Fig. 23: Dimensions in mm: fixing device option PD for Nano

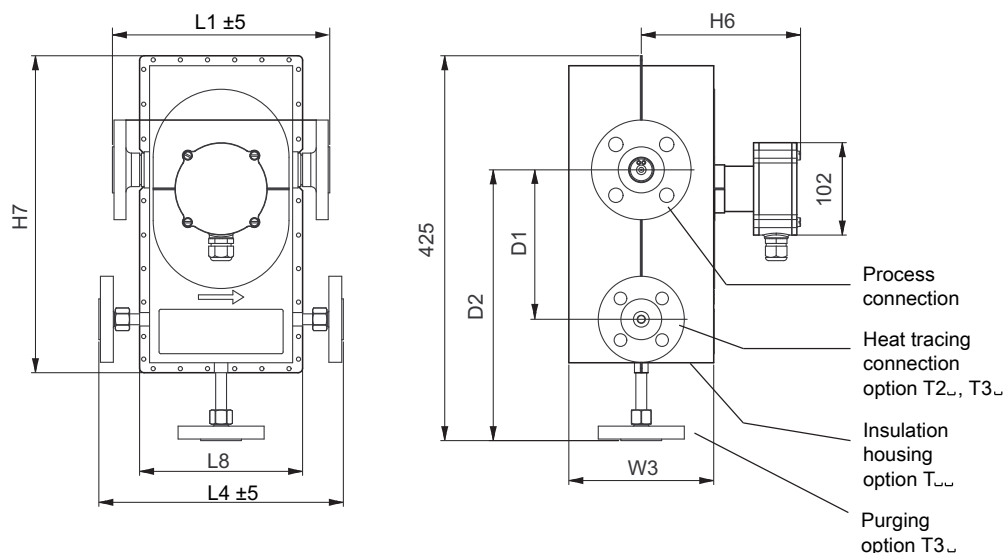


Fig. 24: Dimensions in mm: version with insulation housing

Tab. 12: Dimensions without length L1

Meter size	L2	L4	L5	L6	L7	L8	L9
	in mm (inch)						
Nano 06	150 (5.9)	270 (10.6)	180 (7.1)	111 (4.4)	110 (4.3)	180 (7.1)	210 (8.3)
Nano 08	150 (5.9)	270 (10.6)	180 (7.1)	111 (4.4)	110 (4.3)	180 (7.1)	210 (8.3)
Nano 10	150 (5.9)	270 (10.6)	180 (7.1)	99 (3.9)	110 (4.3)	180 (7.1)	210 (8.3)
Nano 15	150 (5.9)	270 (10.6)	180 (7.1)	89 (3.5)	110 (4.3)	180 (7.1)	210 (8.3)
Nano 20	150 (5.9)	270 (10.6)	180 (7.1)	55 (2.2)	110 (4.3)	180 (7.1)	210 (8.3)

Tab. 13: Dimensions without length L1


Meter size	H1	H3	H5	H6	H7	W3	D1	D2
	in mm (inch)							
Nano 06	25 (1)	81 (3.2)	101 (4)	176 (6.9)	350 (13.8)	160 (6.3)	165 (6.5)	299 (11.8)
Nano 08	25 (1)	81 (3.2)	101 (4)	176 (6.9)	350 (13.8)	160 (6.3)	165 (6.5)	299 (11.8)
Nano 10	25 (1)	81 (3.2)	101 (4)	176 (6.9)	350 (13.8)	160 (6.3)	165 (6.5)	299 (11.8)
Nano 15	25 (1)	81 (3.2)	101 (4)	176 (6.9)	350 (13.8)	160 (6.3)	165 (6.5)	299 (11.8)
Nano 20	25 (1)	81 (3.2)	101 (4)	176 (6.9)	350 (13.8)	160 (6.3)	165 (6.5)	299 (11.8)

Overall length L1 and weight

The overall length of the sensor depends on the selected process connection (type and size of flange). The following tables list the overall length and weight (without insulation or heat tracing and without customized installation length options) as functions of the individual process connection.

The weights in the tables are for the remote type with standard neck. Additional weight for the remote type with long neck: 1 kg (2.2 lb).

Process connections compatible to ASME B16.5 (AISI 316/ AISI 316L dual certified)




Tab. 14: Overall length L1 and weight of sensor (process connections: ASME)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
ASME ½" class 150, raised face (RF)	15	BA1	240 (9.4)	6.2 (14)	240 (9.4)	6.2 (14)	240 (9.4)	6.2 (14)	240 (9.4)	6.2 (14)	240 (9.4)	6.2 (14)
ASME ½" class 300, raised face (RF)		BA2	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)
ASME ½" class 600, raised face (RF)		BA4	250 (9.8)	6.9 (15)	250 (9.8)	6.9 (15)	250 (9.8)	6.9 (15)	250 (9.8)	6.9 (15)	250 (9.8)	6.9 (15)
ASME ½" class 600, ring joint (RJ)		CA4	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)
ASME ½" class 900, raised face (RF)		BA5	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)
ASME ½" class 900, ring joint (RJ)		CA5	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)
ASME ½" class 1500, raised face (RF)		BA6	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)	270 (10.6)	8.8 (19)
ASME ½" class 1500, ring joint (RJ)		CA6	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)	270 (10.6)	11.3 (25)
ASME 1" class 150, raised face (RF)	25	BA1	—	—	240 (9.4)	7.1 (16)	240 (9.4)	7.1 (16)	240 (9.4)	7.1 (16)	240 (9.4)	7.1 (16)
ASME 1" class 300, raised face (RF)		BA2	—	—	240 (9.4)	8.1 (18)	240 (9.4)	8.1 (18)	240 (9.4)	8.1 (18)	240 (9.4)	8.1 (18)
ASME 1" class 600, raised face (RF)		BA4	—	—	260 (10.2)	8.5 (19)	260 (10.2)	8.5 (19)	260 (10.2)	8.5 (19)	260 (10.2)	8.5 (19)
ASME 1" class 600, ring joint (RJ)		CA4	—	—	260 (10.2)	8.6 (19)	260 (10.2)	8.6 (19)	260 (10.2)	8.6 (19)	260 (10.2)	8.6 (19)
ASME 1" class 900, raised face (RF)		BA5	—	—	320 (12.6)	12.7 (28)	320 (12.6)	12.7 (28)	320 (12.6)	12.7 (28)	320 (12.6)	12.7 (28)
ASME 1" class 900, ring joint (RJ)		CA5	—	—	320 (12.6)	12.8 (28)	320 (12.6)	12.8 (28)	320 (12.6)	12.8 (28)	320 (12.6)	12.8 (28)
ASME 1" class 1500, raised face (RF)		BA6	—	—	320 (12.6)	12.7 (28)	320 (12.6)	12.7 (28)	320 (12.6)	12.7 (28)	320 (12.6)	12.7 (28)
ASME 1" class 1500, ring joint (RJ)		CA6	—	—	320 (12.6)	12.8 (28)	320 (12.6)	12.8 (28)	320 (12.6)	12.8 (28)	320 (12.6)	12.8 (28)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
ASME 1½" class 150, raised face (RF)	40	BA1	—	—	250 (9.8)	8 (18)	250 (9.8)	8 (18)	250 (9.8)	8 (18)	250 (9.8)	8 (18)
ASME 1½" class 300, raised face (RF)		BA2	—	—	250 (9.8)	10.3 (23)	250 (9.8)	10.3 (23)	250 (9.8)	10.3 (23)	250 (9.8)	10.3 (23)
ASME 1½" class 600, raised face (RF)		BA4	—	—	270 (10.6)	11.7 (26)	270 (10.6)	11.7 (26)	270 (10.6)	11.7 (26)	270 (10.6)	11.7 (26)
ASME 1½" class 600, ring joint (RJ)		CA4	—	—	270 (10.6)	11.6 (26)	270 (10.6)	11.6 (26)	270 (10.6)	11.6 (26)	270 (10.6)	11.6 (26)
ASME 1½" class 900, raised face (RF)		BA5	—	—	340 (13.4)	17.5 (39)	340 (13.4)	17.5 (39)	340 (13.4)	17.5 (39)	340 (13.4)	17.5 (39)
ASME 1½" class 900, ring joint (RJ)		CA5	—	—	340 (13.4)	17.7 (39)	340 (13.4)	17.7 (39)	340 (13.4)	17.7 (39)	340 (13.4)	17.7 (39)
ASME 1½" class 1500, raised face (RF)		BA6	—	—	340 (13.4)	17.5 (39)	340 (13.4)	17.5 (39)	340 (13.4)	17.5 (39)	340 (13.4)	17.5 (39)
ASME 1½" class 1500, ring joint (RJ)		CA6	—	—	340 (13.4)	17.7 (39)	340 (13.4)	17.7 (39)	340 (13.4)	17.7 (39)	340 (13.4)	17.7 (39)

Meaning of "—": not available

Process connections compatible to EN 1092-1 (1.4404/ AISI 316 L)




Tab. 15: Overall length L1 and weight of sensor (process connections: EN)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
EN DN15 PN40, type B1, raised face (RF)	15	BD4	240 (9.4)	6.8 (15)	240 (9.4)	6.8 (15)	240 (9.4)	6.8 (15)	240 (9.4)	6.8 (15)	240 (9.4)	6.8 (15)
EN DN15 PN40, type D, with groove		GD4	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)
EN DN15 PN40, type E, with spigot		ED4	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)
EN DN15 PN40, type F, with recess		FD4	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)
EN DN15 PN100, type B1, raised face (RF)		BD6	250 (9.8)	7.6 (17)	250 (9.8)	7.6 (17)	250 (9.8)	7.6 (17)	250 (9.8)	7.6 (17)	250 (9.8)	7.6 (17)
EN DN15 PN100, type D, with groove		GD6	250 (9.8)	13.6 (30)	250 (9.8)	13.6 (30)	250 (9.8)	13.6 (30)	250 (9.8)	13.6 (30)	250 (9.8)	13.6 (30)
EN DN15 PN100, type E, with spigot		ED6	250 (9.8)	7.3 (16)	250 (9.8)	7.3 (16)	250 (9.8)	7.3 (16)	250 (9.8)	7.3 (16)	250 (9.8)	7.3 (16)
EN DN15 PN100, type F, with recess		FD6	250 (9.8)	7.5 (17)	250 (9.8)	7.5 (17)	250 (9.8)	7.5 (17)	250 (9.8)	7.5 (17)	250 (9.8)	7.5 (17)
EN DN25 PN40, type B1, raised face (RF)	25	BD4	–	–	240 (9.4)	7.7 (17)	240 (9.4)	7.7 (17)	240 (9.4)	7.7 (17)	240 (9.4)	7.7 (17)
EN DN25 PN40, type D, with groove		GD4	–	–	240 (9.4)	7.7 (17)	240 (9.4)	7.7 (17)	240 (9.4)	7.7 (17)	240 (9.4)	7.7 (17)
EN DN25 PN40, type E, with spigot		ED4	–	–	240 (9.4)	7.4 (16)	240 (9.4)	7.4 (16)	240 (9.4)	7.4 (16)	240 (9.4)	7.4 (16)
EN DN25 PN40, type F, with recess		FD4	–	–	240 (9.4)	7.6 (17)	240 (9.4)	7.6 (17)	240 (9.4)	7.6 (17)	240 (9.4)	7.6 (17)
EN DN25 PN100, type B1, raised face (RF)		BD6	–	–	260 (10.2)	10.3 (23)	260 (10.2)	10.3 (23)	260 (10.2)	10.3 (23)	260 (10.2)	10.3 (23)
EN DN25 PN100, type D, with groove		GD6	–	–	260 (10.2)	10.2 (22)	260 (10.2)	10.2 (22)	260 (10.2)	10.2 (22)	260 (10.2)	10.2 (22)
EN DN25 PN100, type E, with spigot		ED6	–	–	260 (10.2)	9.7 (21)	260 (10.2)	9.7 (21)	260 (10.2)	9.7 (21)	260 (10.2)	9.7 (21)
EN DN25 PN100, type F, with recess		FD6	–	–	260 (10.2)	10.1 (22)	260 (10.2)	10.1 (22)	260 (10.2)	10.1 (22)	260 (10.2)	10.1 (22)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
EN DN40 PN40, type B1, raised face (RF)	40	BD4	—	—	240 (9.4)	9.2 (20)	240 (9.4)	9.2 (20)	240 (9.4)	9.2 (20)	240 (9.4)	9.2 (20)
EN DN40 PN40, type D, with groove		GD4	—	—	240 (9.4)	9.1 (20)	240 (9.4)	9.1 (20)	240 (9.4)	9.1 (20)	240 (9.4)	9.1 (20)
EN DN40 PN40, type E, with spigot		ED4	—	—	240 (9.4)	8.8 (19)	240 (9.4)	8.8 (19)	240 (9.4)	8.8 (19)	240 (9.4)	8.8 (19)
EN DN40 PN40, type F, with recess		FD4	—	—	240 (9.4)	9 (20)	240 (9.4)	9 (20)	240 (9.4)	9 (20)	240 (9.4)	9 (20)
EN DN40 PN100, type B1, raised face (RF)		BD6	—	—	320 (12.6)	13.7 (30)	320 (12.6)	13.7 (30)	320 (12.6)	13.7 (30)	320 (12.6)	13.7 (30)
EN DN40 PN100, type D, with groove		GD6	—	—	320 (12.6)	13.6 (30)	320 (12.6)	13.6 (30)	320 (12.6)	13.6 (30)	320 (12.6)	13.6 (30)
EN DN40 PN100, type E, with spigot		ED6	—	—	320 (12.6)	13.2 (29)	320 (12.6)	13.2 (29)	320 (12.6)	13.2 (29)	320 (12.6)	13.2 (29)
EN DN40 PN100, type F, with recess		FD6	—	—	320 (12.6)	13.5 (30)	320 (12.6)	13.5 (30)	320 (12.6)	13.5 (30)	320 (12.6)	13.5 (30)

Meaning of "—": not available

Process connections compatible to JIS B 2220 (AISI 316/ AISI 316 L)




Tab. 16: Overall length L1 and weight of sensor (process connections: JIS)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
JIS DN15 10K	15	BJ1	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)	240 (9.4)	6.5 (14)
JIS DN15 20K		BJ2	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)	240 (9.4)	6.7 (15)
JIS DN25 10K	25	BJ1	—	—	240 (9.4)	7.6 (17)	240 (9.4)	7.6 (17)	240 (9.4)	7.6 (17)	240 (9.4)	7.6 (17)
JIS DN25 20K		BJ2	—	—	240 (9.4)	8 (18)	240 (9.4)	8 (18)	240 (9.4)	8 (18)	240 (9.4)	8 (18)
JIS DN40 10K	40	BJ1	—	—	240 (9.4)	8.4 (19)	240 (9.4)	8.4 (19)	240 (9.4)	8.4 (19)	240 (9.4)	8.4 (19)
JIS DN40 20K		BJ2	—	—	240 (9.4)	8.8 (19)	240 (9.4)	8.8 (19)	240 (9.4)	8.8 (19)	240 (9.4)	8.8 (19)

Meaning of "—": not available

Process connections compatible to JPI




Tab. 17: Overall length L1 and weight of sensor (process connections: JPI)

Process connections	Model code pos.		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
JPI ½" class 150	15	BP1	240 (9.4)	6.1 (14)	240 (9.4)	6.1 (14)	240 (9.4)	6.1 (14)	240 (9.4)	6.1 (14)	240 (9.4)	6.1 (14)
JPI ½" class 300		BP2	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)	240 (9.4)	6.6 (15)
JPI ½" class 600		BP4	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)	250 (9.8)	6.8 (15)
JPI 1" class 150	25	BP1	—	—	240 (9.4)	6.9 (15)	240 (9.4)	6.9 (15)	240 (9.4)	6.9 (15)	240 (9.4)	6.9 (15)
JPI 1" class 300		BP2	—	—	240 (9.4)	8 (18)	240 (9.4)	8 (18)	240 (9.4)	8 (18)	240 (9.4)	8 (18)
JPI 1" class 600		BP4	—	—	260 (10.2)	8.4 (18)	260 (10.2)	8.4 (18)	260 (10.2)	8.4 (18)	260 (10.2)	8.4 (18)
JPI 1½" class 150	40	BP1	—	—	250 (9.8)	8.1 (18)	250 (9.8)	8.1 (18)	250 (9.8)	8.1 (18)	250 (9.8)	8.1 (18)
JPI 1½" class 300		BP2	—	—	250 (9.8)	10.3 (23)	250 (9.8)	10.3 (23)	250 (9.8)	10.3 (23)	250 (9.8)	10.3 (23)
JPI 1½" class 600		BP4	—	—	270 (10.6)	11.4 (25)	270 (10.6)	11.4 (25)	270 (10.6)	11.4 (25)	270 (10.6)	11.4 (25)

Meaning of "—": not available


Process connections with internal thread NPT



Tab. 18: Overall length L1 and weight of sensor (process connections: NPT thread)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
NPT ¼"	06	TT9	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)
NPT ⅜"	08		260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)
NPT ½"	15		260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)
NPT ¾"	20		260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)


Process connections with internal thread G



Tab. 19: Overall length L1 and weight of sensor (process connections: G thread)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
G 1/4"	06	TG9	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)
G 3/8"	08		260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)
G 1/2"	15		260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)	260 (10.2)	5.6 (12)
G 3/4"	20		260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)	260 (10.2)	5.5 (12)

Clamp process connections according to DIN 32676 series A




Tab. 20: Overall length L1 and weight of sensor (process connections: DIN 32676 series A clamp)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
DIN 32676 series A DN15	15	HS4	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)
DIN 32676 series A DN25	25		—	—	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)
DIN 32676 series A DN40	40		—	—	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)

Meaning of "—": not available

Clamp process connections according to DIN 32676 series C (Tri-Clamp)




Tab. 21: Overall length L1 and weight of sensor (process connections: DIN 32676 series C Tri-Clamp)

Process connections	Model code position		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
DIN 32676 series C ½"	15	HS8	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)	240 (9.4)	5.3 (12)
DIN 32676 series C 1"	25		—	—	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)
DIN 32676 series C 1½"	40		—	—	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)	240 (9.4)	5.4 (12)

Meaning of "—": not available

Clamp process connections according to DIN 11864 2-BF form A




Tab. 22: Overall length L1 and weight of sensor (process connections: DIN 11864-2-BF Form A)

Process connections	Model code pos.		Nano 06		Nano 08		Nano 10		Nano 15		Nano 20	
	5	6	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)	L1 in mm (inch)	Weight in kg (lb)
DIN 11864-2-BF Form A DN15	15	HS3	260 (10.2)	5.7 (12.6)	260 (10.2)	5.7 (12.6)	260 (10.2)	5.7 (12.6)	260 (10.2)	5.7 (12.6)	260 (10.2)	5.7 (12.6)

Meaning of "—": not available

NAMUR & Customer length



Overall length and weight for customized installation length

Tab. 23: Available process connections for options NL and CL with minimum and maximum installation length

Model code position		Nano 06 to Nano 20	
5	6	CL min in mm (inch)	CL max (NL) ¹⁾ in mm (inch)
15	BA1, BA2, BD4, BJ1, BJ2, BP1, BP2, ED4, FD4, GD4	300 (11.8)	510 (20.1)
	BA4, CA4, BP4	310 (12.2)	510 (20.1)
25	BA1, BA2, BD4, BJ1, BJ2, BP1, BP2, ED4, FD4, GD4	300 (11.8)	510 (20.1)
	BA4, CA4, BP4	320 (12.6)	510 (20.1)
40	BA1, BA2, BP1, BP2	310 (12.2)	510 (20.1)
	BD4, BJ1, BJ2, ED4, FD4, GD4	300 (11.8)	510 (20.1)
	BA4, CA4, BP4	330 (13)	510 (20.1)

Meaning of "CL": Customer length, "NL": NAMUR length; NL corresponds to CL max

¹⁾ NL only for process connection size 15, with other sizes only CL available (corresponds to NL for size 15)

Tab. 24: Additional weight in combination with options NL and CL

	Nano 06	Nano 08	Nano 10	Nano 15	Nano 20
Additional weight for customized installation length in kg/mm	0.003				

Typical dimensions of measuring tubes

Tab. 25: Typical dimensions of measuring tubes

Meter size	Material of wetted parts	Model code pos. 4	Internal diameter in mm (inch)	Wall thickness in mm (inch)
Nano06	Measuring tubes made of nickel alloy C-22/2.4602, process connections of stainless steel 1.4404/316L	K	0.90 (0.035)	0.15 (0.006)
Nano08			1.20 (0.047)	0.20 (0.008)
Nano10			2.10 (0.083)	0.25 (0.009)
Nano15			3.00 (0.118)	0.25 (0.009)
Nano20			4.50 (0.177)	0.40 (0.016)

Additional weight for insulation and heat tracing

Tab. 26: Additional weight for insulation and heat tracing

Model code pos. 15	Description	Process connection	Weight in kg (lb)				
			Nano 06	Nano 08	Nano 10	Nano 15	Nano 20
/T10	Insulation	—	2.2 (4.9)				
/T21 ¹⁾	Insulation and heat tracing	ASME ½" class 150, raised face (RF)	2.4 (5.3)				
/T22 ¹⁾		ASME ½" class 300, raised face (RF)					
/T26 ¹⁾		EN DN15 PN40					
/T31 ¹⁾	Insulation and heat tracing with purging	ASME ½" class 150, raised face (RF)	2.6 (5.7)				
/T32 ¹⁾		ASME ½" class 300, raised face (RF)					
/T36 ¹⁾		EN DN15 PN40					

¹⁾Weights from insulation (T10) have to be considered additionally.

5.4 Transmitter dimensions and weights

Transmitter dimensions

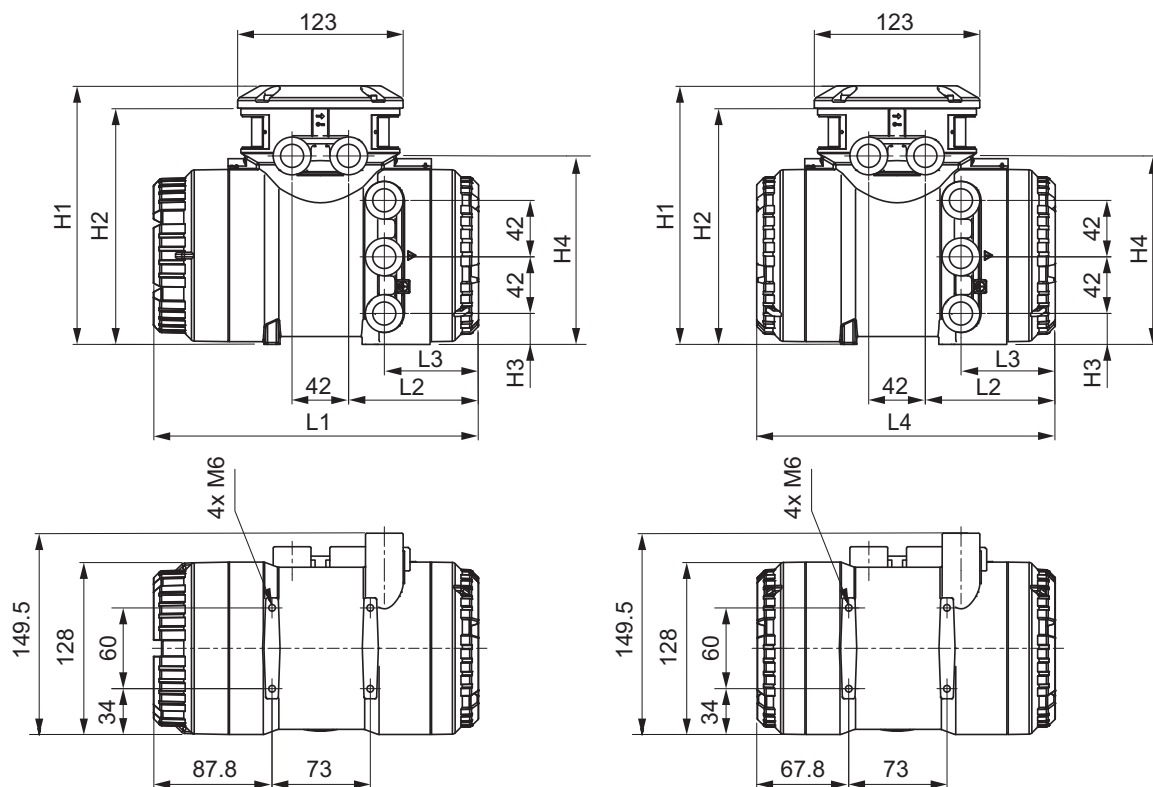


Fig. 25: Dimensions of transmitter in mm
(left: transmitter with display, right: transmitter without display)

Tab. 27: Overall length L1 - L4 and height H1 - H4 of transmitter (material: stainless steel, aluminum)

Material	L1 in mm (inch)	L2 in mm (inch)	L3 in mm (inch)	L4 in mm (inch)	H1 in mm (inch)	H2 in mm (inch)	H3 in mm (inch)	H4 in mm (inch)
Stainless steel	255.5 (10.06)	110.5 (4.35)	69 (2.72)	235 (9.25)	201 (7.91)	184 (7.24)	24 (0.94)	150.5 (5.93)
Aluminum	241.5 (9.51)	96.5 (3.8)	70 (2.76)	221 (8.7)	192 (7.56)	175 (6.89)	23 (0.91)	140 (5.51)


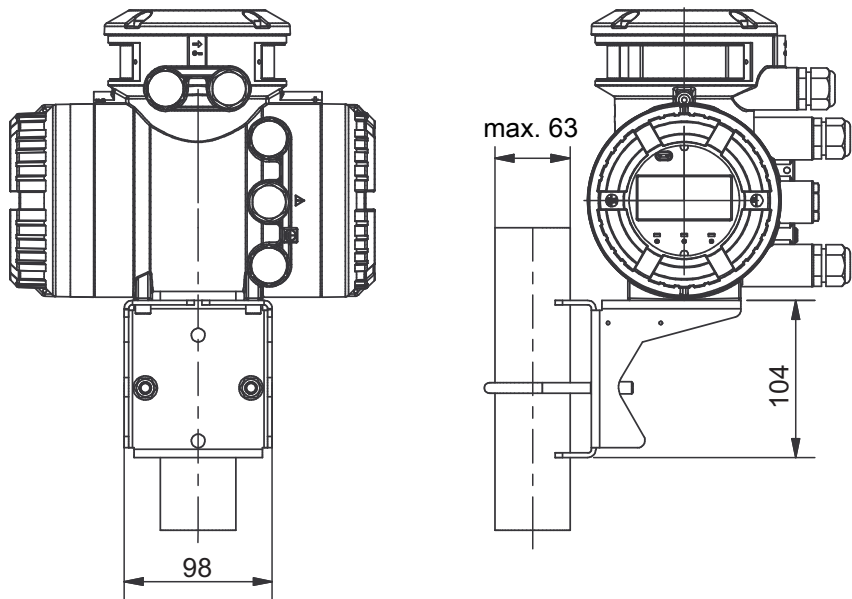


Fig. 26: Dimensions of transmitter in mm, attached to mounting bracket.

Transmitter weights



Model code (pos. 10)	Design type	Housing material of transmitter	Weight in kg (lb)
A, B, E, F	Remote	Aluminum	max. 4.4 (9.7)
J, K		Stainless steel	12.5 (27.6)

6 Electrical specification

6.1 Power supply

Power supply

Alternating-current voltage (rms):

- Power supply¹⁾: 24 V_{AC} +20 % -15 % or 100 – 240 V_{AC} +10 % -20 %
- Power frequency: 47 – 63 Hz

Direct-current voltage:

- Power supply¹⁾: 24 V_{DC} +20 % -15 % or 100 – 120 V_{DC} +8.3 % -10 %

¹⁾ for option MC₋ (Marine approval) supply voltage is limited to 24 V; in addition NE21 testing indicates a tolerable area of 24 V_{DC} ±20 % under NE21 test conditions.

Power consumption

$P \leq 10$ W (including sensor)

Power supply failure



In the event of a power failure, the flow meter data are backed up on a non-volatile internal memory. In case of devices with display, the characteristic sensor values, such as nominal diameter, serial number, calibration constants, zero point, etc. and the error history are also stored on a microSD card.

Galvanic isolation

All circuits for inputs, outputs and power supply are galvanically isolated from each other.

6.2 Electrical interfaces

Depending on the selected interface protocol up to 4 in and/or outputs (I/O) are available, partially configurable.

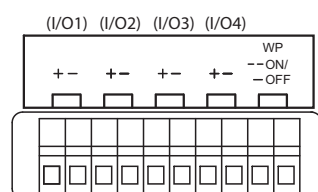

Model code position 13	Interface protocol	IO1 +/-	IO2 +/-	IO3 +/-	IO4 +/-
J ₋	HART	Active or Passive Analog Output + HART	Passive Pulse or Status Output	Configurable	Configurable
M ₋	Modbus	Configurable		Modbus	
G ₋ ¹⁾	PROFIBUS PA	PROFIBUS PA	Passive Pulse Output ²⁾	—	—
F ₋ ¹⁾	FOUNDATION Fieldbus	FOUNDATION Fieldbus		—	—
T3 ¹⁾	PROFINET over APL	PROFINET over APL	PROFINET over APL Shield (+)	Passive Pulse Output ²⁾	—

¹⁾ Only with Ultimate Transmitter

²⁾ For calibration purpose only

Details about in and outputs and communication interfaces are specified in the following chapters.

Spare Sensor I/O

Model code position 13	Specification
NN	Spare sensor without transmitter, all communication types and I/Os apply

6.2.1 Analog inputs and outputs

6.2.1.1 Analog outputs

Active current output *Iout*

One or two current outputs are available depending on model code position 13.

Depending on the measured value, the active current output delivers 4 – 20 mA.

It may be used for output of the following measured values for example.

- Flow rate (mass, volume, net partial component flow of a mixture)
- Density
- Temperature
- Pressure
- Concentration

NOTICE

Please see Software Instruction Manual IM 01U10S0_-00_-R for further details.

For HART communication devices, it is supplied on the current output *Iout1*. The current output may be operated in compliance with the NAMUR NE43 standard.

	Value
Nominal output current range	4 – 20 mA
Maximum output current range	2.4 – 21.6 mA
Load resistance	≤ 750 Ω
Load resistance for secure HART communication	230 – 600 Ω

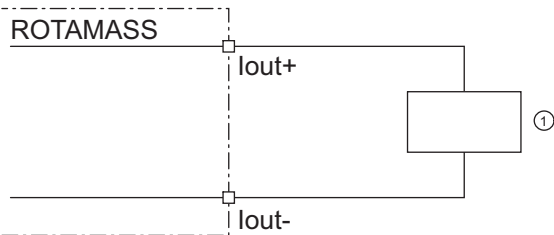


Fig. 27: Active current output connection *Iout* HART

① Receiver

Passive current output *I*_{out}

	Value
Nominal output current range	4 – 20 mA
Maximum output current range	2.4 – 21.6 mA
External power supply	10.5 – 32 V _{DC}
Load resistance for secure HART communication	230 – 600 Ω
Load resistance at current output	≤ 911 Ω

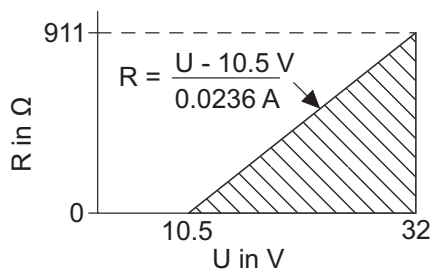


Fig. 28: Maximum load resistance as a function of an external power supply voltage

R Load resistance
U External power supply voltage

The diagram shows the maximum load resistance R as a function of voltage U of the connected voltage source. Higher load resistances are allowed with higher power supply values. The usable zone for passive power output operation is indicated by the hatched area.

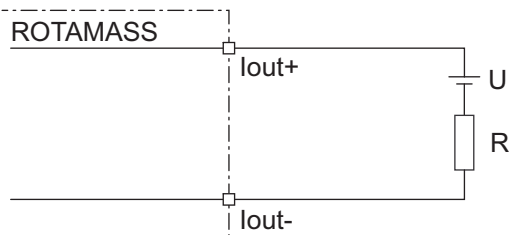


Fig. 29: Passive current output connection *I*_{out}

6.2.1.2 Analog inputs

Active current input *lin*

An individual analog power input is available for external analog devices.

The active current input *lin* is provided for connecting a two-wire transmitter with an output signal of 4 – 20 mA.

	Value
Nominal input current range	4 – 20 mA
Maximum input current range	2.4 – 21.6 mA
Internal power supply	24 V _{DC} ±20 %
Internal load resistance Rotamass	≤ 160 Ω

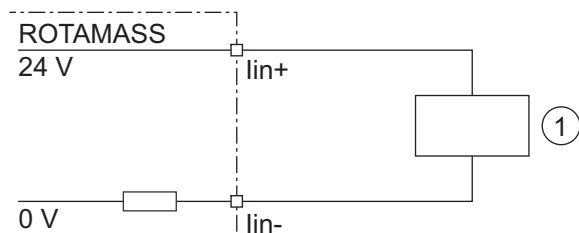


Fig. 30: Connection of external device with passive current output

① External passive current output device

Passive current input *lin*

The passive current input *lin* is provided for connecting a four-wire transmitter with an output signal of 4 – 20 mA.

	Value
Nominal input current range	4 – 20 mA
Maximum input current range	2.4 – 21.6 mA
Internal load resistance Rotamass	≤ 160 Ω

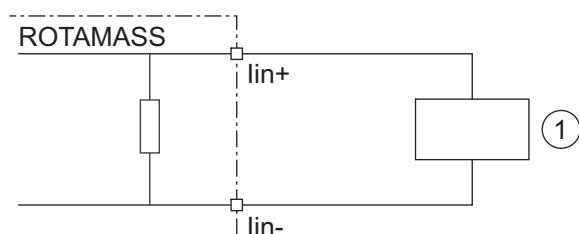


Fig. 31: Connection of external device with active current output

① External active current output device

6.2.2 Digital inputs and outputs

6.2.2.1 Digital outputs

Active pulse output *P/Sout*

Connection of an electronic counter

Maximum voltage and correct polarity must be observed for wiring.

Terms	Value
Load resistance	> 1 kΩ
Internal power supply	24 V _{DC} ±20 %
Maximum pulse rate	10000 pulses/s
Frequency range	0 – 12.5 kHz

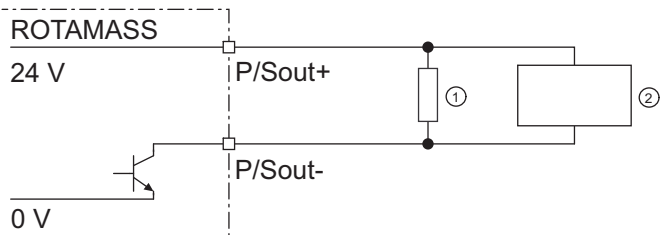


Fig. 32: Active pulse output connection *P/Sout*

- ① Load resistance
- ② Electronic counter

Connection of an electromechanical counter

Terms	Value
Maximum current	150 mA
Average current	≤ 30 mA
Internal power supply	24 V _{DC} ±20 %
Maximum pulse rate	2 pulses/s
Pulse width	20, 33, 50, 100 ms

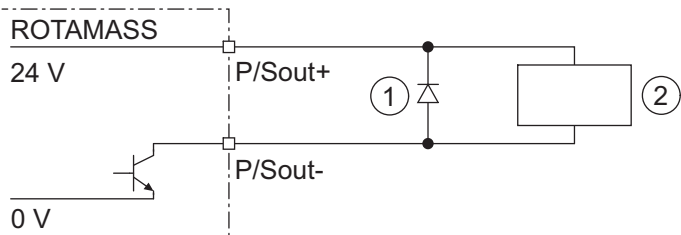
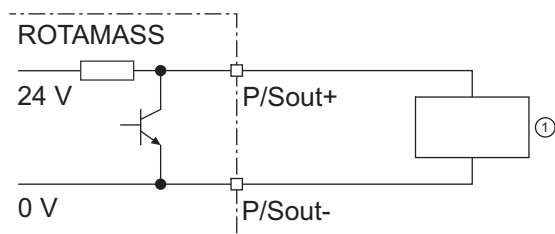


Fig. 33: Active pulse output *P/Sout* connection with electromechanical counter

- ① Protective diode
- ② Electromechanical counter

Active pulse output *P/Sout* with internal pull-up resistor

	Value
Internal power supply	24 V _{DC} ±20 %
Internal pull-up resistor	2.2 kΩ
Maximum pulse rate	10000 pulses/s
Frequency range	0 – 12.5 kHz


Fig. 34: Active pulse output *P/Sout* with internal pull-up resistor

① Electronic counter


Passive pulse output *P/Sout*

Maximum voltage and correct polarity must be observed for wiring.

	Value
Maximum load current	≤ 200 mA
Power supply	≤ 30 V _{DC}
Maximum pulse rate	10000 pulses/s
Frequency range	0 – 12.5 kHz

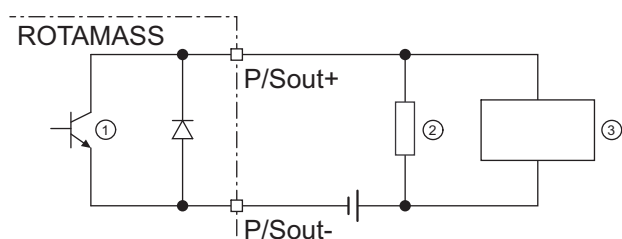Fig. 35: Passive pulse output connection *P/Sout* with electronic counter

- ① Passive pulse or status output
- ② Load resistance
- ③ Electronic counter

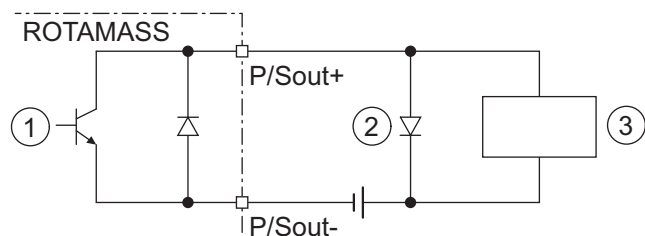Fig. 36: Passive pulse output *P/Sout* connection with electromechanical counter

- ① Passive pulse or status output
- ② Protective diode
- ③ Electromechanical counter

Active status output *P/Sout*

Since this is a transistor contact, maximum allowed current as well as polarity and level of output voltage must be observed during wiring.

	Value
Load resistance	> 1 k Ω
Internal power supply	24 V _{DC} $\pm$ 20 %

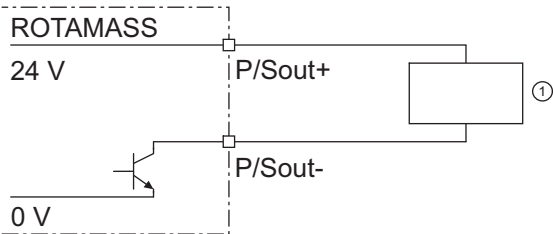


Fig. 37: Active status output connection *P/Sout*

① External device with load resistance

Active status output *P/Sout* with internal pull-up resistor

	Value
Internal pull-up resistor	2.2 k Ω
Internal power supply	24 V _{DC} $\pm$ 20 %

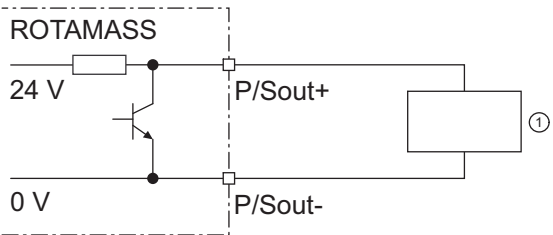


Fig. 38: Active status output *P/Sout* with internal pull-up resistor

① External device

Passive status output *P/Sout* or *Sout*

	Value
Output current	$\leq$ 200 mA
Power supply	$\leq$ 30 V _{DC}

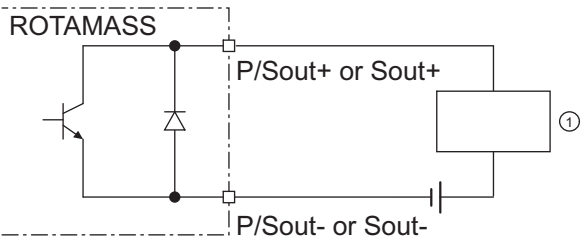


Fig. 39: Passive status output connection *P/Sout* or *Sout*

① External device

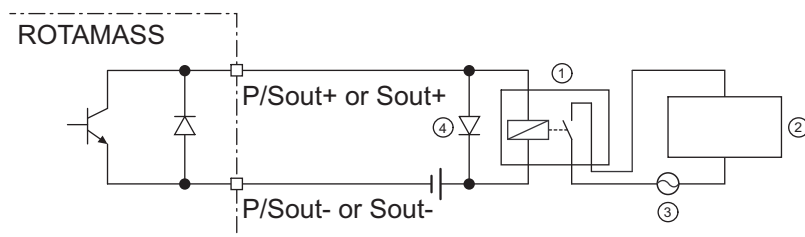


Fig. 40: Passive status output connection *P/Sout* or *Sout* for solenoid valve circuit

- ① Relay
- ② Solenoid valve
- ③ Magnetic valve power supply
- ④ Protective diode

A relay must be connected in series to switch alternating voltage.

Passive pulse or status output *P/Sout* (NAMUR)

Output signals according to EN 60947-5-6 (previously NAMUR, worksheet NA001):

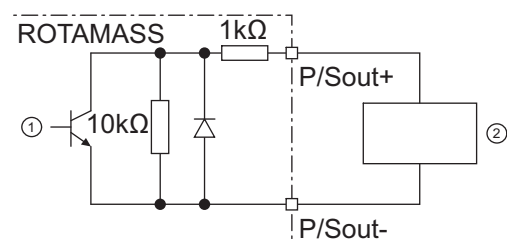


Fig. 41: Passive pulse or status output with switching amplifier connected in series

- ① Passive pulse or status output
- ② Switching amplifier

6.2.2.2 Digital inputs

Status input *Sin*



Do not connect a signal source with electric voltage.

The status input is provided for use of voltage-free contacts with the following specification:

Switching status	Resistance
Closed	< 200 Ω
Open	> 100 kΩ

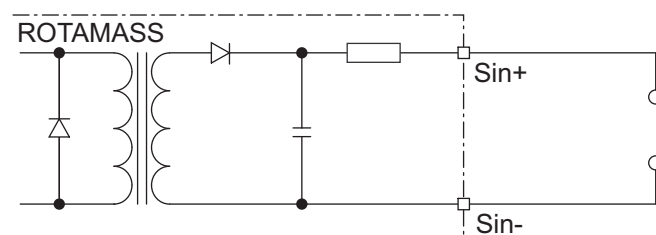


Fig. 42: Status input connection

6.2.3 HART

For HART communication devices, it is supplied on the current output lout1. The current output may be operated in compliance with the NAMUR NE43 standard. HART is available with non-intrinsically and intrinsically safety outputs.

HART I/O

Model code position 13	Connection terminal assignment				
	I/O1 +/-	I/O2 +/-	I/O3 +/-	I/O4 +/-	WP
JA	lout1 Active	P/Sout1 Passive	—	—	Write-protect
JB	lout1 Active	P/Sout1 Passive	P/Sout2 Passive	lout2 Active	Write-protect
JC	lout1 Active	P/Sout1 Passive	Sin	lout2 Active	Write-protect
JD	lout1 Active	P/Sout1 Passive	Sout Passive	P/Sout2 Passive	Write-protect
JE	lout1 Active	P/Sout1 Passive	Sin	P/Sout2 Passive	Write-protect
JF	lout1 Active	P/Sout1 Passive	Sin	P/Sout2 Active Internal pull-up resistor	Write-protect
JG	lout1 Active	P/Sout1 Passive	Sin	P/Sout2 Active	Write-protect
JH	lout1 Active	P/Sout1 Passive	lout2 Passive	lin Active	Write-protect
JJ	lout1 Active	P/Sout1 Passive	P/Sout2 Passive	lin Active	Write-protect
JK	lout1 Active	P/Sout1 Passive	Sin	lin Active	Write-protect
JL	lout1 Active	P/Sout1 Passive	lout2 Passive	lin Passive	Write-protect
JM	lout1 Active	P/Sout1 Passive	P/Sout2 Passive	lin Passive	Write-protect
JN	lout1 Active	P/Sout1 Passive	Sin	lin Passive	Write-protect

lout1	Analog current output with HART communication
lout2	Analog current output
lin	Analog current input
P/Sout1	Pulse or status output
P/Sout2	Pulse or status output
Sin	Status input
Sout	Status output

HART I/O intrinsically safe

Model code position 13	Connection terminal assignment				
	I/O1 +/-	I/O2 +/-	I/O3 +/-	I/O4 +/-	WP
JP	Iout1 Passive	P/Sout1 Passive	Iout2 Passive	—	Write-protect
JQ	Iout1 Passive	P/Sout1 Passive	Iout2 Passive	P/Sout2 Passive	Write-protect
JR	Iout1 Passive	P/Sout1 Passive NAMUR	Iout2 Passive	—	Write-protect
JS	Iout1 Passive	P/Sout1 Passive NAMUR	Iout2 Passive	P/Sout2 Passive NAMUR	Write-protect

Iout1 Analog current output with HART communication

Iout2 Analog current output

P/Sout1 Pulse or status output

P/Sout2 Pulse or status output

Intrinsically safe outputs are only available in combination with selecting Ex approval of the device, see model code position 11 in the table of chapter *Model code description* [▶ 82].

6.2.4 Modbus

Modbus interface is available with configurable I/O option.

Tab. 28: Connection terminal assignment for Modbus

Model code position 13	Connection terminal assignment						
	I/O1 +/-	I/O2 +/-	I/O3 +	I/O3 -	I/O4 +	I/O4 -	WP
M0	–	P/Sout1 Passive	–	Modbus C	Modbus B	Modbus A	Write-protect
M2	lin Active	P/Sout1 Passive	–	Modbus C	Modbus B	Modbus A	Write-protect
M3	P/Sout2 Passive	P/Sout1 Passive	–	Modbus C	Modbus B	Modbus A	Write-protect
M4	P/Sout2 Active	P/Sout1 Passive	–	Modbus C	Modbus B	Modbus A	Write-protect
M5	P/Sout2 Active Internal pull-up resistor	P/Sout1 Passive	–	Modbus C	Modbus B	Modbus A	Write-protect
M6	lout1 Active	P/Sout1 Passive	–	Modbus C	Modbus B	Modbus A	Write-protect
M7	lin Passive	P/Sout1 Passive	–	Modbus C	Modbus B	Modbus A	Write-protect

lout Analog current output, no HART


lin Analog current input

P/Sout1 Pulse or status output

P/Sout2 Pulse or status output

Output Signal

Digital communication signal according to EIA485 standard (RS485).

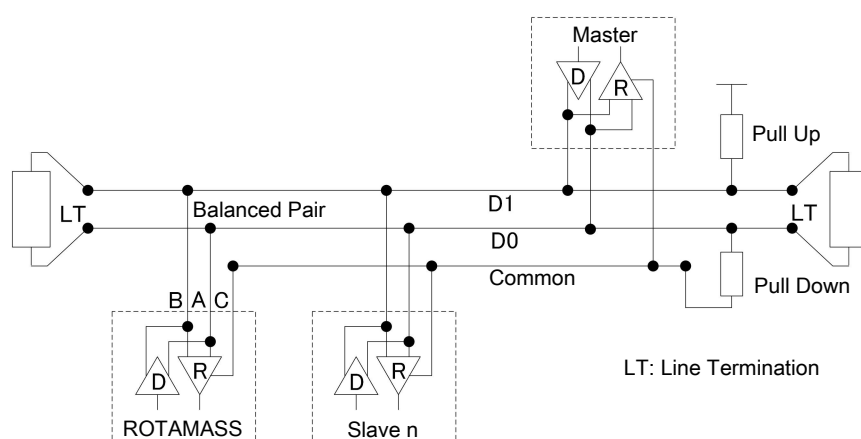

6.2.5 PROFIBUS PA

PROFIBUS PA interface is available with and without intrinsically safety.

Model code position 13	Connection terminal assignment				
	I/O1 +/-	I/O2 +/-	I/O3 +/-	I/O4 +/-	WP
G0	PROFIBUS PA	Pulse Passive	—	—	Write-protect
G1	PROFIBUS PA (IS)	Pulse Passive (IS)	—	—	Write-protect

PROFIBUS PA PA communication
Pulse Passive Pulse / Frequency output

Intrinsically safe (IS) outputs are only available in combination with selecting Ex approval of the device, see model code position 11 of the table in chapter *Model code description* [▶ 82].

Output Signal

Digital communication signal according to IEC 61158/61784.

Maximum voltage and correct polarity must be observed for wiring.

	Value
Power supply	9 – 32 V _{DC}
Current draw	15 mA (maximum)

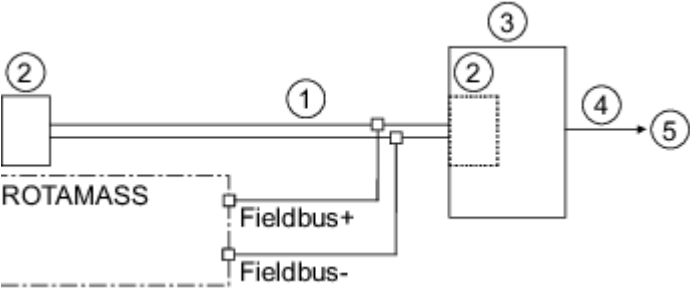


Fig. 43: PROFIBUS PA connection

- ① PROFIBUS PA
- ② Termination
- ③ DP/PA-Coupler
- ④ PROFIBUS DP
- ⑤ HOST

Supported Functions

Profile PA Rev. 3.02 compliant, supporting:

- Condensed Status (NE107)
- Device identification number (IDENT_NUMBER) adaption

Function Blocks	Description	
Transducer	FTB	Flow
	CTB	Concentration
	LTB	LCD Indicator
	MTB	Maintenance
	ADTB	Advanced Diagnostics
Analog Input ¹⁾	AI1	Mass flow
	AI2	Density
	AI3	Temperature
	AI4	Volume flow
	AI5	Reference density
	AI6	Corrected volume flow
Totalizer ¹⁾	TOT1	Mass
	TOT2	Volume
	TOT3	Corrected volume
Analog Output ¹⁾	AO	Pressure

¹⁾ Factory default setting. Assignment can be changed by parameter "channel".

ID	Description	Device description file (GSD)	Applicable function blocks						
			AI1	AI2	AI3	AI4-6	TOT1	TOT2-3	AO
0x45A0	Manufacturer specific	YEC45A0.gsd	•	•	•	•	•	•	•
0x9740	Profile specific	pa139740.gsd	•				•		
0x9741		pa139741.gsd	•	•			•		
0x9742		pa139742.gsd	•	•	•		•		

meaning of "•": available

6.2.6 FOUNDATION Fieldbus

FOUNDATION Fieldbus interface is available with and without intrinsically safety.

Functions overview

Model code position 13	Connection terminal assignment				
	I/O1 +/-	I/O2 +/-	I/O3 +/-	I/O4 +/-	WP
F0	FOUNDATION Fieldbus	Pulse Passive	—	—	Write-protect
F1	FOUNDATION Fieldbus (IS)	Pulse Passive (IS)	—	—	Write-protect

Intrinsically safe (IS) outputs are only available in combination with selecting Ex approval of the device, see model code position 11 in the table of chapter *Model code description* [82].

Output Signal

Digital communication signal according to IEC 61158/61784.

Maximum voltage and correct polarity must be observed for wiring.

	Value
Power supply	9 – 32 V _{DC}
Current draw	15 mA (maximum)

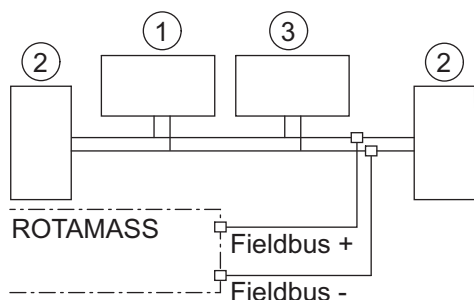


Fig. 44: FOUNDATION Fieldbus connection

- ① Fieldbus power supply and condition
- ② Termination
- ③ HOST

Supported Functions

Compliance to ITK6.3:

Function Blocks	Description	
Transducer	FCB	Flow
	CTB	Concentration
	LTB	LCD Indicator
	MTB	Maintenance
	ADTB	Advanced Diagnostics
Analog Input ¹⁾	AI1	Mass flow
	AI2	Density
	AI3	Temperature
	AI4	Volume flow
	AI5	Reference density
	AI6	Corrected volume flow
Integrator ¹⁾	IT	Depends on FOUNDATION Fieldbus configuration (up to 3)
Multi Analog Output ¹⁾	MAO	Depends on FOUNDATION Fieldbus configuration

¹⁾Depends on FOUNDATION Fieldbus configuration.

ID	Description
594543	Manufacturer
0013	Device Type

6.2.7 PROFINET over APL

PROFINET over APL interface is available with intrinsically safety.

Functions overview

Model code position 13	Connection terminal assignment				
	I/O1 +/-	I/O2 +/-	I/O3 +/-	I/O4 +/-	WP
T3 ¹⁾	PROFINET over APL	PROFINET over APL Shield (+)	Passive Pulse Output ²⁾	—	—

Intrinsically safe (IS) outputs are only available in combination with selecting Ex approval of the device, see model code position 11 in the table of chapter *Model code description* [82].

¹⁾ Only with Ultimate Transmitter

²⁾ For calibration purpose only

Output Signal

Digital communication signal according to IEC IEEE802.3cg (10BASE-T1L: Single Pair Ethernet). Electrical specification according to port profile class SLAA.

	Value
Power supply	9 to 15 V _{DC}
Current draw	20 to 55.56 mA
Power load (max)	0.5 W

For Ethernet-APL connection, it must comply with power class matching. Maximum voltage and correct polarity must be observed for wiring. Port profile SLAA can be connected either to a field switch port with classification SPAA or SPCC.

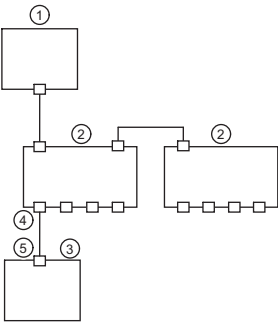


Fig. 45: Spur cable and transmissible length cable

①	Power switch	④	Port classification SPAA or SPCC
②	Field Switch	⑤	Port classification SLAA
③	Field Device (ROTAMASS)		

Supported Functions

- Conformance Class B (CC-B PA), including
 - Network diagnostics function
 - S2 redundancy
- Self-Monitoring and Diagnosis of Field Devices (NE 107)
- PA Profile Rev. 4.02
- Webserver supporting real-time monitoring and parameter configuration
- Update period: Minimum 16ms

Function Blocks	Description	
Analog Input ¹⁾	AI1	Mass flow
	AI2	Density
	AI3	Temperature
	AI4	Volume flow
	AI5	Reference density
	AI6	Corrected volume flow
Totalizer ¹⁾	TOT1	Mass
	TOT2	Volume
	TOT3	Corrected volume
Analog Output ²⁾	AO	Pressure
Manufacturer ID	Device-ID	Description
0x0037	0x0300	Rotamass Total Insight
0xF100	0xB333	Coriolis mass flowmeter

¹⁾ Factory default setting. Assignment can be changed by parameter "Input selector".

²⁾ Factory default setting. Assignment can be changed by parameter "Flow units" and "External function".

Security

The device is supported as covered only if it is installed and used in a control and field network. The operator must be responsible for the IT security of the equipment connected to the device and the device must not be connected to the IT network. Parameter settings can also be locked by either software write protection or hardware write protection.

6.3 Display and microSD card

Display attributes	Specifications	Model code position 14
Type	4-line dot-matrix display	1
Resolution	128(W) x 64 (H) dots	
Size	64.6 mm x 31.2 mm	
Control	via IR switches	

All of the functions described here are also available via digital communication. Numerical values that are entered via the display are limited to 6 digits for process variables and 8 digits for totalizer.

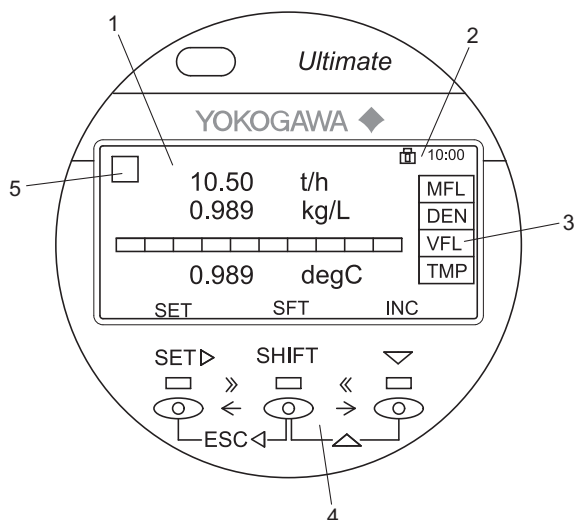


Fig. 46: Display layout

1	Measured quantities and units	4	IR switches
2	Status icon and time	5	Alarm symbol
3	Measured quantity abbreviation		

The controls on the display are IR switches. They respond as soon as an object, such as a finger, is in close proximity. It is not necessary to apply pressure to the display surface.



Display unit

The display unit includes a slot for the microSD card.

SD card attributes	Specifications
Type	Industrial Grade microSD card
SD specification	Compliant with SD Specification version 2.0
Physical dimension	15 mm x 11 mm x 1.0 mm (+/-0.1 mm)
Capacity	1 GB
Seq. Read (MB/s)	24.01
Seq. Write (MB/s)	17.96



It is recommended to use the microSD card included with the Rotamass Total Insight. Functionality of the device cannot be guaranteed if other cards are used.

For status icon placement on the display see figure at *Display* [73], No. 1, 2 or 5.

6.4 Cable specifications

For remote type devices, a connecting cable has to be used to connect the sensor to the transmitter. The device specifications, stated in this document, are valid only if one of the original Rota Yokogawa connecting cables is used.

Cable length limitations to be considered:

Cable type	Option code	Maximum length to keep the specification	Maximum allowable length in hazardous areas
Standard connecting cable	L_	30 m (98.4 ft)	171 m (561.0 ft)
Fire retardant connecting cable	Y_	30 m (98.4 ft)	95 m (311.7 ft)

Cables longer than 30 m must be ordered as separate item. For this purpose please check the “Customer Maintenance Parts List” (CMPL 01U10B01-00EN-R) or consult our Yokogawa Service Team.

If Marine option /MC2 to /MC7 is ordered, a Marine certified cable will be delivered.

7 Approvals and declarations of conformity

CE marking

The Rotamass Total Insight meets the statutory requirements of the applicable EU Directives. By attaching the CE mark, Rota Yokogawa confirms conformity of the field instrument with the requirements of the applicable EU Directives. The EU Declaration of Conformity is enclosed with the product on a data carrier.

Pressure equipment approvals

The Rotamass Total Insight is in compliance with the statutory requirements of the applicable EU Pressure Equipment Directive (PED) for fluid groups 1 and 2.

The customer is fully responsible of selecting proper materials which withstand corrosive or erosive conditions. In case of heavy corrosion and/or erosion the instrument may not withstand the pressure and an incident may happen with human and/or environmental harm. Yokogawa will not take any liability regarding damage caused by corrosion or erosion. If corrosion or erosion may happen, the user has to check periodically if the necessary wall thickness is still in place.

WEEE

Rota Yokogawa GmbH & Co. KG is registered at „Stiftung EAR" as manufacturer of electronic devices. WEEE-Reg.Nr. DE 93847364.

Intended use (for UAE)

Rotamass TI flow meter is specifically designed to both be installed and function within:

- large scale fixed installations
- means of transport for persons or goods, excluding electric two-wheel vehicles which are not type approved.

Details about all standards that are fulfilled are show in the tables below.

Not all options are available in all countries. For details please contact your local Yokogawa Sales Organization.

7.1 Legal equipment standards and norms

Details about all standards that are fulfilled are show in the tables below.

Not all options are available in all countries. For details please contact your local Yokogawa Sales Organization.

Legal equipment standards and norms

Approval type	Approval or certificate
Electromagnetic Compatibility (EMC)	EU directive 2014/30/EU per EN 61326-1 Class A Table 2 and EN 61326-2-3 and EN 61328-2-5 (PROFIBUS PA, FOUNDATION Fieldbus)
	RCM in Australia/New Zealand: Rotamass Total Insight meets the EMC requirements of the Australian Communications and Media Authority (ACMA).
	KC mark in Korea
	TR CU 020 in EAEU area
	CMIM mark in Morocco

Approval type	Approval or certificate
Low Voltage	EU directive 2014/35/EU (LVD) per: ▪ EN 61010 1 ▪ EN 61010 2 030
	TR CU 004 in EAEU area
	CMIM mark in Morocco
	ANSI/UL 61010-1
	CAN/CSA-C22.2 N0. 61010-1/US)
Pressure Equipment	EU directive 2014/68/EU per AD 2000 Code (PED)
	ASME B31.3 compliance
	CRN registered in Canada
	ANSI/UL 61010-1 Annex G
	CAN/CSA-C22.2 N0. 61010-1 Annex G
RoHS	EU Directives 2011/65/EU, 2015/863/EU per EN IEC 63000
	China RoHS
	Environmental Conditions; compliance to ISA-71.04G standard

7.2 Application and industry related standards

General industrial standards

Approval type	Approval or certificate
NAMUR	▪ EMC according to NE 21 ▪ Homologation according to NE 95 ▪ Mounting length according to NE 132
NACE	Chemical composition of wetted materials 316L/316/1.4404/1.4401/1.4435 and Ni-Alloy C-22/2.4602 is conform to: ▪ ANSI / NACE-MR0175 / ISO15156-2 ▪ ANSI / NACE-MR0175 / ISO15156-3 ▪ NACE MR0103 For details please see Rota Yokogawa declaration about NACE conformity 8660001.
API	▪ API MPMS Chapter 5.6:2021 Measurement of Liquid Hydrocarbons by Coriolis Meter ▪ AGA Report No.11:2013 and API MPMS Chapter 14.9:2013 Measurement of Natural Gas by Coriolis Meter

Marine approvals

Approval type	Approval or certificate
IMO	Material Declaration and Ship recycling compliances to IMO Resolution MEPC.379 (80)
DNV	Marine type approval according to DNV Type approval scheme DNV-CP-0338 and EU RO Mutual Recognition type approval required by article 10.1 of EU regulation 391/2009. For thermal oil applications please consider X-ray inspection (option /RT or /RTA); see [82].
KR	Marine type approval according to KR Rules for Classification of Steel Ships Pt.6, Ch.2, Art.301
ABS	Product design assessment according to ABS rules for building and classing ▪ Marine Vessels 4-8-3/1.7, 1.9, 1.11.1, 1.17.1 & 13.1, 4-8-4/27.1, 4-9-9/13.1, 13.5 and Table 1 ▪ Offshore units 4-3-1/9, 11, 15 & 17.1, 4-3-3/9.1.1 and 9.1.2

Approval type	Approval or certificate
LR	Marine type approval according to Lloyd's Register's Type Approval System (LR), test specification Number 1 – December 2021 including Marine, offshore and industrial applications for use in environmental categories ENV1, ENV2, ENV3 and ENV4

Functional Safety

Approval type	Approval or certificate
SIL	Exida Certificate per IEC61508:2010 Parts 1-7 SIL 2 @ HFT=0; SIL 3 @ HFT =1 for both 4...20 mA analog outputs

Metrological Regulations

Approval type	Approval or certificate
NTEP	Compliance with NIST Handbook 44 Requirements. Certificate number: 12-080
ISO	Measurement of fluid flow in closed conduits. Guidance to the selection, installation and use of Coriolis flowmeters (mass flow, density and volume flow measurements) according to Manufacturer Declaration: ISO 10790
Local type approvals	Rotamass Total Insight is registered as a measuring instrument in the following countries: ▪ China ▪ Russia ▪ Belarus ▪ Kazakhstan ▪ Uzbekistan Please contact your Yokogawa representative regarding respective "Pattern Approval Certificate of Measuring Instruments" and for export to these countries.

7.3 Communication interface standards

Communication interface standards

Approval type	Approval or certificate
HART	Registered at FieldComm Group
FOUNDATION Fieldbus	Registered at FieldComm Group acc. to ITK 6
PROFIBUS PA	Certified at PROFIBUS Nutzerorganisation e.V. acc. to PA-Profile 3.02
PROFINET over APL	Certified at PROFIBUS Nutzerorganisation e.V. acc. to PA-Profile 4.02

7.4 Other standards and guidelines

Other standards and guidelines

Approval type	Approval or certificate
IGC	Intergranular Corrosion testing of wetted parts according EN ISO 3651-2 and ASTM. IGC test and certificate available with option P6.

7.5 Hazardous area

Ex approvals: All data relevant for explosion protection are included in separate Explosion Proof Type Manuals.

Approval type	Approval or certificate
ATEX	EU Directive 2014/34/EU ATEX approval: DEKRA 15ATEX0023 X CE ₀₃₄₄ II2G or II2(1)G or II2D or II2(1)D Applied standards: ▪ EN IEC 60079-0 ▪ EN 60079-1 ▪ EN 60079-7 ▪ EN 60079-11 ▪ EN 60079-31 ▪ CLC IEC/TS 60079-47
IECEx	IECEx approval: IECEx DEK 15.0016X Applied standards: ▪ IEC 60079-0 ▪ IEC 60079-1 ▪ IEC 60079-7 ▪ IEC 60079-11 ▪ IEC 60079-31 ▪ IEC TS 60079-47

Approval type	Approval or certificate
FM (CA/US)	FM approvals: ▪ US Cert No. FM16US0095X ▪ CA Cert No. FM16CA0031X Applied standards: ▪ Class 3600 ▪ Class 3610 ▪ Class 3615 ▪ Class 3616 ▪ Class 3810 ▪ ANSI/UL 60079-0 ▪ ANSI/UL 60079-11 ▪ ANSI/UL 61010-1 ▪ ANSI/NEMA 250 ▪ ANSI/IEC 60529 ▪ UL 122701 ▪ CSA-C22.2 No. 0.4 ▪ CSA-C22.2 No. 0.5 ▪ CSA-C22.2 No. 25 ▪ CSA-C22.2 No. 30 ▪ CSA-C22.2 No. 94.1 ▪ CSA-C22.2 No. 94.2 ▪ CSA-C22.2 No. 60079-0 ▪ CSA-C22.2 No. 60079-11 ▪ CSA-C22.2 No. 61010-1 ▪ CSA-C22.2 No. 60529
INMETRO (BR)	INMETRO approval: DEKRA 25.0003X Applied standards: ▪ ABNT NBR IEC 60079-0 ▪ ABNT NBR IEC 60079-1 ▪ ABNT NBR IEC 60079-7 ▪ ABNT NBR IEC 60079-11 ▪ ABNT NBR IEC 60079-31 ▪ ABNT NBR IEC 60079-47
NEPSI (CN)	NEPSI approval: GYJ22.1889X Applied standards: ▪ GB/T 3836.1 ▪ GB/T 3836.2 ▪ GB/T 3836.3 ▪ GB/T 3836.4 ▪ GB/T 3836.31

Approval type	Approval or certificate
PESO (IN)	PESO approval: PESO approval is based on ATEX certification by DEKRA DEKRA 15ATEX0023 X PESO approval is only valid for type of protection “d” flameproof enclosure. Option Q11 must be ordered for conformity of device with PESO requirements. Equipment Reference Numbers: P585538/1 P585538/2 P585538/3 P585538/4 Applied standards: ▪ EN IEC 60079-0 ▪ EN 60079-1 ▪ EN 60079-11
Safety Label (TW)	Please refer to IECEx approval for specifications. A device with IECEx approval (model code position 11, value: SF2_) must be ordered to comply with Safety Label requirements. For export to Taiwan and to get the Safety Label the Yokogawa representative in Taiwan must be contacted in advance. Identification Number: TD04000C
Korea Ex	Korea Ex certificates: ▪ 18-KA4BO-0507X ▪ 18-KA4BO-0508X ▪ 18-KA4BO-0513X ▪ 18-KA4BO-0526X ▪ 18-KA4BO-0509X ▪ 18-KA4BO-0510X ▪ 18-KA4BO-0539X ▪ 18-KA4BO-0540X ▪ 18-KA4BO-0541X ▪ 18-KA4BO-0681X ▪ 18-KA4BO-0542X ▪ 18-KA4BO-0682X ▪ 18-KA4BO-0527X ▪ 18-KA4BO-0528X ▪ 18-KA4BO-0531X ▪ 18-KA4BO-0532X ▪ 18-KA4BO-0533X ▪ 18-KA4BO-0534X ▪ 18-KA4BO-0537X ▪ 18-KA4BO-0538X Applied standards: Notice of Ministry of Labor No 2016-54 harmonized with ▪ IEC 60079-0 ▪ IEC 60079-1 ▪ IEC 60079-7 ▪ IEC 60079-11 ▪ IEC 60079-31

Approval type	Approval or certificate
EAC Ex	RU C-DE.AA87.B.01213/23 Applied standards: ▪ Gost 31610.11-2014 (IEC 60079-11:2011) ▪ Gost IEC 60079-1-2013 ▪ Gost IEC 60079-31-2013 ▪ Gost 31610.7-2017 (IEC 60079-7:2015) ▪ Gost 31610.0-2019 (IEC 60079-0:2017)
Japan Ex	Japan Ex certificates: ▪ DEK 18.0065 X ▪ DEK 18.0066 X ▪ DEK 18.0074 X ▪ DEK 18.0075 X ▪ DEK 18.0083 X ▪ DEK 18.0084 X ▪ DEK 18.0087 X Applied standards: ▪ JNIOASH-TR-46-1 ▪ JNIOASH-TR-46-2 ▪ JNIOASH-TR-46-6
ECAS Ex	25-07-24089/Q25-07-050483/NB0010
Ukraine Ex	DEKRA 15ATEX0023 X


8 Ordering information

8.1 Model code description

The model code of the Rotamass Total Insight is explained below.

Items 1 through 14 are mandatory entries and must be specified at the time of ordering.

Device options (item 15) can be selected and specified individually by separating them with slashes.



Basic model code (pos. 1-4)

Model code positions 5-14 (Mandatory items)

Model code position 15 (device options)

In general, the selection of one option per option group is possible. In option group „Calibration certificate“ all 3 options can be combined.

Model code position	Model code	Description
Transmitter		
1	E	Essential (base function)
1	U	Ultimate (high function)
1	N	Spare sensor without transmitter, combinable with Rotamass TI transmitter
Sensor		
2	N	Nano
Meter size		
3	06	Nominal mass flow: 0.021 t/h (0.77 lb/min) Maximum mass flow: 0.04 t/h (1.5 lb/min)
3	08	Nominal mass flow: 0.045 t/h (1.7 lb/min) Maximum mass flow: 0.094 t/h (3.5 lb/min)
3	10	Nominal mass flow: 0.17 t/h (6.2 lb/min) Maximum mass flow: 0.3 t/h (11 lb/min)
3	15	Nominal mass flow: 0.37 t/h (14 lb/min) Maximum mass flow: 0.6 t/h (22 lb/min)
3	20	Nominal mass flow: 0.95 t/h (35 lb/min) Maximum mass flow: 1.5 t/h (55 lb/min)
Material wetted parts		
4	K	Measuring tubes: Nickel alloy C-22/2.4602 Process connections: Stainless steel 1.4404/316L

Model code position	Model code	Description
Process connection size		
5	06	1/4 in.
5	08	3/8 in.
5	15	DN15, 1/2 in.
5	20	DN20, 3/4 in.
5	25	DN25, 1 in.
5	40	DN40, 1 1/2 in.
Process connection type		
6	BA1	ASME flange class 150, compatible to ASME B16.5, raised face (RF)
6	BA2	ASME flange class 300, compatible to ASME B16.5, raised face (RF)
6	BA4	ASME flange class 600, compatible to ASME B16.5, raised face (RF)
6	CA4	ASME flange class 600, compatible to ASME B16.5, ring joint (RJ)
6	BA5	ASME flange class 900, compatible to ASME B16.5, raised face (RF)
6	CA5	ASME flange class 900, compatible to ASME B16.5, ring joint (RJ)
6	BA6	ASME flange class 1500, compatible to ASME B16.5, raised face (RF)
6	CA6	ASME flange class 1500, compatible to ASME B16.5, ring joint (RJ)
6	BD4	EN flange PN 40, compatible to EN 1092-1 type B1, raised face (RF)
6	GD4	EN flange PN 40, compatible to EN 1092-1 type D, with groove
6	ED4	EN flange PN 40, compatible to EN 1092-1 type E, with spigot
6	FD4	EN flange PN 40, compatible to EN 1092-1 type F, with recess
6	BD6	EN flange PN 100, compatible to EN 1092-1 type B1, raised face (RF)
6	GD6	EN flange PN 100, compatible to EN 1092-1 type D, with groove
6	ED6	EN flange PN 100, compatible to EN 1092-1 type E, with spigot
6	FD6	EN flange PN 100, compatible to EN 1092-1 type F, with recess
6	BJ1	JIS flange 10K, compatible to JIS B 2220
6	BJ2	JIS flange 20K, compatible to JIS B 2220
6	BP1	JPI flange class 150
6	BP2	JPI flange class 300
6	BP4	JPI flange class 600
6	HS3	Threaded aseptic connection according to DIN 11864
6	HS4	Clamp process connection according to DIN 32676 series A
6	HS8	Clamp process connection according to DIN 32676 series C (Tri-Clamp)
6	TG9	Process connection with internal thread G
6	TT9	Process connection with internal thread NPT
Sensor housing material		
7	0	Stainless steel 1.4301/304, 1.4404/316L
7	1	Stainless steel 1.4404/316L
Process fluid temperature range		
8	0	Standard temperature range
8	2	Medium temperature range

Model code position	Model code	Description
Mass flow and density accuracy		
9	E9	Liquid: 0.2% maximum mass flow deviation, 20 g/l density deviation
9	E8	Liquid: 0.2% maximum mass flow deviation, 8 g/l density deviation
9	E7	Liquid: 0.2 % maximum mass flow deviation, 4 g/l density deviation
9	D9	Liquid: 0.15 % maximum mass flow deviation, 20 g/l density deviation
9	D8	Liquid: 0.15 % maximum mass flow deviation, 8 g/l density deviation
9	D7	Liquid: 0.15 % maximum mass flow deviation, 4 g/l density deviation
9	D3	Liquid: 0.15 % maximum mass flow deviation, 1 g/l density deviation
9	D2	Liquid: 0.15 % maximum mass flow deviation, 0.5 g/l density deviation
9	C8	Liquid: 0.1 % maximum mass flow deviation, 8 g/l density deviation
9	C7	Liquid: 0.1 % maximum mass flow deviation, 4 g/l density deviation
9	C3	Liquid: 0.1 % maximum mass flow deviation, 1 g/l density deviation
9	C2	Liquid: 0.1 % maximum mass flow deviation, 0.5 g/l density deviation
9	70	Gas: 0.75 % maximum mass flow deviation
9	50	Gas: 0.50 % maximum mass flow deviation
Design and housing		
10	A	Remote type with "polyester resin powder" coated aluminum transmitter housing and standard neck sensor
10	B	Remote type with "polyester resin powder" coated aluminum transmitter housing and long neck sensor
10	E	Remote type with "corrosion protection" coated aluminum transmitter housing and standard neck sensor
10	F	Remote type with "corrosion protection" coated aluminum transmitter housing and long neck sensor
10	J	Remote type stainless steel transmitter and standard neck sensor
10	K	Remote type stainless steel transmitter and long neck sensor
Ex Approvals		
11	NN00	None
11	KF21	ATEX, explosion group IIC and IIIC
11	KF22	ATEX, explosion group IIB and IIIC
11	SF21	IECEx, explosion group IIC and IIIC
11	SF22	IECEx, explosion group IIB and IIIC
11	FF11	FM, groups A, B, C, D, E, F, G
11	FF12	FM, groups C, D, E, F, G
11	UF21	INMETRO, explosion group IIC and IIIC
11	UF22	INMETRO, explosion group IIB and IIIC
11	NF21	NEPSI, explosion group IIC and dust proof
11	NF22	NEPSI, explosion group IIB and dust proof
11	GF21	EAC Ex, explosion group IIC and IIIC
11	GF22	EAC Ex, explosion group IIB and IIIC
11	PF21	Korea Ex, explosion group IIC and IIIC
11	PF22	Korea Ex, explosion group IIB and IIIC
11	JF52	Japan Ex, Temperature class T2, gas group IIC
11	JF53	Japan Ex, Temperature class T3, gas group IIC
11	JF54	Japan Ex, Temperature class T4, gas group IIC

Model code position	Model code	Description
Cable entries		
12	2	ANSI ½ in. NPT (IP66/67- certified cable glands and blind plugs must be used for this connection)
12	4	ISO M20x1.5 (IP66/67- certified cable glands and blind plugs must be used for this connection)
Communication type and I/O		
13	JA	1 active current output HART, 1 passive pulse or status output
13	JB	2 active current outputs one with HART, 2 passive pulse or status outputs
13	JC	2 active current outputs one with HART, 1 passive pulse or status output, 1 voltage-free status input
13	JD	1 active current output HART, 2 passive pulse or status outputs, 1 passive status output
13	JE	1 active current output HART, 2 passive pulse or status outputs, 1 voltage-free status input
13	JF	1 active current output HART, 1 passive pulse or status output, 1 active pulse or status output with pull-up resistor, 1 voltage-free status input
13	JG	1 active current output HART, 1 passive pulse or status output, 1 active pulse or status output, 1 voltage-free status input
13	JH	1 active current output HART, 1 passive pulse or status output, 1 passive current output, 1 active current input
13	JJ	1 active current output HART, 2 passive pulse or status outputs, 1 active current input
13	JK	1 active current output HART, 1 passive pulse or status output, 1 voltage-free status input, 1 active current input
13	JL	1 active current output HART, 1 passive pulse or status output, 1 passive current output, 1 passive current input
13	JM	1 active current output HART, 2 passive pulse or status outputs, 1 passive current input
13	JN	1 active current output HART, 1 passive pulse or status output, 1 voltage-free status input, 1 passive current input
13	JP	2 passive current outputs one with HART, 1 passive pulse or status output
13	JQ	2 passive current outputs one with HART, 2 passive pulse or status outputs
13	JR	2 passive current outputs one with HART, 1 passive Namur pulse or status output
13	JS	2 passive current outputs one with HART, 2 passive Namur pulse or status outputs
13	F0	FOUNDATION Fieldbus, 1 passive pulse output
13	F1	FOUNDATION Fieldbus, intrinsically safe, 1 passive pulse output
13	M0	Modbus output, 1 passive pulse or status output
13	M2	Modbus output, 1 passive pulse or status output, 1 active current input
13	M3	Modbus output, 2 passive pulse or status outputs
13	M4	Modbus output, 1 passive pulse or status output, 1 active pulse or status output
13	M5	Modbus output, 1 passive pulse or status output, 1 active pulse or status output with pull-up resistor
13	M6	Modbus output, 1 passive pulse or status output, 1 active current output
13	M7	Modbus output, 1 passive pulse or status output, 1 passive current input
13	G0	Profibus PA, 1 passive pulse output
13	G1	Profibus PA, intrinsically safe, 1 passive pulse output
13	T3	PROFINET over APL, intrinsically safe, 1 passive pulse output

Model code position	Model code	Description
13	NN	Spare sensor without transmitter, all communication types and I/Os apply
Display		
14	0	No display
14	1	With display
14	N	Spare sensor without transmitter, no display applied
Model code position	Model code	Description
Additional nameplate information		
15	/BG	Customer-specific tag number on nameplate
Pre-setting of customer parameters		
15	/PS	Presetting of selected parameters based on customer data
Country-specific delivery		
15	/PJ	Delivery to Japan incl. SI units pre-setting and Quality Inspection Certificate (EN/JP)
15	/CN	Delivery to China including China RoHS mark
15	/KC	Delivery to Korea including KC mark
15	/VE	Delivery to EAEU area including EAC mark
15	/VB	Delivery to EAEU area including EAC mark and Belarussia Pattern Approval mark
15	/VR	Delivery to EAEU area including EAC mark and Russia Pattern Approval mark
Country-specific application		
15	/Q11	PESO approval delivery
15	/QR2	Kazakhstan Pattern Approval mark and Primary verification, including certificate
15	/QR3	Uzbekistan Pattern Approval and Primary verification
Concentration and Petroleum measurement		
15	/CST	Standard concentration measurement
15	/AC0	Advanced concentration measurement, customer settings
15	/AC1	Advanced concentration measurement, one default data set
15	/AC4	Advanced concentration measurement, up to four default data sets
15	/C52	Net Oil Computing (NOC) following API standard
Customer-specific calibration		
15	/K2	Customer-specific up to 5-point mass flow calibration with measuring range on factory calibration certificate (mass flow or volume flow of water). A table listing the desired calibration points must be supplied with the order.
15	/K5	Customer-specific up to 10-points mass flow calibration (without repetition) with measuring range on DAKkS calibration certificate (mass flow or volume flow of water). A table listing the desired calibration points must be supplied with the order.
Accordance with terms of order		
15	/P2	Declaration of compliance with the order 2.1 according to EN 10204
15	/P3	Declaration of compliance with the order including inspection certificate 3.1 according to EN 10204 (Quality Inspection Certificate).
Material certificates		
15	/P6	Certificate of Marking Transfer and Raw Material Certificates (Inspection Certificate 3.1 according to EN 10204), including IGC and conform to NACE MR0175 and MR0103. For details and exceptions please refer to Rota Yokogawa declaration about NACE conformity, document no. 8660001.
Pressure testing		
15	/P8	Hydrostatic Pressure Test Certificate (Inspection Certificate 3.1 according to EN 10204)

Model code position	Model code	Description
Surfaces free of oil and grease		
15	/H1	Degreasing of wetted surfaces according to ASTM G93/G93M-19 (Level C), including test report
Welding certificate		
15	/WP	Welding certificates for butt welding between process connection and flow divider: ▪ WPS according to DIN EN ISO 15609-1 ▪ WPQR according to DIN EN ISO 15614-1 ▪ WQC according to DIN EN 287-1 or DIN EN ISO 6906-4
15	/WPA	Welding procedures and certificate according ASME IX for butt welding between process connection and flow divider: ▪ WPS ▪ WPQR ▪ WQP
Calibration certificate		
15	/L2	The certificate confirms that the delivered instrument has undergone a calibration traceable to national standards, including a list of working standards used for calibration. Language: English/Japanese
15	/L3	The certificate confirms that the delivered instrument has undergone a calibration traceable to national standards, including a list of primary standards to which the delivered product is traceable. Language: English/Japanese
15	/L4	The certificate confirms that the delivered instrument has undergone a calibration traceable to national standards and that the calibration system of Rota Yokogawa is traceable to national standards. Language: English/Japanese
X-ray inspection of flange weld seam		
15	/RT	X-ray inspection of flange weld seam according to DIN EN ISO 17636-1/B. Evaluation according to AD2000HP 5/3 and DIN EN ISO 5817/C, including certificate
15	/RTA	X-ray inspection according ASME V
Positive Material Identification of wetted parts		
15	/PM	Positive Material Identification of wetted parts, including certificate (Inspection Certificate 3.1 according to EN 10204)
Dye penetrant test of weld seams		
15	/PT	Dye penetrant test of process connection weld seams according to DIN EN ISO 3452-1, including certificate
15	/PTA	Dye penetrant test of flange welding according to ASME V, including certificate
Combined certificate		
15	/P10	Combination of: ▪ P3: Quality Inspection Certificate ▪ P6: Certificate of Marking Transfer and Raw Material Certificates ▪ P8: Hydrostatic Pressure Test Certificate
15	/P11	Combination of: ▪ P3: Quality Inspection Certificate ▪ P6: Certificate of Marking Transfer and Raw Material Certificates ▪ PM: Positive Material Identification of wetted parts
15	/P12	Combination of: ▪ P3: Quality Inspection Certificate ▪ P6: Certificate of Marking Transfer and Raw Material Certificates ▪ PT: Dye penetrant test according to DIN EN ISO 3452-1 ▪ P8: Hydrostatic Pressure Test Certificate

Model code position	Model code	Description
15	/P13	Combination of: ▪ P3: Quality Inspection Certificate ▪ P6: Certificate of Marking Transfer and Raw Material Certificates ▪ PT: Dye penetrant test according to DIN EN ISO 3452-1 ▪ PM: Positive Material Identification of wetted parts ▪ P8: Hydrostatic Pressure Test Certificate ▪ WP: Welding certificates
15	/P14	Combination of: ▪ PM: Positive Material Identification of wetted parts ▪ P8: Hydrostatic Pressure Test Certificate ▪ WP: Welding certificates
15	/P20	Combination of: ▪ PTA: Dye penetrant test of flange welding according ASME V ▪ WPA: Welding procedures and Certificates according ASME IX ▪ RTA: X-ray test according ASME V
15	/P21	Combination of: ▪ P3: Quality Inspection Certificate ▪ P6: Certificate of Marking Transfer and Raw Material Certificates ▪ P8: Hydrostatic Pressure Test Certificate ▪ PTA: Dye penetrant test of flange welding according ASME V ▪ WPA: Welding procedures and Certificates according ASME IX ▪ RTA: X-ray test according ASME V
15	/P22	Combination of: ▪ P3: Quality Inspection Certificate ▪ P6: Certificate of Marking Transfer and Raw Material Certificates ▪ PM: Positive Material Identification of wetted parts ▪ PTA: Dye penetrant test of flange welding according ASME V ▪ WPA: Welding procedures and Certificates according ASME IX ▪ RTA: X-ray test according ASME V
Tube Health Check		
15	/TC	Tube Health Check
Ferrite testing		
15	/FE	Ferrite test for flange welding acc. DIN EN ISO 8249, including certificate
Batching function		
15	/BT	Batching and filling function
Viscosity function		
15	/VM	Viscosity computing function for liquids
Custody transfer measurement		
15	/Q20	NTEP approval, accuracy class 0.3 acc. NIST Handbook 44
Insulation and heat tracing		
15	/T10	Insulation
15	/T21	Insulation and heat tracing, ASME ½ in. class 150, raised face
15	/T22	Insulation and heat tracing, ASME ½ in. class 300, raised face
15	/T26	Insulation and heat tracing, EN DN15 PN40
15	/T31	Insulation, heat tracing with purging, ASME ½ in. class 150, raised face
15	/T32	Insulation, heat tracing with purging, ASME ½ in. class 300, raised face
15	/T36	Insulation, heat tracing with purging, EN DN15, PN40
Fixing device		
15	/PD	2 in. fixing device for sensor
Measurement of heat quantity		

Model code position	Model code	Description
15	/CGC	Measurement of the total transported energy content of a fuel in connection with a sensor for determining the fuel's calorific value (e.g., a gas chromatograph, not included in scope of delivery).
Marine Approval		
15	/MC2	Marine approval according DNV, EU RO MR TAC, ABS and KR piping class 2
15	/MC3	Marine approval according DNV, EU RO MR TAC, ABS and KR piping class 3
15	/MC4	Marine approval according LR TAC piping class 2
15	/MC5	Marine approval according LR TAC piping class 3
Connecting cable type and length		
15	/L000	Without standard connecting cable
15	/L005	5 meter (16.4 ft) remote connecting cable terminated; standard gray / Ex blue
15	/L010	10 meter (32.8 ft) remote connecting cable terminated; standard gray / Ex blue
15	/L015	15 meter (49.2 ft) remote connecting cable terminated; standard gray / Ex blue
15	/L020	20 meter (65.6 ft) remote connecting cable terminated; standard gray / Ex blue
15	/L030	30 meter (98.4 ft) remote connecting cable terminated; standard gray / Ex blue
15	/Y000	Without fire retardant connecting cable
15	/Y005	5 meter (16.4 ft) remote fire retardant connecting cable, terminated, with BV or DNV Type Approval Certificate
15	/Y010	10 meter (32.8 ft) remote fire retardant connecting cable, terminated, with BV or DNV Type Approval Certificate
15	/Y015	15 meter (49.2 ft) remote fire retardant connecting cable, terminated, with BV or DNV Type Approval Certificate
15	/Y020	20 meter (65.6 ft) remote fire retardant connecting cable, terminated, with BV or DNV Type Approval Certificate
15	/Y030	30 meter (98.4 ft) remote fire retardant connecting cable, terminated, with BV or DNV Type Approval Certificate
Cable glands and blind plug		
15	/V52	2 cable glands, 1 blind plug for power, communication and I/O
15	/V53	3 cable glands for power, communication and I/O
Customized installation length		
15	/NL	NAMUR installation length according to NE132
15	/CL	Customer-specific installation length
Nameplates and Tags		
15	/SCT	Stainless steel tag plate
Adapter for cable entries		
15	/AD2	2 adapter ANSI 1/2 in. NPT to JIS G1/2
Steel armored connecting cable		
15	/LAC	Steel armored version of standard connecting cable

Not all options are available in all countries. For details please contact your local Yokogawa Sales Organization.

8.2 Available model codes per basic model



For complete product configuration, please refer to the FlowConfigurator online sizing and configuration tool: <http://www.FlowConfigurator.com>

Stainless Steel Devices															
Code	Essential Transmitter					Ultimate Transmitter					Spare Sensor				
	RCEN06K	RCEN08K	RCEN10K	RCEN15K	RCEN20K	RCUN06K	RCUN08K	RCUN10K	RCUN15K	RCUN20K	RCNN06K	RCNN08K	RCNN10K	RCNN15K	RCNN20K
process connection size															
-15	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-25		•	•	•	•		•	•	•	•		•	•	•	•
-40		•	•	•	•		•	•	•	•		•	•	•	•
-08	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-20	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-06	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
process connection type															
BA1	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BA2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BA4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BA5	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BA6	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
CA4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
CA5	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
CA6	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BD4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
GD4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
GD6	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
ED4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
ED6	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
FD4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
FD6	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BJ1	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BJ2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
TG9	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
TT9	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BP1	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BP2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BP4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
BD6	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
HS3	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
HS4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
HS8	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Sensor housing material															
0	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
1	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Process fluid temperature range															
0	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Mass flow and density accuracy															
E9	•					•									
E8		•					•								
E7			•	•	•			•	•	•					
D9						•					•				
D8							•								
D7								•	•	•					
D3								•	•	•					
D2									•	•					
C8							•					•			
C7								•	•	•			•	•	•
C3								•	•	•			•		
C2									•	•				•	•
70	•	•	•	•	•										
50						•	•	•	•	•	•	•	•	•	•

Stainless Steel Devices															
Code	Essential Transmitter					Ultimate Transmitter					Spare Sensor				
	RCEN06K	RCEN08K	RCEN10K	RCEN15K	RCEN20K	RCUN06K	RCUN08K	RCUN10K	RCUN15K	RCUN20K	RCNN06K	RCNN08K	RCNN10K	RCNN15K	RCNN20K
Design and housing															
A	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
B	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
E	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
F	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
J	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
K	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Ex Approvals															
-NN00	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-KF21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-KF22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-FF11	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-FF12	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-SF21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-SF22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-GF21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-GF22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-UF21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-UF22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-NF21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-NF22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-JF52	•	•	•	•	•	•	•	•	•	•					
-JF53	•	•	•	•	•	•	•	•	•	•					
-JF54	•	•	•	•	•	•	•	•	•	•					
-PF21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-PF22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Cable entries															
-2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
-4	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Communication type and I/O															
-JA	•	•	•	•	•	•	•	•	•	•					
-JB	•	•	•	•	•	•	•	•	•	•					
-JC	•	•	•	•	•	•	•	•	•	•					
-JD	•	•	•	•	•	•	•	•	•	•					
-JE	•	•	•	•	•	•	•	•	•	•					
-JF	•	•	•	•	•	•	•	•	•	•					
-JG	•	•	•	•	•	•	•	•	•	•					
-JH						•	•	•	•	•					
-JJ						•	•	•	•	•					
-JK						•	•	•	•	•					
-JL						•	•	•	•	•					
-JM						•	•	•	•	•					
-JN						•	•	•	•	•					
-JP	•	•	•	•	•	•	•	•	•	•					
-JQ	•	•	•	•	•	•	•	•	•	•					
-JR	•	•	•	•	•	•	•	•	•	•					
-JS	•	•	•	•	•	•	•	•	•	•					
-F0						•	•	•	•	•					
-F1						•	•	•	•	•					
-G0						•	•	•	•	•					
-G1						•	•	•	•	•					
-M0	•	•	•	•	•	•	•	•	•	•					
-M2						•	•	•	•	•					
-M3	•	•	•	•	•	•	•	•	•	•					
-M4	•	•	•	•	•	•	•	•	•	•					
-M5	•	•	•	•	•	•	•	•	•	•					
-M6	•	•	•	•	•	•	•	•	•	•					
-M7						•	•	•	•	•					
-T3						•	•	•	•	•	•	•	•	•	•
-NN											•	•	•	•	•
Display															
0	•	•	•	•	•										
1	•	•	•	•	•	•	•	•	•	•					
N											•	•	•	•	•

Stainless Steel Devices															
Code	Essential Transmitter					Ultimate Transmitter					Spare Sensor				
	RCEN06K	RCEN08K	RCEN10K	RCEN15K	RCEN20K	RCUN06K	RCUN08K	RCUN10K	RCUN15K	RCUN20K	RCNN06K	RCNN08K	RCNN10K	RCNN15K	RCNN20K
Additional nameplate information															
/BG	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Pre-setting of customer parameters															
/PS	•	•	•	•	•	•	•	•	•	•					
Country-specific delivery															
/PJ	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/CN	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/KC	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/VB	•	•	•	•	•	•	•	•	•	•					
/VE	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/VR	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Country-specific application															
/Q11	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/QR2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/QR3	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Concentration and Petroleum measurement															
/CST						•	•	•	•	•					
/AC0						•	•	•	•	•					
/AC1						•	•	•	•	•					
/AC4						•	•	•	•	•					
/C52						•	•	•	•	•					
Customer-specific calibration															
/K2	•	•	•	•	•	•	•	•	•	•					
/K5	•	•	•	•	•	•	•	•	•	•					
Accordance with terms of order															
/P2	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P3	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Material certificates															
/P6	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Pressure testing															
/P8	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Surfaces free of oil and grease															
/H1	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Welding certificate															
/WP	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/WPA	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Calibration certificate															
/L2	•	•	•	•	•	•	•	•	•	•					
/L3	•	•	•	•	•	•	•	•	•	•					
/L4	•	•	•	•	•	•	•	•	•	•					
X-ray inspection of flange weld seam															
/RT	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/RTA	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Positive Material Identification of wetted parts															
/PM	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Dye penetrant test of weld seams															
/PT	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/PTA	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Combined certificate															
/P10	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P11	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P12	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P13	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P14	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P20	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/P22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Tube Health Check															
/TC	•	•	•	•	•	•	•	•	•	•					
Ferrite testing															
/FE	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Batching function															
/BT						•	•	•	•	•					

Stainless Steel Devices															
Code	Essential Transmitter					Ultimate Transmitter					Spare Sensor				
	RCEN06K	RCEN08K	RCEN10K	RCEN15K	RCEN20K	RCUN06K	RCUN08K	RCUN10K	RCUN15K	RCUN20K	RCNN06K	RCNN08K	RCNN10K	RCNN15K	RCNN20K
Viscosity function															
/VM						•	•	•	•	•					
Custody transfer measurement															
/Q20										•					
Insulation and heat tracing															
/T10	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/T21	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/T22	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/T26	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/T31	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/T32	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/T36	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Fixing device															
/PD	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Measurement of heat quantity															
/CGC						•	•	•	•	•					
Marine Approval															
/MC2	•	•	•	•	•	•	•	•	•	•					
/MC3	•	•	•	•	•	•	•	•	•	•					
/MC4			•	•	•			•	•	•					
/MC5			•	•	•			•	•	•					
Connecting cable type and length															
/L000	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/L005	•	•	•	•	•	•	•	•	•	•					
/L010	•	•	•	•	•	•	•	•	•	•					
/L015	•	•	•	•	•	•	•	•	•	•					
/L020	•	•	•	•	•	•	•	•	•	•					
/L030	•	•	•	•	•	•	•	•	•	•					
/Y000	•	•	•	•	•	•	•	•	•	•	•		•	•	•
/Y005	•	•	•	•	•	•	•	•	•	•					
/Y010	•	•	•	•	•	•	•	•	•	•					
/Y015	•	•	•	•	•	•	•	•	•	•					
/Y020	•	•	•	•	•	•	•	•	•	•					
/Y030	•	•	•	•	•	•	•	•	•	•					
Cable glands and blind plug															
/V52	•	•	•	•	•	•	•	•	•	•					
/V53	•	•	•	•	•	•	•	•	•	•					
Customized installation length															
/NL	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
/CL	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Nameplates and Tags															
/SCT	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Adapter for cable entries															
/AD2	•	•	•	•	•	•	•	•	•	•					
Steel armored connecting cable															
/LAC	•	•	•	•	•	•	•	•	•	•					

8.3 Ordering Instructions

Specify the following information when ordering a product:

8.3.1 Mandatory ordering instructions

The following information have to be specified when ordering a product:

- Model code
- Fluid name
- Rotamass TI is delivered with quick reference hardcopy, a compressed version of the general instruction manual. For delivery choose one of the languages below:
 - English
 - French
 - German
 - Japanese
 - Chinese
 - Korean
 - Russian

8.3.2 Optional ordering instructions

The following information depend on the product configuration and can or have to be selected.

Manual and display language

- Display language and units depend on the selected language pack:

pack 1	pack 2	pack 3
EN-Pack1 - English	EN-Pack2 - English	EN-Pack3 - English
DE-Pack1 - German	DE-Pack2 - German	DE-Pack3 - German
FR-Pack1 - French	RU-Pack2 - Russian	FR-Pack3 - French
PT-Pack1 - Portuguese	PL-Pack2 - Polish	PT-Pack3 - Portuguese
IT-Pack1 - Italian	KZ-Pack2 - Kazakh	IT-Pack3 - Italian
ES-Pack1 - Spanish		ES-Pack3 - Spanish
JA-Pack1 - Japanese		CN-Pack3 - Chinese

- Unit notation on the display (display only present for value 1 on position 14 of the model code):
 - Metric units
 - Imperial units - US
 - Imperial units - GB
 - Russia specific units (only available with language pack 2)
 - Japan specific units (only available with language pack 1)

Serial and tag number, customer name

- Tag No. engraved on the nameplate and mentioned on the calibration certificate (option BG, up to 17 characters length)
- Customer name for the certificates (option L2, L3, L4: up to 40 characters length)
- Software Tag No.: short and long (short tag no. mentioned also on the calibration certificate):

Parameter	Value
HART/ Modbus Tag No. (short): up to 8 characters length (Capital letters only)	Default value has 8 space characters
HART/ Modbus Tag No. (long): up to 32 characters length	Default value has 32 space characters
PROFIBUS PA NODE ADDRESS (HEX): up to 2 characters length	Default value '0x7E' unless otherwise specified
PROFIBUS PA SOFTWARE TAG: up to 32 characters length	Default value 'FT2001' unless otherwise specified
FOUNDATION Fieldbus NODE ADDRESS (HEX): up to 2 characters length	Default value '0xF6' unless otherwise specified
FOUNDATION Fieldbus SOFTWARE TAG: up to 32 characters length	Default value 'FT2004' unless otherwise specified
PROFINET STATION NAME:	Empty
PROFINET SOFTWARE TAG (long): up to 32 characters length	Default value 'FT2001' unless otherwise specified
PROFINET IP ADDRESS:	'192.168.1.210'
PROFINET SUBNET MASK:	'255.255.255.0'
PROFINET Default gateway IP address:	Empty

Concentration measurement

In case advanced concentration measurement with predefined sets (option AC1, AC4) is ordered, at least one of the following sets have to be selected:




Set	Fluid A / B	Concentration range	Unit	Temperature units	
				in °C	in °F
C01	Sugar / Water	0 – 85	°Bx	0 – 80	32 – 176
C02 ¹⁾	NaOH / Water	2 – 50	WT%	0 – 100	32 – 212
C03	KOH / Water	0 – 60	WT%	54 – 100	129 – 212
C04	NH ₄ NO ₃ / Water	1 – 50	WT%	0 – 80	32 – 176
C05	NH ₄ NO ₃ / Water	20 – 70	WT%	20 – 100	68 – 176
C06 ¹⁾	HCl / Water	22– 34	WT%	20 – 40	68 – 104
C07	HNO ₃ / Water	50 – 67	WT%	10 – 60	50 – 140
C09 ¹⁾	H ₂ O ₂ / Water	30 – 75	WT%	4 – 44	39 – 111
C10 ¹⁾	Ethylene Glycol / Water	10 – 50	WT%	-20 – 40	-4 – 104
C11	Amylum = starch / Water	33 – 43	WT%	35 – 45	95 – 113
C12	Methanol / Water	35 – 60	WT%	0 – 40	32 – 104
C20	Alcohol / Water	55 – 100	VOL%	10 – 40	50 – 104
C21	Sugar / Water	40 – 80	°Bx	75 – 100	167 – 176
C30	Alcohol / Water	66 – 100	WT%	15 – 40	59 – 104
C37	Alcohol / Water	66 – 100	WT%	10 – 40	50 – 104

¹⁾ We recommend using devices with wetted parts made of nickel alloy C22. Contact the Yokogawa sales organization about availability.

Maximum 4 C... option sets can be ordered for one device simultaneously.

Display orientation

- When display is ordered, its orientation has to be specified. Orientation of the display (display only present for value 1 on position 14 of the model code):

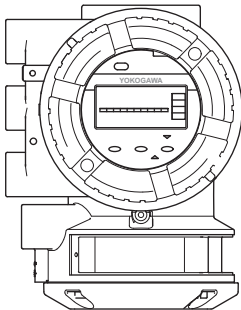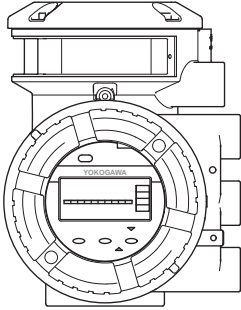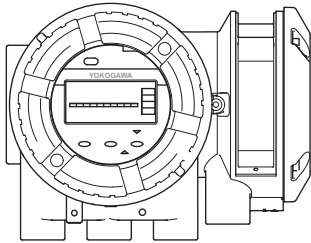Orientation 1	Orientation 2	Orientation 3
	Recommended orientation	
		

- Unit notation on the display (display only present for value 1 on position 14 of the model code):
 - SI - units
 - Imperial - units U.S.
 - Imperial - units GB
 - Russia specific - units
 - Japan specific units



The parameter "Installation Orientation" in transmitter must be set by the customer according to the installation direction of the sensor.

TRADEMARKS

HART:	registered trademark of FieldComm Group, Inc., US
Modbus:	registered trademark of SCHNEIDER ELECTRIC USA, INC.
FOUNDATION Fieldbus:	registered trademark of FieldComm Group, Inc., US
PROFIBUS: PROFINET:	registered trademark of PROFIBUS and PROFINET International, Karlsruhe, DE
Ethernet-APL:	registered trademark of FieldComm Group, ODVA, OPC Foundation, and PROFIBUS Nutzerorganisation e.V.
ROTAMASS:	registered trademark of Rota Yokogawa GmbH & Co. KG, DE
TRI-CLAMP:	registered trademark of ALFA LAVAL CORPORATE AB, SE
FieldMate:	registered trademark of YOKOGAWA ELECTRIC CORPORATION
SD:	registered trademark of SD-3C LLC.
QR code:	registered trademark of DENSO WAVE INCORPORATED

All other company and product names mentioned in this document are trade names, trademarks or registered trademarks of their respective companies. In this document, trademarks or registered trademarks are not marked with TM or ®.

All rights reserved. Copyright © 2025-09-29

Manufacturer:

Rota Yokogawa GmbH & Co. KG
Rheinstr. 8
D-79664 Wehr
Germany

For the actual manufacturing location of your device refer to the model code and/or serial number.

