

# Drawings

EJX110A  
 Differential Pressure Transmitter  
 Wetted Parts Material Code S, L  
 (Except for Measurement Span Code F  
 and Option Code /HD, /HD2)



SD 01C25B01-01E


[Style: S3]

Unit: mm (approx. inch)


## Wetted Parts Material Code S, L (Except for Measurement Span Code F and Option Code /HD, /HD2)

### • Vertical Impulse Piping Type

Process connector downside  
 (Installation code 7)

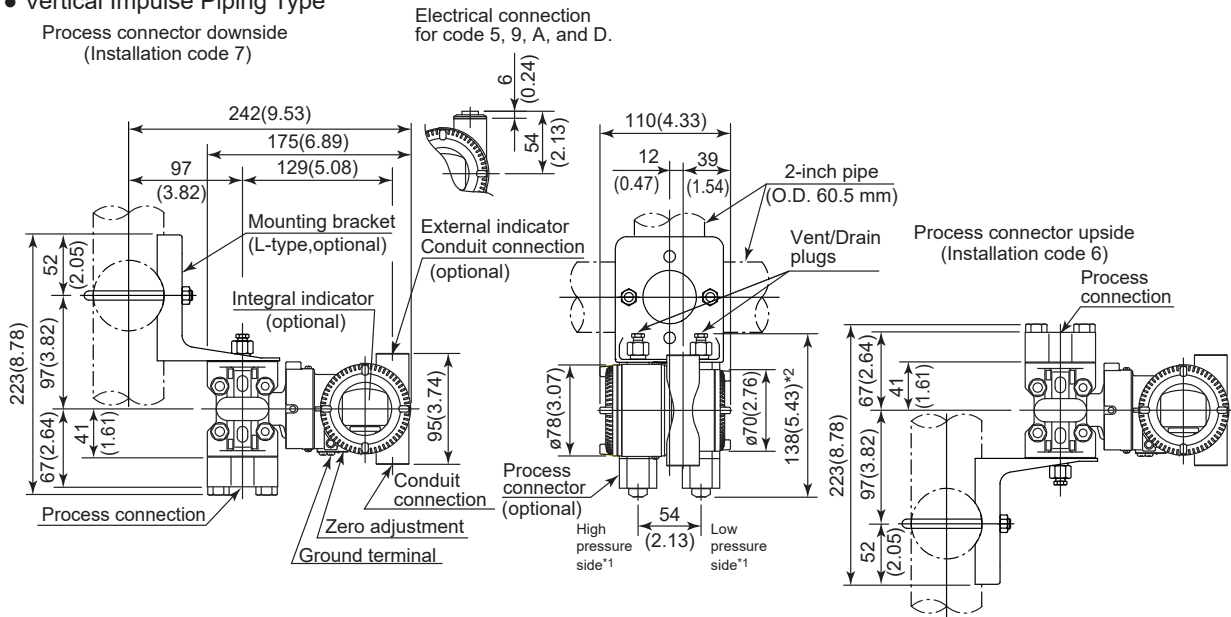


### • Horizontal Impulse Piping Type (Installation code 9)

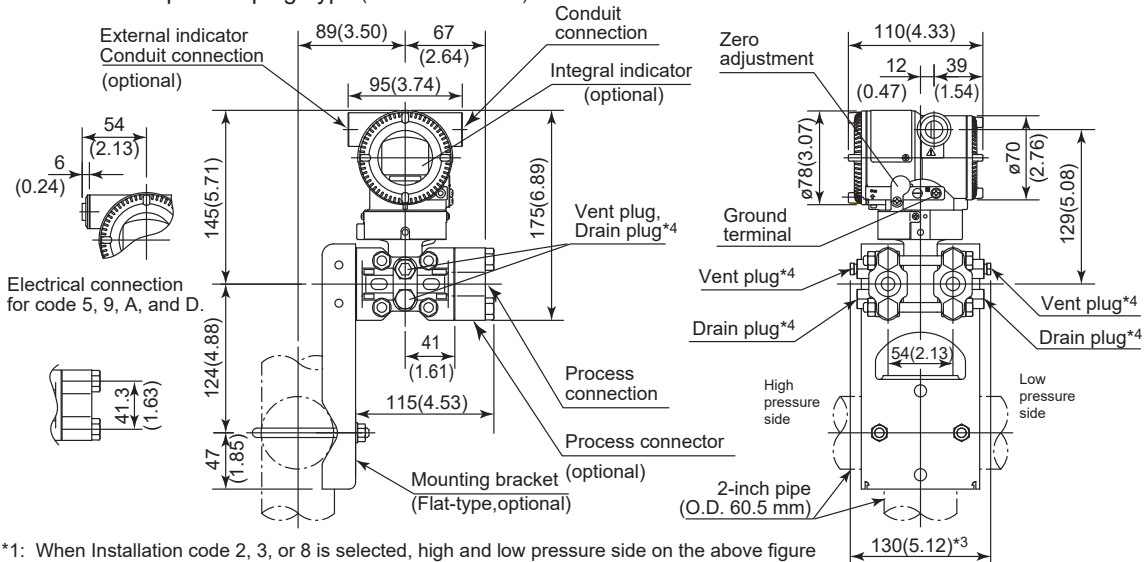


- \*1: When Installation code 2, 3, or 8 is selected, high and low pressure side on the above figure are reversed. (i.e. High pressure side is on the right side.)
- \*2: When Option code K1, K2, K5, or K6 is selected, add 15 mm(0.59 inch) to the value in the figure.
- \*3: When Option code K1, K2, K5, or K6 is selected, add 30 mm(1.18 inch) to the value in the figure.
- \*4: Not available when option code GS is specified.
- \*5: When electrical connection code 7 or C is selected, a blind plug is protruded up to 8 mm(0.31 inch) from the conduit connection.

- Terminal Configuration

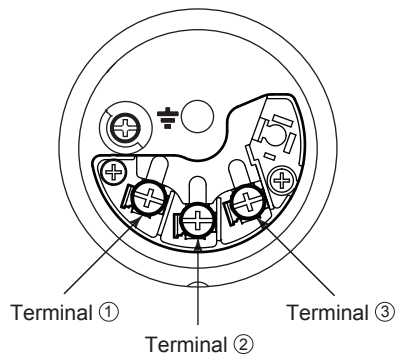

- Terminal Wiring

SUPPLY	+	①	Power supply and output terminals
	-	②	
CHECK	+	③	External indicator (ammeter) terminals*1*2
or	-	②	
ALARM	+	③	Status contact output terminals*2
	-	②	
			 Ground terminal

\*1: When using an external indicator or check meter, the internal resistance must be 10  $\Omega$  or less. A check meter or indicator cannot be connected when /AL option is specified.

\*2: Not available for FOUNDATION Fieldbus and PROFIBUS PA communication types.