

EJX110A
Differential Pressure Transmitter
Bottom Process Connection

DPharp *EJX*™


SD 01C25B01-02E

[Style: S3]


- **Bottom Process Connection** (Installation code B)

Unit: mm (approx. inch)

Measurement span code M, H and V, except for option code /HD and /HD2

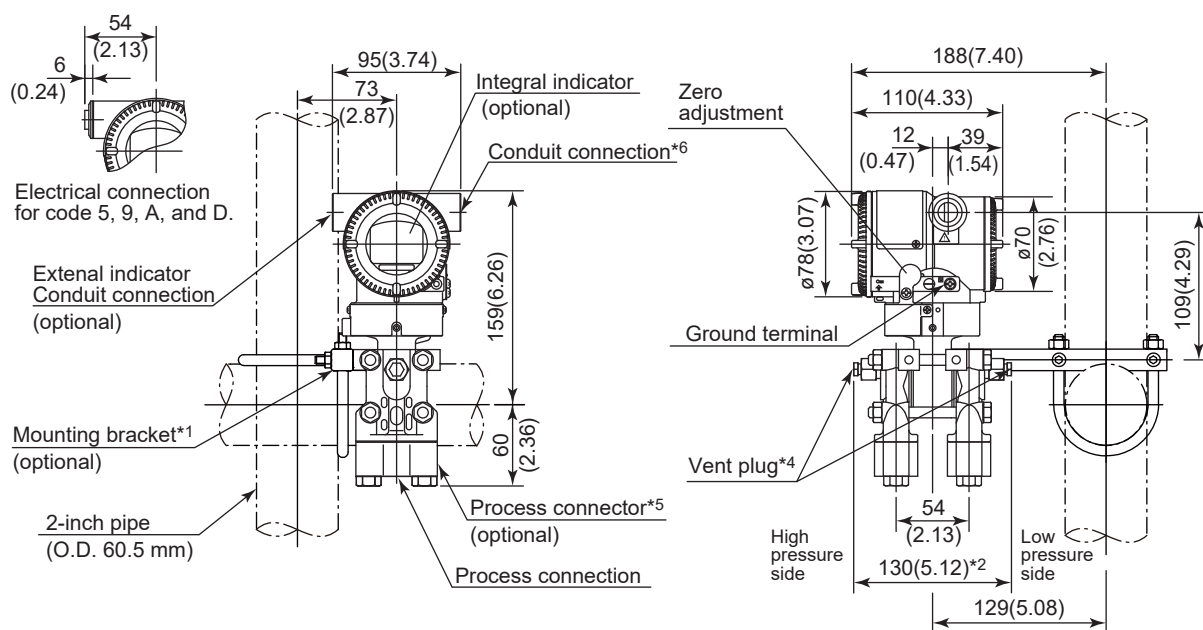

Measurement span code F or option code /HD, /HD2

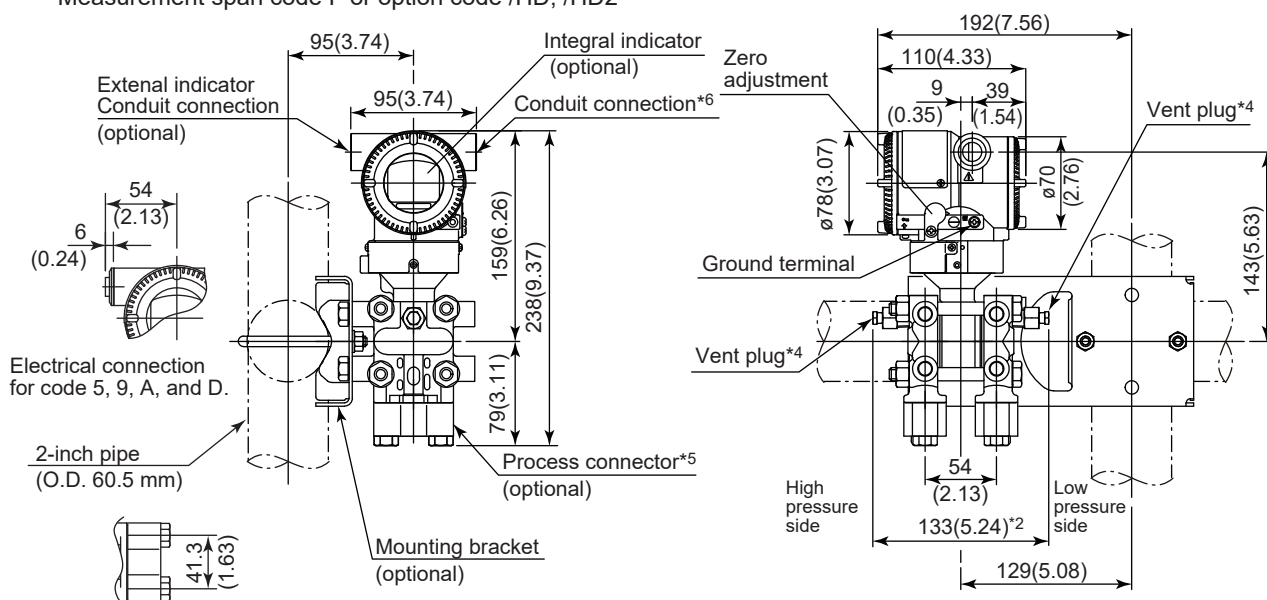

*1: A transmitter with SST housing is not applicable for mounting to horizontal 2-inch pipe.

*2: When option code K1, K2, K5, K6, K41, K42, K45, or K46 is selected, add 30 mm (1.18 inch) to the value in the figure.


*3: When electrical connection code 7 or C is selected, a blind plug is protruded up to 8 mm (0.31 inch) from the conduit connection.

*4: When option code UN is specified, Vent holes and plugs are not applicable.

*5: When option code BS is selected, a bug screen is attached in the process connection port on the cover flange of low pressure side.
No process connector for low pressure side is attached in that case.

*6: When option code PP is selected, a blind plug is attached to the conduit connection on both sides.

• Terminal Configuration

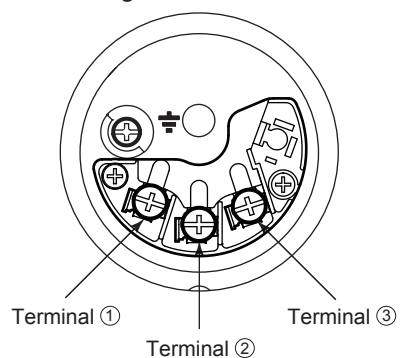

• Terminal Wiring

SUPPLY	+	①	Power supply and output terminals
	-	②	
CHECK	+	③	External indicator (ammeter) terminals*1*2
or	-	②	
ALARM	+	③	Status contact output terminals*2
	-	②	
		⏏	Ground terminal

*1: When using an external indicator or check meter, the internal resistance must be 10 Ω or less. A check meter or indicator cannot be connected when /AL option is specified.

*2: Not available for FOUNDATION Fieldbus and PROFIBUS PA communication types.