




Unit: mm (approx. inch)


• Horizontal Impulse Piping Type (The drawing below is for Installation code 9.)

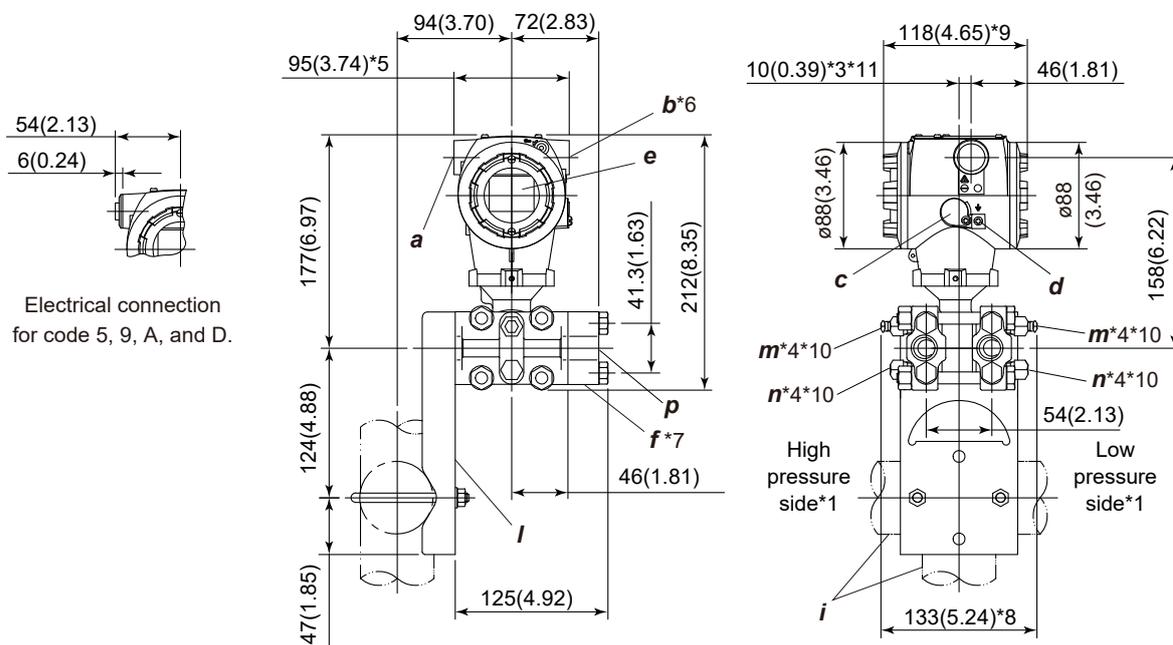

<b>a</b>	External indicator Conduit connection (optional)	<b>e</b>	Display (optional)	<b>m</b>	Vent plug
<b>b</b>	Conduit connection	<b>f</b>	Process connector (optional)	<b>n</b>	Drain plug
<b>c</b>	Zero adjustment	<b>i</b>	2-inch pipe (O.D. 60.5 mm)	<b>p</b>	Process connection
<b>d</b>	Ground terminal	<b>l</b>	Mounting bracket (Flat-type, optional)		

- \*1: In case of Installation code 2, 3, or 8 is specified, high and low pressure side on the above figure are reversed. (i.e. High pressure side is on the right side)
- \*2: In case of optional codes /K01, /K05, /K41 and /K45 specified, add 15 mm (0.59 inch).
- \*3: In case of Installation code 2, 3, or 8 is specified, it is 16 mm (0.63 inch).
- \*4: In case of optional code /UN specified, plugs are not attached.
- \*5: In case of electrical connection code 7 or C is specified, a blind plug is protruded by up to 8 mm (0.31 inch) from conduit connection.
- \*6: In case of optional code /PP specified, a blind plug is attached to conduit connection on both sides.
- \*7: In case of optional code /BS specified, a bug screen is installed to the process connection port of the low side cover flange, and no process connector is attached on the low pressure side.
- \*8: In case of optional codes /K01, /K05, /K41 and /K45 specified, add 30 mm (1.18 inch).
- \*9: In case of Display and interface code N specified, it is 113 mm (4.45 inch).
- \*10: In case of optional code /GS specified, plugs are not attached.
- \*11: In case of Capsule range code E is specified, it is 13 mm (0.51 inch).

• Terminal Configuration

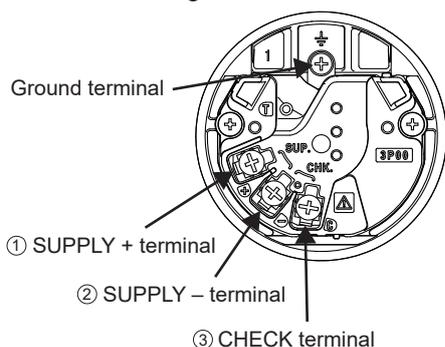

• Terminal Wiring

SUPPLY	+	①	Power supply and output terminals
	-	②	
CHECK	+	③	External indicator (ammeter) terminals *1
	-	②	
			⏏ Ground terminal

- \*1: When using an external indicator or check meter, the internal resistance must be 10Ω or less. Not available for PROFINET communication type.