


Drawings

OpreX™ Pressure Transmitter EJX110S Differential Pressure Transmitter Universal Flange Capsule Range Code: E, F, J, K, P, Q

SD 01C33C10-10EN

Unit: mm (approx. inch)


- Universal Flange (The drawing below is for Installation code U.)
 - Capsule Range Code: E, F, J, K, P, Q

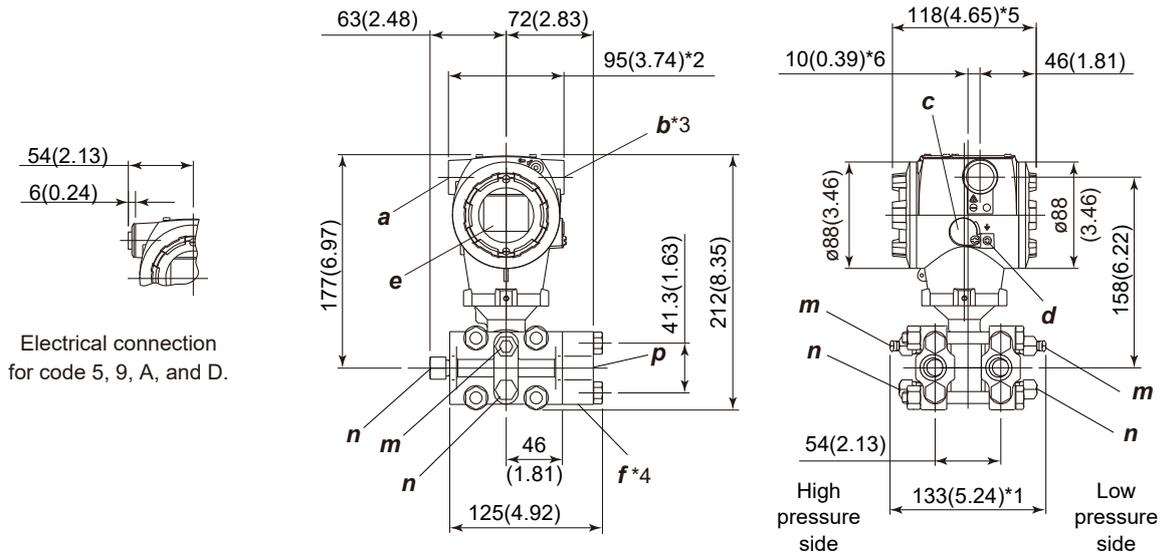

a	External indicator Conduit connection (optional)	d	Ground terminal	m	Vent plug
b	Conduit connection	e	Display (optional)	n	Drain plug
c	Zero adjustment	f	Process connector (optional)	p	Process connection

- *1: In case of optional codes /K01, /K05, /K41 and /K45 specified, add 30 mm (1.18 inch).
- *2: In case of electrical connection code 7 or C is specified, a blind plug is protruded by up to 8 mm (0.31 inch) from conduit connection.
- *3: In case of optional code /PP specified, a blind plug is attached to conduit connection on both sides.
- *4: In case of optional code /BS specified, a bug screen is installed to the process connection port of the low side cover flange, and no process connector is attached on the low pressure side.
- *5: In case of Display and interface code N specified, it is 113 mm (4.45 inch).
- *6: In case of Capsule range code E is specified, it is 13 mm (0.51 inch).

• Terminal Configuration

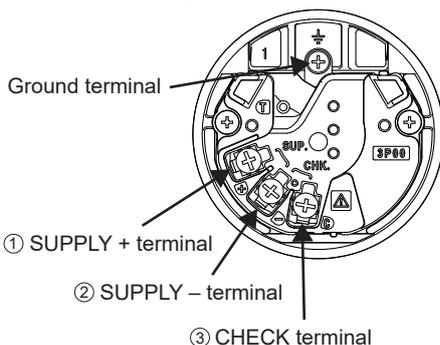

• Terminal Wiring

SUPPLY +	①] Power supply and output terminals
-	②	
CHECK +	③] External indicator (ammeter) terminals *1
-	②	
Ground terminal		

- *1: When using an external indicator or check meter, the internal resistance must be 10Ω or less. Not available for PROFINET communication type.