

Drawings


OpreX™ Pressure Transmitter
 EJX110S Differential Pressure Transmitter
 Universal Flange
 Capsule Range Code: 1, 2, 3, 5, 6 and
 Bolts and Nuts Material Code: D, F, H, L, K

SD 01C33C10-11EN

Unit: mm (approx. inch)

• **Universal Flange (The drawing below is for Installation code U.)**


• Bolts and Nuts Material Code: D, F, L

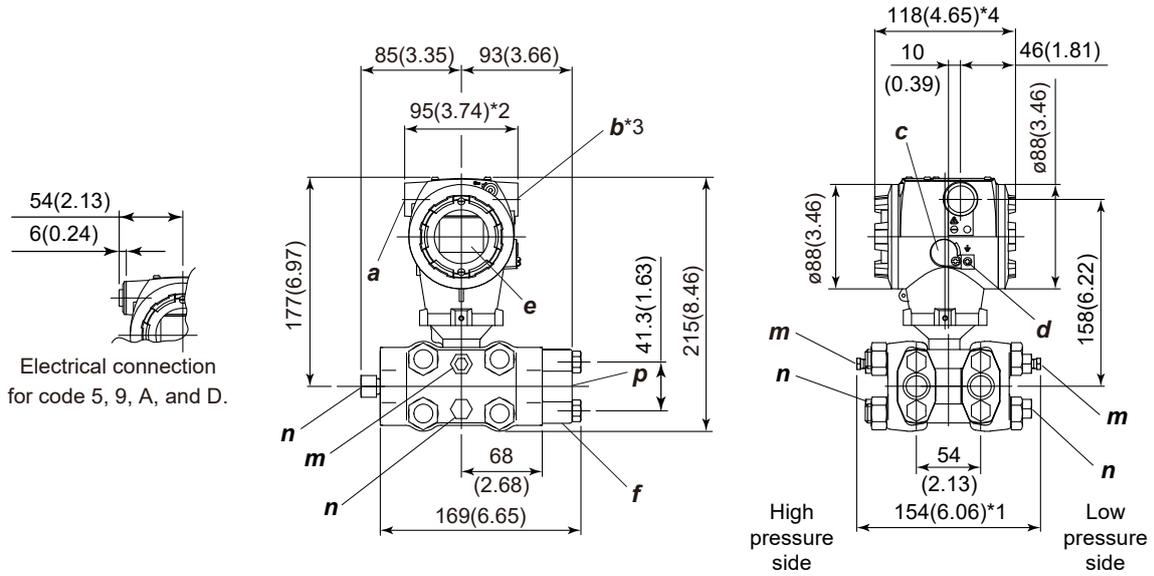

a External indicator Conduit connection (optional)	d Ground terminal	m Vent plug
b Conduit connection	e Display (optional)	n Drain plug
c Zero adjustment	f Process connector (optional)	p Process connection

Unit: mm (approx. inch)


• Bolts and Nuts Material Code: K, H

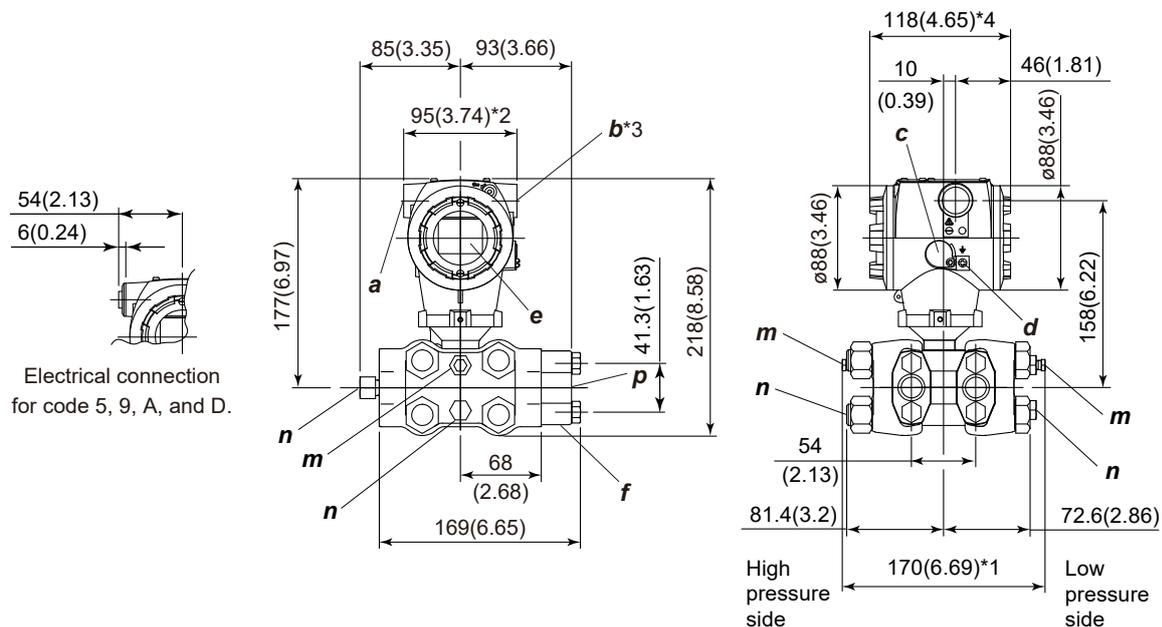

a	External indicator Conduit connection (optional)	d	Ground terminal	m	Vent plug
b	Conduit connection	e	Display (optional)	n	Drain plug
c	Zero adjustment	f	Process connector (optional)	p	Process connection

- *1: In case of optional codes /K01, /K05, /K41 and /K45 specified, add 30 mm (1.18 inch).
- *2: In case of electrical connection code 7 or C is specified, a blind plug is protruded by up to 8 mm (0.31 inch) from conduit connection.
- *3: In case of optional code /PP specified, a blind plug is attached to conduit connection on both sides.
- *4: In case of Display and interface code N specified, it is 113 mm (4.45 inch).

• Terminal Configuration

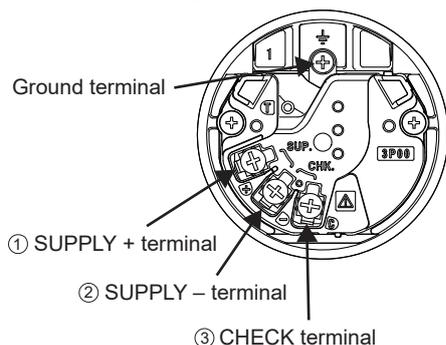

• Terminal Wiring

SUPPLY +	①] Power supply and output terminals
-	②	
CHECK +	③] External indicator (ammeter) terminals *1
-	②	
Ground terminal		

*1: When using an external indicator or check meter, the internal resistance must be 10Ω or less. Not available for PROFINET communication type.