


Drawings

OpreX™ Pressure Transmitter EJX310S Absolute Pressure Transmitter Bottom Process Connection

SD 01C33D10-08EN

Unit: mm (approx. inch)


- Bottom Process Connection (The drawing below is for Installation code B.)

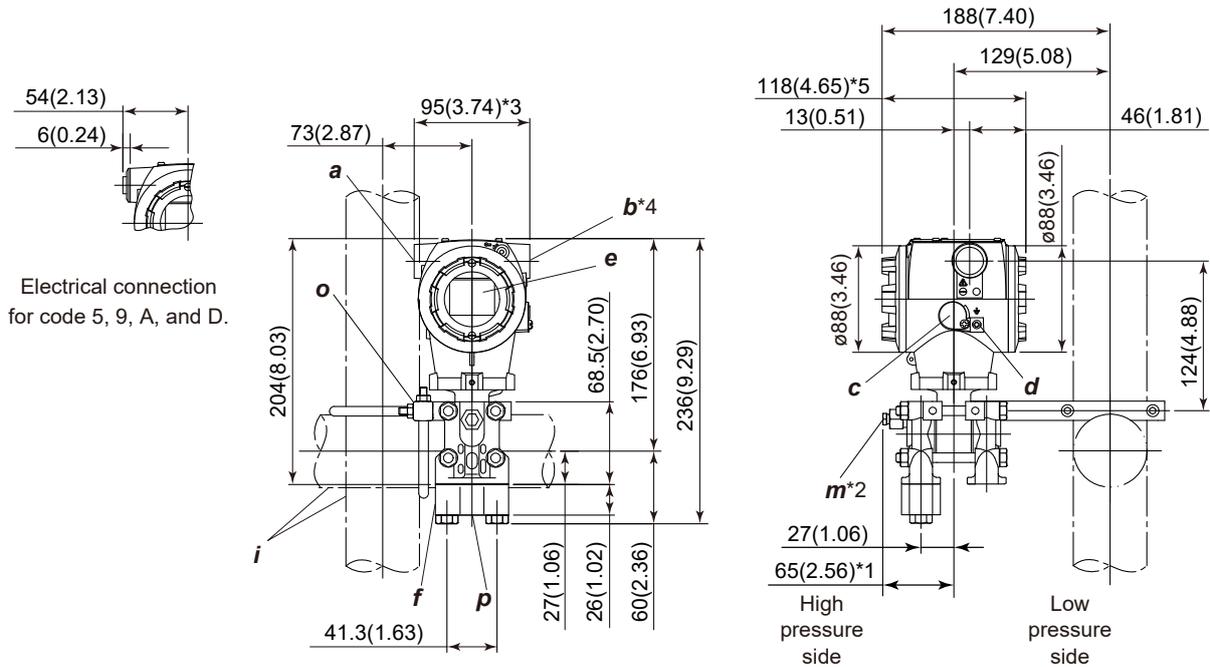

a	External indicator Conduit connection (optional)	e	Display (optional)	o	Mounting bracket (optional)
b	Conduit connection	f	Process connector (optional)	p	Process connection
c	Zero adjustment	i	2-inch pipe (O.D. 60.5 mm)		
d	Ground terminal	m	Vent plug		

- *1: In case of optional codes /K01, /K05, /K41 and /K45 specified, add 15 mm (0.59 inch).
- *2: In case of optional code /JN specified, plugs are not attached.
- *3: In case of electrical connection code 7 or C is specified, a blind plug is protruded by up to 8 mm (0.31 inch) from conduit connection.
- *4: In case of optional code /PP specified, a blind plug is attached to conduit connection on both sides.
- *5: In case of Display and interface code N specified, it is 113 mm (4.45 inch).

- Terminal Configuration

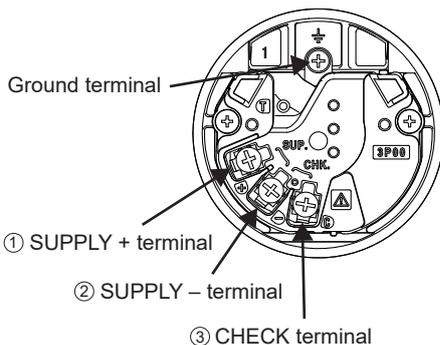

- Terminal Wiring

SUPPLY	+	①	Power supply and output terminals
	-	②	
CHECK	+	③	External indicator (ammeter) terminals *1
	-	②	
			⏚ Ground terminal

- *1: When using an external indicator or check meter, the internal resistance must be 10Ω or less. Not available for PROFINET communication type.