


# Drawings

## OpreX™ Pressure Transmitter EJX310S Absolute Pressure Transmitter Universal Flange

SD 01C33D10-09EN

Unit: mm (approx. inch)


- Universal Flange (The drawing below is for Installation code U.)

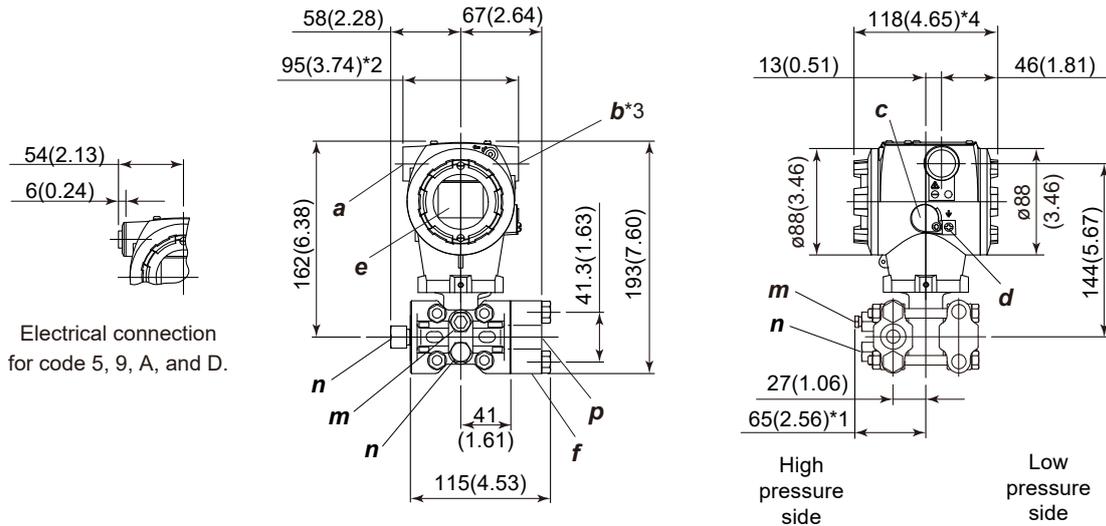

<b>a</b> External indicator Conduit connection (optional)	<b>d</b> Ground terminal	<b>m</b> Vent plug
<b>b</b> Conduit connection	<b>e</b> Display (optional)	<b>n</b> Drain plug
<b>c</b> Zero adjustment	<b>f</b> Process connector (optional)	<b>p</b> Process connection

- \*1: In case of optional codes /K01, /K05, /K41 and /K45 specified, add 15 mm (0.59 inch).
- \*2: In case of electrical connection code 7 or C is specified, a blind plug is protruded by up to 8 mm (0.31 inch) from conduit connection.
- \*3: In case of optional code /PP specified, a blind plug is attached to conduit connection on both sides.
- \*4: In case of Display and interface code N specified, it is 113 mm (4.45 inch).

### • Terminal Configuration

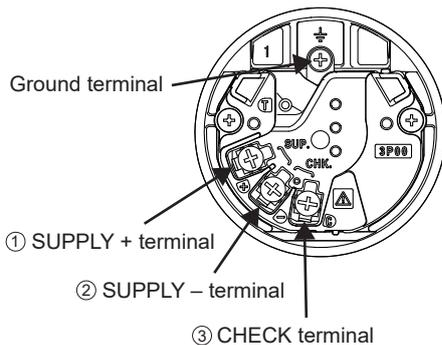

### • Terminal Wiring

SUPPLY +	①	Power supply and output terminals
-	②	
CHECK +	③	External indicator (ammeter) terminals *1
-	②	
		⏏ Ground terminal

- \*1: When using an external indicator or check meter, the internal resistance must be 10Ω or less. Not available for PROFINET communication type.