

# Alarm Rationalization for Improving Safety

- An Application Example in Petrochemical Corporation of Singapore (Private) Limited -

Ng Kok Chu <sup>\*1</sup>      Koji Ueda <sup>\*2</sup>

---

*Proper alarming is critical for safe and stable plant operations. Along with the progress of control systems, alarms can be easily created for various conditions compared with the era when alarms were indicated and consolidated on a panel consisting of a series of annunciators. However, numerous nuisance alarms can overwhelm the operators. This report outlines Yokogawa's Alarm Rationalization and introduces an application example where nuisance alarms were reduced by 66% and safer and more stable plant operation was thus achieved.*

---

## INTRODUCTION

As plant operation becomes more intelligent and complex, the alarm system for safe and stable operation is becoming increasingly important. An alarm warns operators of an abnormal situation in a process and urges them to respond to it. However, alarm flooding may cause operators to miss critical alarms or to misjudge the situation, which increases the risk of plant disaster or production losses. Thus, proper alarm management is critical for safe and stable plant operations. According to the investigation report on the explosion and fire at a refinery in Milford Haven, Britain in 1994<sup>(1)</sup>, numerous alarms were announced for five hours before the explosion and the operators overlooked the alarms that indicated the signs leading to the explosion. The safety of a plant can be maintained only when “the right alarms are annunciated to operators at the right timing”

Yokogawa's Alarm Rationalization improves the performance of a customer's alarm system. The service consists of the following.

- Fundamental nuisance alarm reduction

- Engineering Equipment and Material Users Association (EEMUA) #191-based alarm system design<sup>(2)</sup>
- Operational State-based Alarm Management

These services aim at improving plant safety through alarm rationalization.

This paper provides an outline of the Fundamental Nuisance Alarm Reduction and an example in which this service helped ensure safe and stable plant operation.

## BACKGROUND OF INTRODUCTION

Petrochemical Corporation of Singapore (Private) Limited (PCS), which was concerned about so many alarms in their plant, learned that Yokogawa's Alarm Rationalization would meet their needs and decided to introduce the Fundamental Nuisance Alarm Reduction as a first step.

PCS was established jointly by the Singapore government and Japan-Singapore Petrochemicals Co., Ltd. (JSPC) in 1977. The present shareholders are JSPC and QPI and Shell Petrochemicals (Singapore) Pte Ltd. PCS, situated in Julong Island, Singapore, is the upstream company of the Singapore Petrochemical Complex. PCS has two trains of petrochemical plants: PCS1 started in 1984 and PCS2 was added in 1997. As shown in Figure 1, PCS exports toluene and xylene as well as supplies basic petrochemical products, such as ethylene, propylene, acetylene, butadiene, methyl tertiary-butyl ether (MTBE) and benzene to downstream companies in the complex.

---

<sup>\*1</sup> Petrochemical Corporation of Singapore (Private) Limited

<sup>\*2</sup> Vigilant Plant Services Center,  
Industrial Automation Business Headquarters

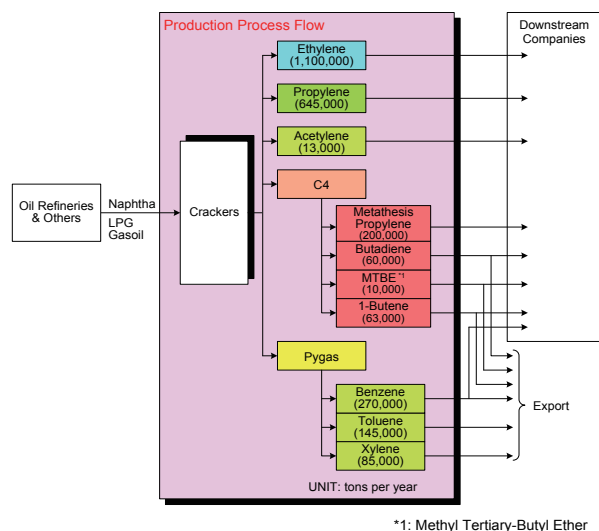


Figure 1 PCS's production flow

## FUNDAMENTAL NUISANCE ALARM REDUCTION

This section provides an outline of the Fundamental Nuisance Alarm Reduction and explains the procedure.

### Outline

The Fundamental Nuisance Alarm Reduction is the introductory service among the Alarm Rationalization services. This service collects and analyzes alarm and event logs (A&E) recorded during operations to identify the root causes of individual alarms and works out the solutions. The key is how to distinguish nuisance alarms from good ones. "Alarm Systems," EEMUA Publication No. 191, is the de facto standard for alarm management, providing the characteristics of a good alarm as shown in Figure 2. In this service, eliminating nuisance alarms is investigated while keeping these characteristics in mind.

The Alarm Rationalization also offers the EEMUA #191-based Alarm System Design and Operational State-based Alarm Management. The EEMUA #191-based Alarm System Design enables advanced alarm processing using the Consolidated Alarm Management Software (CAMS) that runs on the CENTUM VP and CS 3000, Yokogawa's distributed control systems (DCS). In addition, the Operational State-based Alarm Management enables dynamic alarm management for changes in operation states, in such operations as startup of a plant or change in types of products.

All the service procedures of the Alarm Rationalization are defined in accordance with the DMAIC steps of Six Sigma, and tasks for the individual steps are clarified. The services are provided only by qualified engineers who have been trained through a training system with a virtual plant utilizing a dynamic process simulator and who have passed the qualification test. By standardizing working procedures and training systems in this way, Yokogawa ensures the quality of service.

Relevant	: not spurious or of low operational value
Unique	: not duplicating another alarm
Timely	: not long before any response is needed or too late to do anything
Prioritized	: indicating the importance that the operator deals with the problem
Understandable	: having a message which is clear and easy to understand
Diagnostic	: identifying the problem that has occurred
Advisory	: indicative of the action to be taken
Focusing	: drawing attention to the most important issues

Figure 2 Characteristics of a good alarm

### Implementation Procedure

Figure 3 shows the implementation procedure of the Fundamental Nuisance Alarm Reduction, and Figure 4 shows the phases of the service.

<b>Define</b>	- Establish Cross Functional Team (CFT) - Set target for the performance of the alarm system during normal operation
<b>Measure</b>	- Acquire A&E logs for various operational states
<b>Analyze</b>	- Sort acquired A&E logs - Identify root causes of nuisance alarms through team discussion
<b>Improve</b>	- Identify proper countermeasure to reduce alarms - Take practical countermeasures and monitor the performance
<b>Control</b>	- Evaluate performance improvement - Establish the management of change - Establish the alarm management system

Figure 3 Service implementation procedure

Step	Activity	Yokogawa	Client	Site/Office	1 <sup>st</sup> Month	2 <sup>nd</sup> Month	3 <sup>rd</sup> Month
D	KOM, Meeting for target setting	✓	✓	S			
M	Acquisition of Alarms & Events message logs	✓	✓	S			
	Data analysis and interim report	✓		O			
A	Quality check of the report	✓		O			
	CFT meeting for identifying causes and countermeasures	✓	✓	S			
I	Implementation of countermeasure for reducing nuisance alarms		✓	S			
	Telephone or E-mail support	✓		O			
	Evaluation of the performance improvement		✓	S			
	Preparation of a service report	✓		O			
C	Review of a service report	✓		S			
	Modification of a service report	✓		O			
	Final report qualification	✓		O			
	Submission of a service report	✓		O			

Client  
Yokogawa or Yokogawa + Client

Figure 4 Service phases

### Define

This service begins with securing the strong commitment of the customer's top management to proceed with the improvement through alarm rationalization. The efforts of Yokogawa or a single department of the customer are not enough for such plant-wide activities as alarm rationalization that requires cooperation among relevant departments of the customer. The management's commitment is vital for securing the cooperation among the departments and their resources.

Next, an improvement team is formed by people from Yokogawa and the relevant departments of the customer. This cross functional team (CFT) includes engineers or chief-

level engineers from various departments such as operation, process, instrumentation, machinery, and maintenance departments who have expertise in each area. Studies by members from such diverse areas will help carry out the improvements effectively.

The kickoff meeting is then held, and the target alarm load, which is the alarm reduction target to be achieved by this service, is set.

#### ■ Measure

In this step, A&E used for analysis is prepared. A&E must be recorded for at least one month of operation because it is desirable for it to include various operating conditions.

#### ■ Analyze

A&Es obtained in the Measure step are sorted in order of frequency and are written in a worksheet used for the improvement work. Such information as the ratio of alarms for a certain tag to all the alarms, the number of alarms in ten minutes, and types of alarms are also added to the tag list in the worksheet. This helps clarify which alarms and tags should be eliminated to achieve the target set in the Define step. Figure 5 shows an example of the worksheet.

Upon completing the worksheet, Yokogawa first extracts the characters of the alarms and estimates root causes of alarms by paying attention to types of alarms, intervals and sequences of alarms related with other events and so forth.

Then, a CFT meeting is held, and the root cause of each alarm is identified by the team members utilizing information such as the usage of an alarm, its necessity, problems in measurement, characteristics of devices, malfunctions in the past and maintenance logs.

Tag	Alarm	Sep.09	Sep.10	Sep.11	Sep.12	Sep.13	Sep.14	Sep.15	Alarm Type	% of Nuisance Reduction	Alarm FPI (alarm/10min)
1 H35574	9485	867	1807	1900	1951	1958	1162	0	LOP	35.7	16.9
2 P827220	8819	0	0	0	0	0	1361	4455	VEL+ VEL-	57.7	11.1
3 H30015	1177	0	0	1	692	695	21	20	ANS+	62.9	9.8
4 H35570	1367	50	224	239	201	226	225	192	LOP	68.0	8.4
5 A25520	1125	0	0	0	0	0	82	943	LOP, LOP-	71.8	7.4
6 A20111	755	0	0	0	0	0	0	755	HI	74.7	6.7
7 A27631	729	0	124	553	0	0	45	5	LOP	77.4	5.9
8 T38118	629	0	77	166	94	152	69	61	LOP	75.9	6.2
9 PY27502M	545	0	525	0	0	0	0	3	HI	81.9	4.8
10 P18023	392	0	0	0	0	0	15	377	LOP-	83.3	4.4
11 H71631	381	0	1	324	28	11	17	0	PERR	84.8	4.0
12 A23632	324	0	0	0	0	0	141	183	HI	86.0	3.7
13 FY70020M	323	0	0	0	39	284	0	0	LO, LL	87.2	3.4
14 H70001	320	49	270	1	0	0	0	0	ANS+	88.4	3.0
15 P70005	312	4	0	0	0	308	0	0	LOP, LO, LL	89.6	2.7
16 A91031	305	0	0	0	0	0	51	303	LOP-	90.8	2.4
17 L25259C	250	31	28	6	35	29	82	39	LO	91.7	2.2
18 A95401A	232	0	0	0	0	0	16	216	HI, LO	92.6	2.0
19 PC35517A	224	7	7	7	134	5	53	11	HI, HI, LO	93.4	1.7

Figure 5 Worksheet example

#### ■ Improve

After the root causes have been identified, measures against those causes are determined. Fundamental measures are desirable to get rid of causes. However, next-best measures may have to be considered if the best measures require modification of the equipment or process and are difficult to implement in the near future.

The following are typical measures that can be implemented in instrumentation.

- Reviewing alarm settings
- Reviewing alarm hysteresis settings

- Switching unnecessary alarms off
- Adding logic, e.g., a chattering prevention timer
- Adding alarm activation condition logic
- Repairing and replacing instruments in the field
- Reviewing measurement ranges
- Changing sensor locations

Once the measures are finalized, they are actually applied to the plant. The measures vary from those that can be easily implemented, to those that require works during plant shutdown, and sometimes require new software packages or devices.

After taking the measures, A&E is obtained again to verify the effect.

#### ■ Control

By analyzing the obtained A&E, the improvement is evaluated, and the final report is created. In addition to the alarm reduction result, the report includes recommendations for further improvement that could not be implemented within the project period for some reason, such as plant shutdown is required to implement it.

Furthermore, the final report contains suggestions on change management and the alarm management organization for maintaining the effects of the measures, as well as the framework of the project including the history, organization, schedule and procedures for future reference.

### APPLICATION EXAMPLE OF FUNDAMENTAL NUISANCE ALARM REDUCTION

This section provides an application example of the Fundamental Nuisance Alarm Reduction introduced to PCS.

#### Implementation


In the Define step, the target of alarms announced during normal operation was set at two alarms or fewer per ten minutes per operator. Usually, the target tags for analysis are determined based on the active alarms. In this application, however, it was known from past data that there were many tags set to Alarm Off (AOF: alarms are suppressed) and long-standing alarms that are not recorded in A&E. To review the alarm system from scratch, we decided to include those tags and alarms in the analysis.

All the members of the CFT consisting of key persons from various departments of the customer attended Yokogawa's Improvement Leader Development Program and learned the contents of Alarm Rationalization and the procedure to reduce alarms through training using the desktop virtual experience in advance. As a result, they thoroughly understood the service and could carry out the subsequent improvement activities efficiently.

In the Measure step, an alarm event log was recorded from one month before the kickoff meeting using Yokogawa's Exaplog event analysis package. Figure 6 shows part of the log.


Since Exaplog is not only a simple logger but also a process analytical tool, it can display alarms and events

graphically and many data processing functions are prepared for further analysis. It is very effective also in the Analyze step.

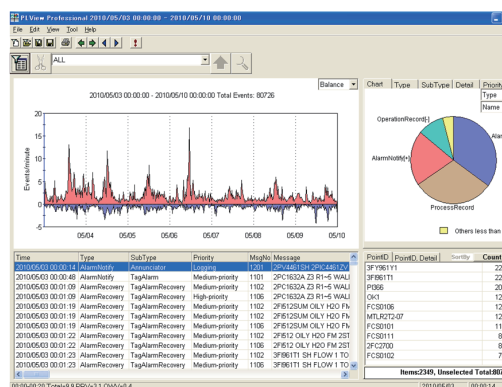

**Figure 6** Example of Exaplog event analysis package display

Figure 7 shows the distribution of the measures for nuisance alarm reduction finalized in the Improve step.

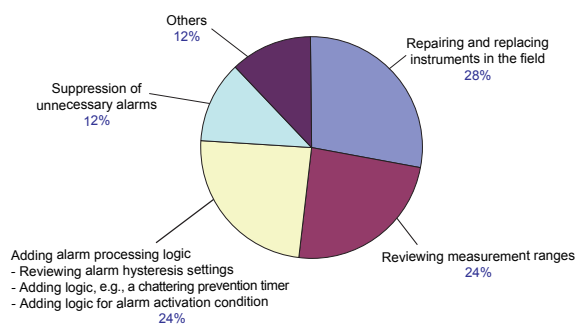

**Figure 7** Distribution of the measures for nuisance alarm reduction

## Results Achieved by the Service

The Alarm Rationalization has achieved the following results.

### ■ Reducing operator workload and improving productivity by alarm reduction

The alarms from tags of concern were reduced by 66%. Thanks to the reduction in burden caused by nuisance alarms, operators now can focus more on productivity improvement and safe, stable operation of the plant.

### ■ Improving safety by utilizing all the alarms

AOF settings of all the AOF tags were cancelled once by reviewing alarm parameters. As a result, those alarms were again recognized as effective by operators and were

used to notify abnormal situations in the plant that had been submerged by AOF. Thus, safer operation has been achieved.

### ■ Effective alarm management system

We have established a system in which long-standing alarms are periodically reported to the operation and maintenance managers to remind them of the alarms and let them remove the alarms. This system was especially effective to create awareness among operators that alarms should not be ignored.

### ■ Management of change

Management of change in alarm settings and AOF settings is one of the most important items for maintaining plant safety. We have established application and approval processes when such items need to be changed. When applying to make a change, the background and reasons for the change must be attached to give a clear view of the change.

### ■ Sustainable alarm management

The alarm CFT organized for this project has turned into an alarm audit team. The alarm audit added in the alarm management system has a function to maintain the best alarm performance achieved by this project. It reviews the alarm performance and recommends further improvement both from technical and management points of view.

## CONCLUSION

As described, the aim of Alarm Rationalization is not simply to reduce alarms but to ensure safe and stable plant operation. Proper control of alarms enables the operators to surely recognize the plant situation at the earliest opportunity.

These improvements tend to end after being implemented once, although continuous activities are essential to improve safety. As described in “Sustainable alarm management”, a system for periodical review is important. VigilantPlant Services, the theme of this Yokogawa Technical Report, include services that assist such periodic improvement activities.

Yokogawa will continue to contribute to safe and stable plant operation by making the most of VigilantPlant Services.

## REFERENCES

- (1) Health and Safety Executive, “The Explosion and Fires at the Texaco Refinery, Milford Haven, 24 July 1994,” HSE Books, 1997
- (2) EEMUA Publication No. 191 2nd Edition, Alarm Systems - A Guide to Design, Management and Procurement, 2007

\* CENTUM, Exaplog and VigilantPlant Services are registered trademarks of Yokogawa Electric Corporation.